


Private Drinking Water Well Sampling Results

(Original wells; results for new deep wells not shown)

Dec. 2017 to Dec. 2023

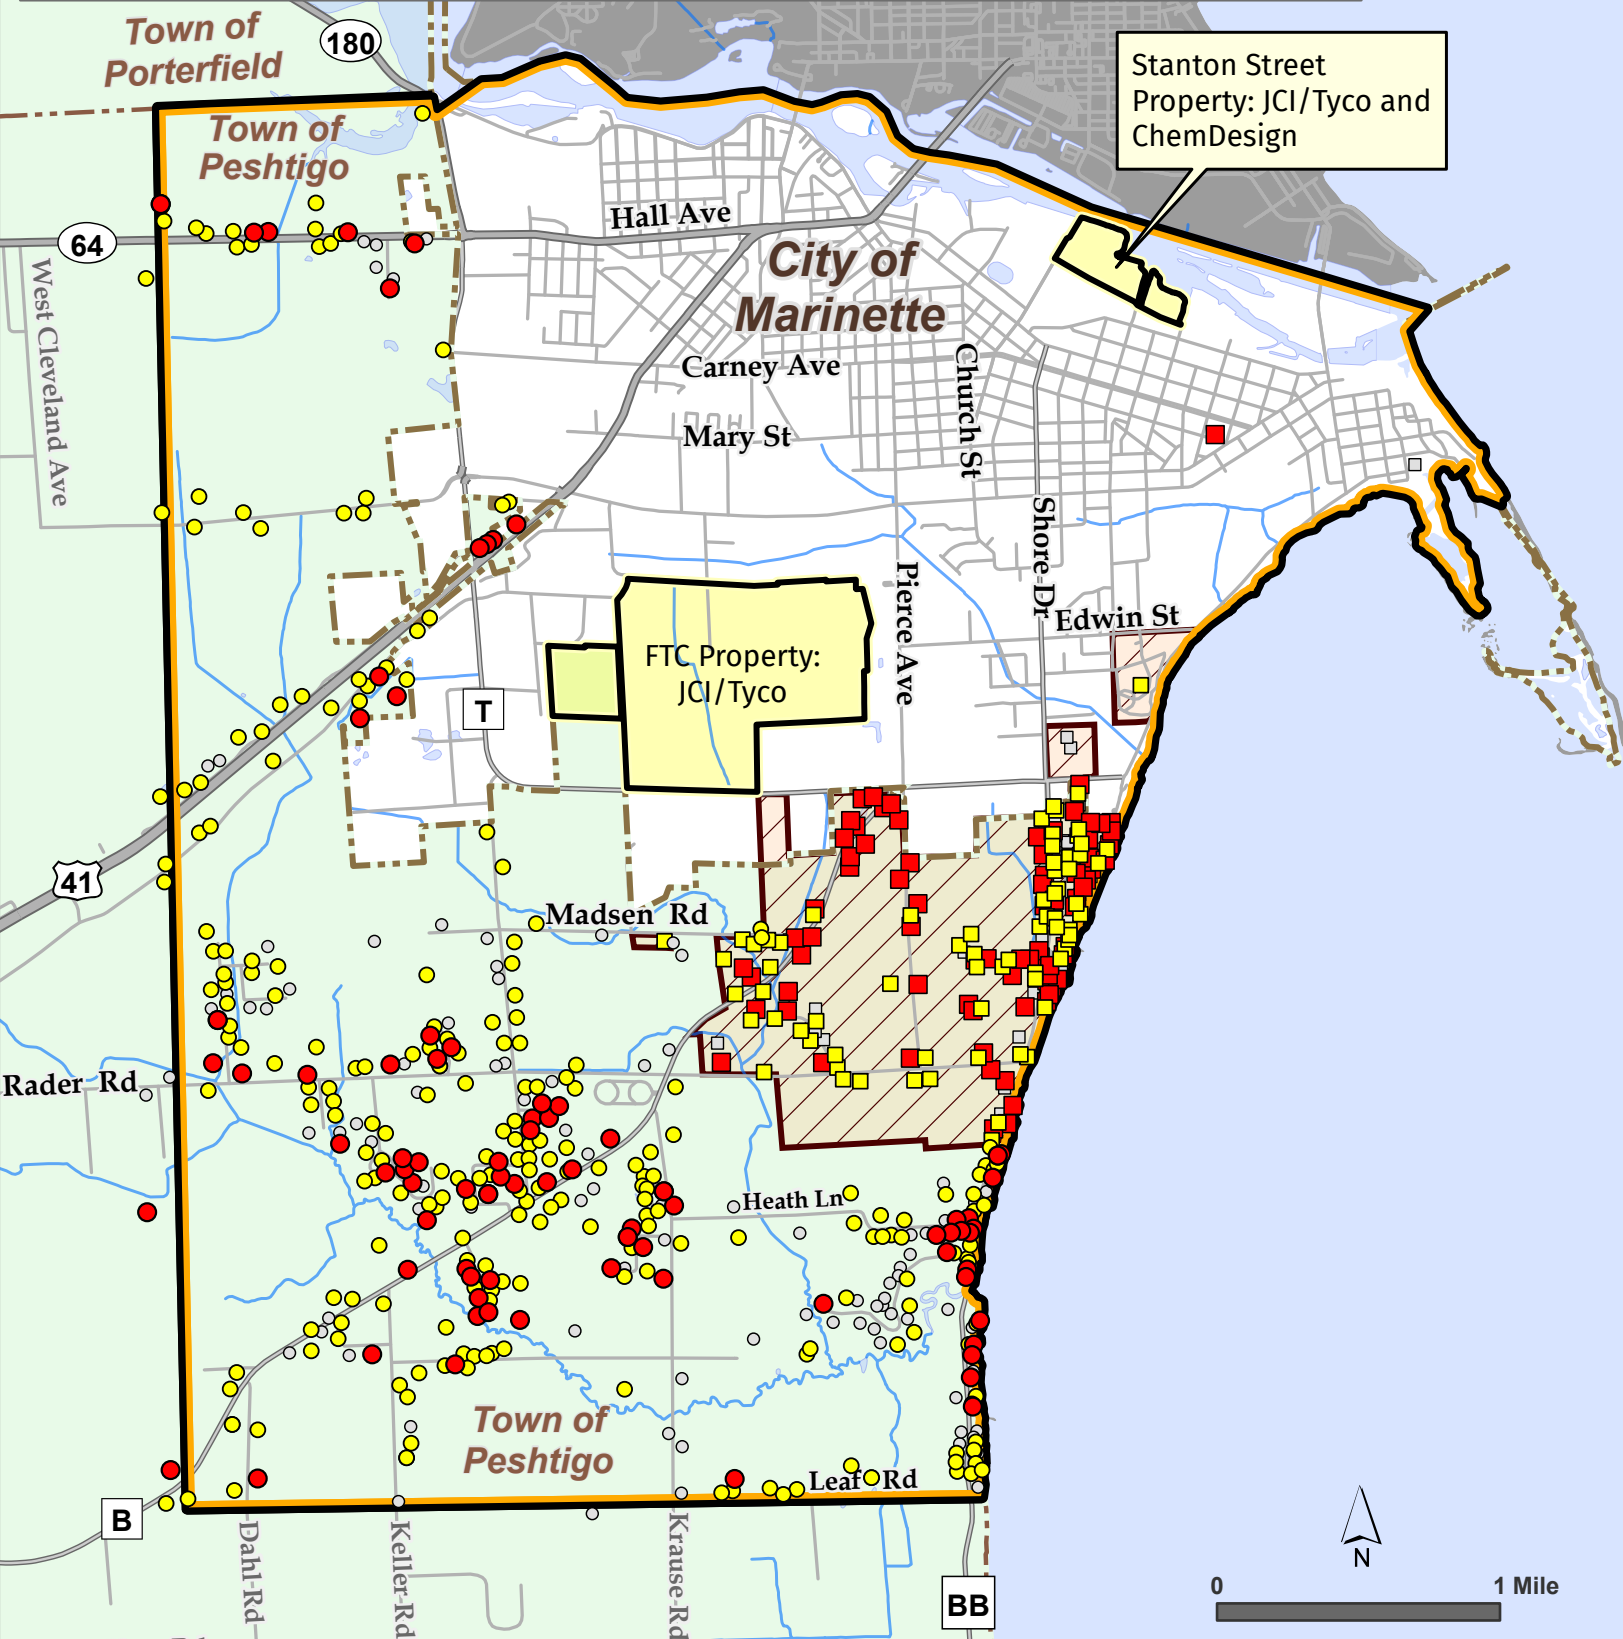

- Investigation Area
- JCI/Tyco Potable Well Sampling Area
- Sampled by JCI/Tyco
- Sampled by DNR

Private Drinking Water Well Results

- PFAS not detected
- PFAS < DHS Guidelines *
- PFAS >= DHS Guidelines *

* Health Advisory Level for 18 PFAS and Hazard Index < 1.0 (updated Feb. 2025)

Remediation & Redevelopment Program
Wisconsin Department of Natural Resources

