



WPDES PERMIT

STATE OF WISCONSIN
DEPARTMENT OF NATURAL RESOURCES
**PERMIT TO DISCHARGE UNDER THE WISCONSIN POLLUTANT DISCHARGE
ELIMINATION SYSTEM**

City of Chilton

is permitted, under the authority of Chapter 283, Wisconsin Statutes, to discharge from two facilities in Calumet County: Chilton Wastewater Treatment Facility and Chilton Waterworks Softener Plant #8, located at 457 East Main St, Chilton, WI

to

the South Branch of the Manitowoc River (WBIC no. 77900), in the South Branch of the Manitowoc River Watershed (MA05) of the Manitowoc River Basin

in accordance with the effluent limitations, monitoring requirements and other conditions set forth in this permit.

The permittee shall not discharge after the date of expiration. If the permittee wishes to continue to discharge after this expiration date an application shall be filed for reissuance of this permit, according to Chapter NR 200, Wis. Adm. Code, at least 180 days prior to the expiration date given below.

State of Wisconsin Department of Natural Resources
For the Secretary

By _____
Heidi Schmitt Marquez
Wastewater Field Supervisor

Date Permit Signed/Issued

PERMIT TERM: EFFECTIVE DATE - April 01, 2025

EXPIRATION DATE - March 31, 2030

TABLE OF CONTENTS

1 INFLUENT REQUIREMENTS	1
1.1 SAMPLING POINT(S)	1
1.2 MONITORING REQUIREMENTS	1
1.2.1 <i>Sampling Point 701 - INFLUENT</i>	1
2 IN-PLANT REQUIREMENTS	2
2.1 SAMPLING POINT(S)	2
2.2 MONITORING REQUIREMENTS AND LIMITATIONS	2
2.2.1 <i>Sampling Point 104 - SOFTENER PLANT #8 EFFLUENT</i>	2
2.2.2 <i>Sampling Point 105 - WWTF EFFLUENT</i>	3
3 SURFACE WATER REQUIREMENTS	9
3.1 SAMPLING POINT(S)	9
3.2 MONITORING REQUIREMENTS AND EFFLUENT LIMITATIONS	9
3.2.1 <i>Sampling Point (Outfall) 002 - COMBINED EFFLUENT</i>	9
4 LAND APPLICATION REQUIREMENTS	15
4.1 SAMPLING POINT(S)	15
4.2 MONITORING REQUIREMENTS AND LIMITATIONS	15
4.2.1 <i>Sampling Point (Outfall) 004 - LIQUID SLUDGE</i>	15
5 SCHEDULES	21
5.1 CHLORIDE SOURCE REDUCTION MEASURES (TARGET VALUE)	21
5.2 TMDL-BASED EFFLUENT MASS LIMITS FOR TOTAL PHOSPHORUS	22
5.3 PFOS/PFOA MINIMIZATION PLAN DETERMINATION OF NEED	22
5.4 INSTALL CONTINUOUS FLOW RECORDING DEVICE	23
5.5 DISSIPATIVE COOLING STUDY	23
5.6 SS (SANITARY SEWAGE COLLECTION SYSTEM) SUBCLASS	24
5.7 SLUDGE MANAGEMENT PLAN	24
6 STANDARD REQUIREMENTS	25
6.1 REPORTING AND MONITORING REQUIREMENTS	25
6.1.1 <i>Monitoring Results</i>	25
6.1.2 <i>Sampling and Testing Procedures</i>	25
6.1.3 <i>Recording of Results</i>	25
6.1.4 <i>Reporting of Monitoring Results</i>	26
6.1.5 <i>Compliance Maintenance Annual Reports</i>	26
6.1.6 <i>Records Retention</i>	26
6.1.7 <i>Other Information</i>	26
6.1.8 <i>Reporting Requirements – Alterations or Additions</i>	26
6.2 SYSTEM OPERATING REQUIREMENTS	27
6.2.1 <i>Noncompliance Reporting</i>	27
6.2.2 <i>Flow Meters</i>	27
6.2.3 <i>Raw Grit and Screenings</i>	27
6.2.4 <i>Sludge Management</i>	28
6.2.5 <i>Prohibited Wastes</i>	28
6.2.6 <i>Bypass</i>	28
6.2.7 <i>Scheduled Bypass</i>	28
6.2.8 <i>Controlled Diversions</i>	29
6.2.9 <i>Proper Operation and Maintenance</i>	29
6.2.10 <i>Operator Certification</i>	29
6.3 SEWAGE COLLECTION SYSTEMS	29
6.3.1 <i>Sanitary Sewage Overflows and Sewage Treatment Facility Overflows</i>	29

6.3.2 Capacity, Management, Operation and Maintenance (CMOM) Program	31
6.3.3 Sewer Cleaning Debris and Materials	31
6.4 SURFACE WATER REQUIREMENTS	31
6.4.1 Permittee-Determined Limit of Quantitation Incorporated into this Permit	31
6.4.2 Appropriate Formulas for Effluent Calculations	32
6.4.3 Effluent Temperature Requirements	32
6.4.4 Visible Foam or Floating Solids	32
6.4.5 Surface Water Uses and Criteria	32
6.4.6 Percent Removal	33
6.4.7 E. coli	33
6.4.8 Seasonal Disinfection	33
6.4.9 Total Residual Chlorine Requirements	33
6.4.10 Whole Effluent Toxicity (WET) Monitoring Requirements	34
6.4.11 Whole Effluent Toxicity (WET) Identification and Reduction	34
6.4.12 Reopener Clause	35
6.4.13 PFOS and PFOA Requirements	35
6.5 LAND APPLICATION REQUIREMENTS	35
6.5.1 Sludge Management Program Standards And Requirements Based Upon Federally Promulgated Regulations	35
6.5.2 General Sludge Management Information	35
6.5.3 Sludge Samples	35
6.5.4 Land Application Characteristic Report	35
6.5.5 Calculation of Water Extractable Phosphorus	36
6.5.6 Annual Land Application Report	36
6.5.7 Other Methods of Disposal or Distribution Report	36
6.5.8 Approval to Land Apply	36
6.5.9 Soil Analysis Requirements	36
6.5.10 Land Application Site Evaluation	37
6.5.11 Class B Sludge: Fecal Coliform Limitation	37
6.5.12 Class B Sludge - Vector Control: Injection	37
6.5.13 Class B Sludge - Vector Control: Incorporation	37
7 SUMMARY OF REPORTS DUE	38

1 Influent Requirements

1.1 Sampling Point(s)

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
701	INFLUENT - Total combined influent from the sanitary sewage collection system and hauled waste receiving station. At Sampling Point 701, the permittee shall collect representative samples of the influent from the influent automatic composite sampler drawing 24-hour flow proportional composite samples from the influent channel following fine screening. The permittee shall measure the influent flow rate using a continuous flow recording device following fine screening and prior to the biological phosphorus removal tanks.

1.2 Monitoring Requirements

The permittee shall comply with the following monitoring requirements.

1.2.1 Sampling Point 701 - INFLUENT

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Continuous	
BOD ₅ , Total		mg/L	3/Week	24-Hr Flow Prop Comp	
Suspended Solids, Total		mg/L	3/Week	24-Hr Flow Prop Comp	

2 In-Plant Requirements

2.1 Sampling Point(s)

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
104	SOFTENER PLANT #8 EFFLUENT - This sample point is used for reporting information on the effluent discharged from the Softener Plant #8. At Sampling Point 104, the permittee shall calculate the flow rate, softener regeneration rate, regeneration cycle volume, and collect representative grab samples for chloride, total suspended solids, and total phosphorus of the Softener Plant #8 effluent prior to mixing with the wastewater treatment facility effluent from Sampling Point 105 and discharging to the South Branch of the Manitowoc River via Outfall 002.
105	WWTF EFFLUENT - At Sampling Point 105, the permittee shall collect representative samples of the final effluent from the effluent automatic composite sampler drawing 24-hour flow proportional composite samples and continuously measure the pH and dissolved oxygen after the cascade step aerator except that the permittee shall collect grab samples of the effluent for PFOA, PFOS, total residual chlorine, and E. coli from the effluent wet well prior to mixing with the Softener Plant #8 effluent from Sampling Point 104 and discharging to the South Branch of the Manitowoc River via Outfall 002. Starting on April 1, 2028, the permittee shall measure the effluent flow rate using a continuous flow recording device at a representative location following the final clarifiers.

2.2 Monitoring Requirements and Limitations

The permittee shall comply with the following monitoring requirements and limitations.

2.2.1 Sampling Point 104 - SOFTENER PLANT #8 EFFLUENT

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Estimated	See the Flow Rate - Estimated section.
Softener Regeneration		cycles/day	Daily	Count	See the Softener Regeneration - Count section.
Regeneration Cycle Volume		gal/cycle	Daily	Estimated	See the Regeneration Cycle Volume - Estimated section.
Chloride		mg/L	Weekly	Grab	
Phosphorus, Total		mg/L	Weekly	Grab	
Suspended Solids, Total		mg/L	Weekly	Grab	

2.2.1.1 Flow Rate – Estimated

The flow rate at sample point 104 shall be estimated as follows:

$$\text{Flow Rate (MGD)} = \text{Softener Regeneration (cycles/day)} \times \text{Regeneration Cycle Volume (gal/cycle)} \times 0.000001$$

2.2.1.2 Softener Regeneration – Count

The parameter *Softener Regeneration* shall be reported daily as the number of softener regeneration cycles/day at the Softener Plant #8.

2.2.1.3 Regeneration Cycle Volume – Estimated

The parameter *Regeneration Cycle Volume* shall be reported daily as the estimated volume of water discharged during a softener regeneration cycle at the Softener Plant #8.

2.2.2 Sampling Point 105 - WWTF EFFLUENT

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Continuous	Monitoring begins April 1, 2028. See the Install Continuous Flow Recording Device Schedule.
BOD ₅ , Total	Weekly Avg	16 mg/L	3/Week	24-Hr Flow Prop Comp	Applies November-April.
BOD ₅ , Total	Weekly Avg	10 mg/L	3/Week	24-Hr Flow Prop Comp	Applies May-October.
BOD ₅ , Total	Monthly Avg	16 mg/L	3/Week	24-Hr Flow Prop Comp	Applies November-April.
BOD ₅ , Total	Monthly Avg	10 mg/L	3/Week	24-Hr Flow Prop Comp	Applies May-October.
BOD ₅ , Total	Weekly Avg	156 lbs/day	3/Week	Calculated	Applies November-April.
BOD ₅ , Total	Weekly Avg	100 lbs/day	3/Week	Calculated	Applies May-October.
BOD ₅ , Total	Monthly Avg	156 lbs/day	3/Week	Calculated	Applies November-April.
BOD ₅ , Total	Monthly Avg	100 lbs/day	3/Week	Calculated	Applies May-October.
Suspended Solids, Total	Weekly Avg	15 mg/L	3/Week	24-Hr Flow Prop Comp	Applies November-April.
Suspended Solids, Total	Weekly Avg	10 mg/L	3/Week	24-Hr Flow Prop Comp	Applies May-October.
Suspended Solids, Total	Monthly Avg	15 mg/L	3/Week	24-Hr Flow Prop Comp	Applies November-April.
Suspended Solids, Total	Monthly Avg	10 mg/L	3/Week	24-Hr Flow Prop Comp	Applies May-October.
pH Field	Daily Min	6.0 su	Daily	Continuous	
pH Field	Daily Max	9.0 su	Daily	Continuous	
Dissolved Oxygen	Daily Min	8.0 mg/L	Daily	Continuous	
Chlorine, Total Residual	Daily Max	21 µg/L	Daily	Grab	Applies May-September.
Chlorine, Total Residual	Weekly Avg	6.5 µg/L	Daily	Grab	Applies May-September.
Chlorine, Total Residual	Monthly Avg	6.5 µg/L	Daily	Grab	Applies May-September.
E. coli	Geometric	126 #/100 ml	Weekly	Grab	Applies May-September.

	Mean - Monthly				
E. coli	% Exceedance	10 Percent	Monthly	Calculated	Applies May-September. See the E. coli Percent Limit section. Enter the result in the eDMR on the last day of the month.
Nitrogen, Ammonia (NH ₃ -N) Total	Daily Max - Variable	mg/L	3/Week	24-Hr Flow Prop Comp	Applies year-round. See the Daily Maximum Ammonia Nitrogen (NH ₃ -N) Limits section.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	11 mg/L	3/Week	24-Hr Flow Prop Comp	Applies December-March.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	14 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in April.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	5.4 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in May.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	3.8 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in June.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	3.1 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in July.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	3.2 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in August.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	4.6 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in September.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	7.3 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in October.
Nitrogen, Ammonia (NH ₃ -N) Total	Weekly Avg	13 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in November.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	7.9 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in January.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	8.5 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in February.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	11 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in March.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	14 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in April.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	5.4 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in May.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	3.8 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in June.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	2.4 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in July.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	2.3 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in August.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	3.2 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in September.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	6.0 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in October.

Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	13 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in November.
Nitrogen, Ammonia (NH ₃ -N) Total	Monthly Avg	9.6 mg/L	3/Week	24-Hr Flow Prop Comp	Applies in December.
Phosphorus, Total	Monthly Avg	1.0 mg/L	Weekly	24-Hr Flow Prop Comp	
Chloride		mg/L	Weekly	24-Hr Flow Prop Comp	See the Chloride-Calculated section.
PFOS		ng/L	1/ 2 Months	Grab	Monitoring only. See PFOS/PFOA Minimization Plan Determination of Need Schedule.
PFOA		ng/L	1/ 2 Months	Grab	Monitoring only. See PFOS/PFOA Minimization Plan Determination of Need Schedule.
Chronic WET	Monthly Avg	1.1 TUC	See Listed Qtr(s)	24-Hr Flow Prop Comp	See the Whole Effluent Toxicity (WET) Testing section.
Nitrogen, Total Kjeldahl		mg/L	See Listed Qtr(s)	24-Hr Flow Prop Comp	Annual in rotating quarters. See Nitrogen Series Monitoring section.
Nitrogen, Nitrite + Nitrate Total		mg/L	See Listed Qtr(s)	24-Hr Flow Prop Comp	Annual in rotating quarters. See Nitrogen Series Monitoring section.
Nitrogen, Total		mg/L	See Listed Qtr(s)	Calculated	Annual in rotating quarters. See Nitrogen Series Monitoring section. Total Nitrogen shall be calculated as the sum of reported values for Total Kjeldahl Nitrogen and Total Nitrite + Nitrate Nitrogen.

2.2.2.1 Average Annual Design Flow

The average annual design flow of the permittee's wastewater treatment facility is 1.19 MGD.

2.2.2.2 E. coli Percent Limit

No more than 10 percent of *E. coli* bacteria samples collected in any calendar month may exceed 410 #/100 ml. Bacteria samples may be collected more frequently than required. All samples shall be reported on the monthly discharge monitoring reports (DMRs). The following calculation should be used to calculate percent exceedances.

$$\frac{\text{\# of Samples greater than 410 \#/100}}{\text{Total \# of samples}} \times 100 = \% \text{ Exceedance}$$

2.2.2.3 Daily Maximum Ammonia Nitrogen (NH₃-N) Limits

The daily maximum ammonia nitrogen effluent limit is a variable limit, dependent upon the effluent pH. Presented below is a table of daily maximum ammonia nitrogen effluent limits corresponding to various effluent pH values. Measurement of effluent pH is required on the same days as the collection of samples for ammonia analysis. For each

day that the effluent is monitored for ammonia, report the measured ammonia concentration in the Ammonia column of the electronic Discharge Monitoring Report (eDMR) and the applicable variable limit (from the table below) in the Ammonia Variable Limit column of the eDMR.

Daily Maximum Ammonia Nitrogen Limits

Effluent pH s.u.	Daily Max Limit mg/L	Effluent pH s.u.	Daily Max Limit mg/L	Effluent pH s.u.	Daily Max Limit mg/L
6.0 ≤ pH ≤ 6.1	108	7.0 < pH ≤ 7.1	66	8.0 < pH ≤ 8.1	14
6.1 < pH ≤ 6.2	106	7.1 < pH ≤ 7.2	59	8.1 < pH ≤ 8.2	11
6.2 < pH ≤ 6.3	104	7.2 < pH ≤ 7.3	52	8.2 < pH ≤ 8.3	9.4
6.3 < pH ≤ 6.4	101	7.3 < pH ≤ 7.4	46	8.3 < pH ≤ 8.4	7.8
6.4 < pH ≤ 6.5	98	7.4 < pH ≤ 7.5	40	8.4 < pH ≤ 8.5	6.4
6.5 < pH ≤ 6.6	94	7.5 < pH ≤ 7.6	34	8.5 < pH ≤ 8.6	5.3
6.6 < pH ≤ 6.7	89	7.6 < pH ≤ 7.7	29	8.6 < pH ≤ 8.7	4.4
6.7 < pH ≤ 6.8	84	7.7 < pH ≤ 7.8	24	8.7 < pH ≤ 8.8	3.7
6.8 < pH ≤ 6.9	78	7.8 < pH ≤ 7.9	20	8.8 < pH ≤ 8.9	3.1
6.9 < pH ≤ 7.0	72	7.9 < pH ≤ 8.0	17	8.9 < pH ≤ 9.0	2.6

2.2.2.4 PFOS/PFOA Sampling and Reporting Requirements

For grab samples, as defined per s. NR 218.04(10), Wis. Adm. Code, a single sample at a location as defined by the sample point description shall be taken during the time of the day most representative to capture all potential discharges. If extra equipment besides the sample bottle is used to collect the sample, it is recommended that a one-time equipment blank is collected with the first sample. An equipment blank would be collected by passing laboratory-verified PFAS-free water over or through field sampling equipment before the collection of a grab sample to evaluate potential contamination from the equipment used during sample.

If any equipment blanks are performed, these results shall be reported in the comments section of the eDMR and shall also be documented in the reports submitted as part of the PFOS/PFOA Minimization Plan Determination of Need schedule of the permit.

2.2.2.5 PFOS/PFOA Minimization Plan Determination of Need

The permittee shall monitor PFOS and PFOA as specified in the table above and report on the effluent concentrations including trends in monthly and annual average PFOS and PFOA concentrations as specified in the PFOS/PFOA Minimization Plan Determination of Need Schedule.

If, after reviewing the data, the Department determines that a minimization plan for PFOS and PFOA is necessary based on the procedures in s. NR 106.98(4), Wis. Adm. Code, the department will notify the permittee in writing that a PFOS and PFOA minimization plan that satisfies the requirements in s. NR 106.99, Wis. Adm. Code, is required. The permittee shall submit an initial plan for department approval no later than 90 days after written notification was sent from the department in accordance with s. NR 106.985(2)(a), Wis. Adm. Code. Pursuant to s. NR 106.985(2)(b), Wis. Adm. Code, as soon as possible after department approval of the PFOS and PFOA minimization plan, the department will modify or revoke and reissue the permit in accordance with public notice procedures under ch. 283, Wis. Stats., and ch. NR 203, Wis. Adm. Code, to include the PFOS and PFOA minimization plan and other related terms and condition.

If, however, the Department determines that a PFOS and PFOA minimization plan is unnecessary based on the procedures in s. NR 106.98(4), Wis. Adm. Code, the Department shall notify the permittee that no further action is required. Per s. NR 106.98(3)(a), Wis. Adm. Code, the department may reduce monitoring frequency to once every 3

months (quarterly) on a case-by-case basis, but only after at least 12 representative results have been generated. If the permittee requests a reduction in monitoring and the department agrees a reduction would be appropriate, the permit may be modified in accordance with public notice procedures under ch. 283, Wis. Stats., and ch. NR 203, Wis. Adm. Code, to incorporate this change.

2.2.2.6 Whole Effluent Toxicity (WET) Testing

Primary Control Water: Grab sample collected from the South Branch of the Manitowoc River, upstream and out of the influence of the permittee's discharge and any other known discharge – unless the use of a different control water source is approved by the Department prior to use.

Instream Waste Concentration (IWC): 88%

Dilution series: At least five effluent concentrations and dual controls must be included in each test.

- **Chronic:** 100, 75, 50, 25, 12.5% and any additional selected by the permittee.

WET Testing Frequency:

Chronic tests are required during the following quarters:

- **April – June 2025; January – March 2026; July – September 2027; October – December 2028; and April – June 2029**

Chronic WET testing shall continue after the permit expiration date (until the permit is reissued) in accordance with the WET requirements specified for the last full calendar year of this permit. For example, the next test would be required in **April – June 2030**.

Concurrent Monitoring: Effluent monitoring for Chloride shall be conducted concurrently with WET testing.

Testing: WET testing shall be performed during normal operating conditions. Permittees are not allowed to turn off or otherwise modify treatment systems, production processes, or change other operating or treatment conditions during WET tests.

Reporting: The permittee shall report test results on the Discharge Monitoring Report form, and also complete the "Whole Effluent Toxicity Test Report Form" (Section 6, "*State of Wisconsin Aquatic Life Toxicity Testing Methods Manual, 2nd Edition*"), for each test. The original, complete, signed version of the Whole Effluent Toxicity Test Report Form shall be sent to the Biomonitoring Coordinator, Bureau of Water Quality, 101 S. Webster St., P.O. Box 7921, Madison, WI 53707-7921, within 45 days of test completion. The Discharge Monitoring Report (DMR) form shall be submitted electronically by the required deadline.

Determination of Positive Results: A chronic toxicity test shall be considered positive if the Toxic Unit - Chronic (TU_c) is greater than **1.1** for either species. The TU_c shall be calculated as follows: $TU_c = 100 \div IC_{25}$.

Additional Testing Requirements: Within 90 days of a test which showed positive results, the permittee shall submit the results of at least 2 retests to the Biomonitoring Coordinator on "Whole Effluent Toxicity Test Report Forms". The 90 day reporting period shall begin the day after the test which showed a positive result. The retests shall be completed using the same species and test methods specified for the original test (see the Standard Requirements section herein).

2.2.2.7 Nitrogen Series Monitoring

Monitoring for Total Kjeldahl Nitrogen (TKN), Nitrite + Nitrate Nitrogen, and Total Nitrogen shall be conducted once each year in rotating quarters in order to collect seasonal information about the discharge. Tests are required during the following quarters.

- **April – June 2025; January – March 2026; July – September 2027; October – December 2028; and April – June 2029**

Nitrogen Series monitoring shall continue after the permit expiration date (until the permit is reissued) in accordance with the monitoring requirements specified in the last full calendar year of this permit. For example, the next test would be required in **April – June 2030**.

Testing: Monitoring shall be performed during normal operating conditions. Permittees are not allowed to turn off or otherwise modify treatment systems, production processes, or change other operating or treatment conditions during testing.

3 Surface Water Requirements

3.1 Sampling Point(s)

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
002	COMBINED EFFLUENT - Total combined effluent from the wastewater treatment facility (Sample Point 105) and Softener Plant #8 (Sample Point 104). At Sampling Point 002, the permittee shall collect representative samples of the combined effluent from the combined effluent composite automatic sampler drawing 24-hour time proportional composite samples from the monitoring manhole except that the permittee shall collect grab samples of the combined effluent for temperature from the monitoring manhole prior to being discharged to the South Branch of the Manitowoc River via Outfall 002. The permittee shall calculate the flow rate, total phosphorus loading, total suspended solids loading, and chloride concentration of the combined effluent in accordance with the conditions of this permit.

3.2 Monitoring Requirements and Effluent Limitations

The permittee shall comply with the following monitoring requirements and limitations.

3.2.1 Sampling Point (Outfall) 002 - COMBINED EFFLUENT

Monitoring Requirements and Effluent Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Flow Rate		MGD	Daily	Calculated	See the Flow Rate-Calculated and Chloride, TSS and TP-Calculated sections.
Chloride	Weekly Avg	560 mg/L	Weekly	Calculated	Interim limit. See the Chloride Variance-Implement Source Reduction Measures section and the Chloride Source Reduction Measures (Target Value) Schedule. See also the Chloride-Calculated and Mass Balance Schematic for Chloride Calculation sections.
Acute WET		TU _a	See Listed Qtr(s)	24-Hr Comp	See the Whole Effluent Toxicity (WET) Testing section.

Monitoring Requirements and Effluent Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Temperature Maximum		deg F	3/Week	Measure	Monitoring only January-December 2028. Dissipative cooling study in October 2028. See the Effluent Temperature Monitoring and Dissipative Cooling Demonstration-POTW Weekly Average Limits sections. See also the Dissipative Cooling Study Schedule.
Suspended Solids, Total		mg/L	Weekly	Calculated	See the TSS-Calculated and Mass Balance Schematic for TSS Calculation sections.
Suspended Solids, Total	Weekly Avg	247 lbs/day	Weekly	Calculated	
Suspended Solids, Total	Monthly Avg	175 lbs/day	Weekly	Calculated	
Suspended Solids, Total		lbs/month	Monthly	Calculated	Calculate the Total Monthly Discharge of TSS and report on the last day of the month on the eDMR. See TMDL Calculations section.
Suspended Solids, Total		lbs/yr	Monthly	Calculated	Calculate the 12-month rolling sum of total monthly mass of TSS discharged and report on the last day of the month on the eDMR. See TMDL Calculations section.
Phosphorus, Total	Monthly Avg	1.0 mg/L	Weekly	Calculated	Interim limit effective upon permit effective date. See the TP-Calculated and Mass Balance Schematic for TP Calculation sections.
Phosphorus, Total	Monthly Avg	5.0 lbs/day	Weekly	Calculated	Monitoring only upon permit effective date. Final TMDL-Based Mass Limits for Total Phosphorus go into effect per the Schedule. See also the Phosphorus TMDL section.

Monitoring Requirements and Effluent Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Phosphorus, Total	6-Month Avg	1.7 lbs/day	Weekly	Calculated	Monitoring only upon permit effective date. Final TMDL-Based Mass Limits for Total Phosphorus go into effect per the Schedule. See also the Phosphorus TMDL section.
Phosphorus, Total		lbs/month	Monthly	Calculated	Calculate the Total Monthly Discharge of phosphorus and report on the last day of the month on the eDMR. See TMDL Calculations section.
Phosphorus, Total		lbs/yr	Monthly	Calculated	Calculate the 12-month rolling sum of total monthly mass of phosphorus discharged and report on the last day of the month on the DMR. See TMDL Calculations section.

3.2.1.1 Flow Rate – Calculated

The flow rate at Sample Point 002 shall be calculated as follows:

$$\text{Flow Rate at 002 (MGD)} = \text{Flow Rate at 701}^1 \text{ (MGD)} + \text{Estimated Flow Rate at 104 (MGD)}$$

¹ *Influent Flow Rate at Sample Point 701 shall be used in this calculation until the flow monitoring device is installed at the In-Plant Sample Point 105. Starting April 1, 2028, the Flow Rate at Sample Point 105 shall be used in this calculation.*


3.2.1.2 Chloride, Total Suspended Solids, and Total Phosphorus – Calculated

The permittee shall use the following equation to calculate the concentration of chloride, TSS, and TP in the discharge of the combined effluent (Sample Point/Outfall 002) for each day that results are reported, as specified above, using data for Flow at 701¹, 104 and 002, and Concentrations at 105 and 104, all for the same day:

$$\text{Concentration at 002 (mg/L)} = \frac{\text{Flow at 701}^1 \text{ (MGD)} \times \text{Concentration at 105 (mg/L)} + \text{Flow at 104 (MGD)} \times \text{Concentration at 104 (mg/L)}}{\text{Flow at 002 (MGD)}}$$

3.2.1.3 Mass Balance Schematic for Chloride, Total Suspended Solids, and Total Phosphorus Calculation

The following schematic is intended to provide clarity in the derivation of the equation for chloride, TSS, and TP concentrations at Sample Point 002.

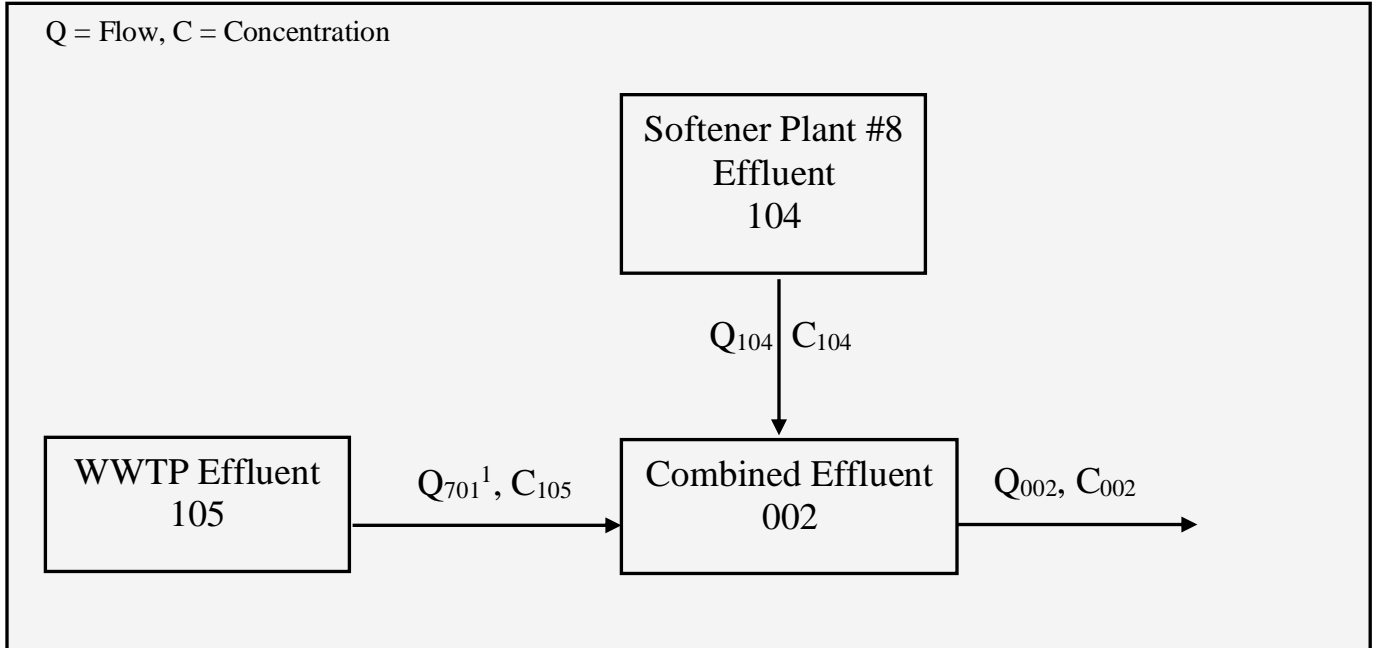

3.2.1.4 Effluent Temperature Monitoring

For manually measuring effluent temperature, grab samples should be collected at 6 evenly spaced intervals during the 24-hour period. Alternative sampling intervals may be approved if the permittee can show that the maximum effluent temperature is captured during the sampling interval. For monitoring temperature continuously, collect measurements in accordance with s. NR 218.04(13). This means that discrete measurements shall be recorded at intervals of not more than 15 minutes during the 24-hour period. In either case, report the maximum temperature measured during the day on the DMR. For seasonal discharges collect measurements either manually or continuously during the period of operation and report the daily maximum effluent temperature on the DMR.

3.2.1.5 Dissipative Cooling Demonstration – POTW Weekly Average Limits

If weekly average effluent temperature limitations are needed, the permittee may submit all additional necessary information with a request that the Department account for dissipative cooling of the effluent pursuant to s. NR 106.59, Wis. Adm. Code. Monitoring frequency shall be 3/Week in calendar year 2028. If after reviewing the data the Department determines that weekly average effluent limitations for temperature are necessary because the thermal load from the effluent is not adequately dissipated, effluent limitations shall be included at the time of permit reissuance. A re-evaluation of the limits may then be requested pursuant to NR 106 – ‘Subchapters V & VI Effluent Limitations for Temperature’ or NR 102.26 – Site Specific Ambient Temperature.

3.2.1.6 Chloride Variance – Implement Source Reduction Measures

This permit contains a variance to the water quality-based effluent limit (WQBEL) for chloride granted in accordance with s. NR 106.83(2), Wis. Adm. Code. As conditions of this variance the permittee shall (a) maintain effluent quality at or below the interim effluent limitation specified in the table above, (b) implement the chloride source reduction measures specified below, (c) follow the Source Reduction Plan dated November 1, 2024, and (d) perform the actions listed in the schedule (See the Schedules section herein):

A. SRMs Targeting Municipal Water Softening

1. Optimize the operation of the municipal ion-exchange softeners (see the Chloride Source Reduction Plan for more information).
2. Encourage water conservation measures.

B. SRMs Targeting Point-of-Use Water Softening Sources

1. Educate point-of-use softener owners of the availability of municipally softened water and the impact of chloride on water quality; provide information about increasing softener efficiency and reducing the use of softened water.
2. Maintain inventory of point-of-use water softeners in use in the City and collect information about the type of regeneration control unit and when each was last tuned-up.
3. Enforce existing ordinance that requires the use of demand initiated regeneration, a high salt efficiency standard and periodic tune-ups for new and replacement point-of-use softeners.

C. SRMs Targeting Industrial, Commercial and Municipal Sources

1. Work with industrial and commercial contributors to prevent increases in the amount of chloride discharged, and seek reductions from those sources.
2. Evaluate new industries for the potential to discharge chlorides.

D. SRMs Targeting Winter Road Maintenance

1. Assess management practices to reduce/eliminate the discharge of chloride to the sanitary sewer system at municipality/county facilities housing vehicles used for snow plowing and road de-icing/anti-icing.

3.2.1.7 Northeast Lakeshore Basin (NEL) Total Maximum Daily Load (TMDL) Calculations

Approved TMDL: The Northeast Lakeshore Basin (NEL) TMDL Waste Load Allocation (WLA) for total phosphorus and total suspended solids was approved by the U.S. Environmental Protection Agency in October, 2023. TMDL total lbs/month and lbs/yr effluent results shall be calculated as follows:

Total Monthly Discharge (lbs/month) = monthly average concentration (mg/L) x total flow for the month (MG/month) x 8.34

12-Month Rolling Sum of Total Monthly Discharge (lbs/yr) = the sum of the most recent 12 consecutive months of Total Monthly Discharges

3.2.1.8 TMDL Limitations for Total Phosphorus

The approved TMDL phosphorus WLA for this permittee is 517 lbs/yr at Outfall 002 and results in calculated phosphorus mass limits of 5.0 lbs/day as a monthly average and 1.7 lbs/day as a 6-month average which go into effect pursuant to the Phosphorus Compliance Schedule. *The 6-month average limit is expressed as a seasonal average with averaging periods occurring from May through October and November through April. Compliance with the 6-month average limit is evaluated at the end of each 6-month period on April 30th and October 31st annually.* The 12-month rolling sum of total monthly phosphorus (lbs/yr) shall be reported each month for direct comparison to the facility's WLA.

The phosphorus limit of 1.0 mg/L is an interim limit set in accordance with s. NR. 217.17, Wis. Adm. Code. The interim limit will remain in effect unless a more stringent limit is required at a future permit issuance by ss. NR 217.13 and NR 217.16(2), Wis. Adm. Code, or the limit is relaxed following procedures outlined in ch. NR 207, Wis. Adm. Code. Sampling and reporting of phosphorus concentrations and masses discharged shall begin upon the permit effective date.

3.2.1.9 TMDL Limitations for Total Suspended Solids

The approved TMDL TSS WLA for this permittee is 43,491 lbs/yr at Outfall 002, and results in calculated TSS mass limits of 247 lbs/day as a weekly average and 175 lbs/day as a monthly average. The 12-month rolling sum of total monthly TSS (lbs/yr) shall be reported each month for direct comparison to the facility's WLA.

3.2.1.10 Whole Effluent Toxicity (WET) Testing

Primary Control Water: Grab sample collected from the South Branch of the Manitowoc River, upstream and out of the influence of the permittee's discharge and any other known discharge – unless the use of a different control water source is approved by the Department prior to use.

Dilution series: At least five effluent concentrations and dual controls must be included in each test.

- **Acute:** 100, 50, 25, 12.5, 6.25% and any additional selected by the permittee.

WET Testing Frequency:

Acute tests are required during the following quarters:

- **January – March 2026; and April – June 2029**

Acute WET testing shall continue after the permit expiration date (until the permit is reissued) in accordance with the WET requirements specified for the last full calendar year of this permit. For example, the next test would be required in **April – June 2030**.

Testing: WET testing shall be performed during normal operating conditions. Permittees are not allowed to turn off or otherwise modify treatment systems, production processes, or change other operating or treatment conditions during WET tests.

Reporting: The permittee shall report test results on the Discharge Monitoring Report form, and also complete the "Whole Effluent Toxicity Test Report Form" (Section 6, "*State of Wisconsin Aquatic Life Toxicity Testing Methods Manual, 2nd Edition*"), for each test. The original, complete, signed version of the Whole Effluent Toxicity Test Report Form shall be sent to the Biomonitoring Coordinator, Bureau of Water Quality, 101 S. Webster St., P.O. Box 7921, Madison, WI 53707-7921, within 45 days of test completion. The Discharge Monitoring Report (DMR) form shall be submitted electronically by the required deadline.

Determination of Positive Results: An acute toxicity test shall be considered positive if the Toxic Unit - Acute (TU_a) is greater than **1.0** for either species (fathead minnow (*Pimephales promelas*) and waterflea (*Ceriodaphnia dubia*)). The TU_a shall be calculated as follows: $TU_a = 100 \div LC_{50}$.

Additional Testing Requirements: Within 90 days of a test which showed positive results, the permittee shall submit the results of at least 2 retests to the Biomonitoring Coordinator on "Whole Effluent Toxicity Test Report Forms". The 90-day reporting period shall begin the day after the test which showed a positive result. The retests shall be completed using the same species and test methods specified for the original test (see the Standard Requirements section herein).

4 Land Application Requirements

4.1 Sampling Point(s)

The discharge(s) shall be limited to land application of the waste type(s) designated for the listed sampling point(s) on Department approved land spreading sites or by hauling to another facility.

Sampling Point Designation	
Sampling Point Number	Sampling Point Location, Waste Type/Sample Contents and Treatment Description (as applicable)
004	LIQUID SLUDGE - Waste activated sludge that is thickened and aerobically digested in two sludge storage tanks to generate Class B sludge. At Sampling Point 004, the permittee shall collect representative grab and/or composite samples of the liquid sludge from the storage tank(s) after complete mixing and prior to being land applied on department approved sites via Outfall 004.

4.2 Monitoring Requirements and Limitations

The permittee shall comply with the following monitoring requirements and limitations.

4.2.1 Sampling Point (Outfall) 004 - LIQUID SLUDGE

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Solids, Total		Percent	Annual	Composite	
Arsenic Dry Wt	High Quality	41 mg/kg	Annual	Composite	
Arsenic Dry Wt	Ceiling	75 mg/kg	Annual	Composite	
Cadmium Dry Wt	High Quality	39 mg/kg	Annual	Composite	
Cadmium Dry Wt	Ceiling	85 mg/kg	Annual	Composite	
Copper Dry Wt	High Quality	1,500 mg/kg	Annual	Composite	
Copper Dry Wt	Ceiling	4,300 mg/kg	Annual	Composite	
Lead Dry Wt	High Quality	300 mg/kg	Annual	Composite	
Lead Dry Wt	Ceiling	840 mg/kg	Annual	Composite	
Mercury Dry Wt	High Quality	17 mg/kg	Annual	Composite	
Mercury Dry Wt	Ceiling	57 mg/kg	Annual	Composite	
Molybdenum Dry Wt	Ceiling	75 mg/kg	Annual	Composite	
Nickel Dry Wt	High Quality	420 mg/kg	Annual	Composite	
Nickel Dry Wt	Ceiling	420 mg/kg	Annual	Composite	
Selenium Dry Wt	High Quality	100 mg/kg	Annual	Composite	
Selenium Dry Wt	Ceiling	100 mg/kg	Annual	Composite	
Zinc Dry Wt	High Quality	2,800 mg/kg	Annual	Composite	
Zinc Dry Wt	Ceiling	7,500 mg/kg	Annual	Composite	
Nitrogen, Total Kjeldahl		Percent	Annual	Composite	
Nitrogen, Ammonium (NH ₄ -N) Total		Percent	Annual	Composite	
Phosphorus, Total		Percent	Annual	Composite	

Monitoring Requirements and Limitations					
Parameter	Limit Type	Limit and Units	Sample Frequency	Sample Type	Notes
Phosphorus, Water Extractable		% of Tot P	Annual	Composite	
Potassium, Total Recoverable		Percent	Annual	Composite	
PFOA + PFOS		µg/kg	Annual	Calculated	Report the sum of PFOA and PFOS. See PFAS Permit Sections for more information.
PFAS Dry Wt			Annual	Grab	Perfluoroalkyl and Polyfluoroalkyl Substances based on updated DNR PFAS List. See PFAS Permit Sections for more information.

Other Sludge Requirements	
Sludge Requirements	Sample Frequency
List 3 Requirements – Pathogen Control: The requirements in List 3 shall be met prior to land application of sludge.	Annual
List 4 Requirements – Vector Attraction Reduction: The vector attraction reduction shall be satisfied prior to, or at the time of land application as specified in List 4.	Annual

4.2.1.1 Changes in Feed Sludge Characteristics

If a change in feed sludge characteristics, treatment process, or operational procedures occurs which may result in a significant shift in sludge characteristics, the permittee shall reanalyze the sludge for List 1, 2, 3 and 4 parameters each time such change occurs.

4.2.1.2 Sludge Which Exceeds the High Quality Limit

Cumulative pollutant loading records shall be kept for all bulk land application of sludge which does not meet the high quality limit for any parameter. This requirement applies for the entire calendar year in which any exceedance of Table 3 of s. NR 204.07(5)(c), is experienced. Such loading records shall be kept for all List 1 parameters for each site land applied in that calendar year. The formula to be used for calculating cumulative loading is as follows:

$$[(\text{Pollutant concentration (mg/kg)} \times \text{dry tons applied/ac}) \div 500] + \text{previous loading (lbs/acre)} = \text{cumulative lbs pollutant per acre}$$

When a site reaches 90% of the allowable cumulative loading for any metal established in Table 2 of s. NR 204.07(5)(b), the Department shall be so notified through letter or in the comment section of the annual land application report (3400-55).

4.2.1.3 Lists 1, 2, 3, and 4

List 1 TOTAL SOLIDS AND METALS	
See the Monitoring Requirements and Limitations table above for monitoring frequency and limitations for the List 1 parameters	
Solids, Total (percent)	
Arsenic, mg/kg (dry weight)	
Cadmium, mg/kg (dry weight)	
Copper, mg/kg (dry weight)	
Lead, mg/kg (dry weight)	
Mercury, mg/kg (dry weight)	
Molybdenum, mg/kg (dry weight)	
Nickel, mg/kg (dry weight)	
Selenium, mg/kg (dry weight)	
Zinc, mg/kg (dry weight)	

List 2 NUTRIENTS	
See the Monitoring Requirements and Limitations table above for monitoring frequency for the List 2 parameters	
Solids, Total (percent)	
Nitrogen Total Kjeldahl (percent)	
Nitrogen Ammonium (NH ₄ -N) Total (percent)	
Phosphorus Total as P (percent)	
Phosphorus, Water Extractable (as percent of Total P)	
Potassium Total Recoverable (percent)	

List 3 PATHOGEN CONTROL FOR CLASS B SLUDGE		
The permittee shall implement pathogen control as listed in List 3. The Department shall be notified of the pathogen control utilized and shall be notified when the permittee decides to utilize alternative pathogen control.		
The following requirements shall be met prior to land application of sludge.		
Parameter	Unit	Limit
Fecal Coliform *	MPN/gTS or CFU/gTS	2,000,000
OR, ONE OF THE FOLLOWING PROCESS OPTIONS		
Aerobic Digestion		Air Drying
Anaerobic Digestion		Composting
Alkaline Stabilization		PSRP Equivalent Process
* The Fecal Coliform limit shall be reported as the geometric mean of 7 discrete samples on a dry weight basis.		

**List 4
 VECTOR ATTRACTION REDUCTION**

The permittee shall implement any one of the vector attraction reduction options specified in List 4. The Department shall be notified of the option utilized and shall be notified when the permittee decides to utilize an alternative option.

One of the following shall be satisfied prior to, or at the time of land application as specified in List 4.

Option	Limit	Where/When it Shall be Met
Volatile Solids Reduction	≥38%	Across the process
Specific Oxygen Uptake Rate	≤1.5 mg O ₂ /hr/g TS	On aerobic stabilized sludge
Anaerobic bench-scale test	<17 % VS reduction	On anaerobic digested sludge
Aerobic bench-scale test	<15 % VS reduction	On aerobic digested sludge
Aerobic Process	>14 days, Temp >40°C and Avg. Temp > 45°C	On composted sludge
pH adjustment	>12 S.U. (for 2 hours) and >11.5 (for an additional 22 hours)	During the process
Drying without primary solids	>75 % TS	When applied or bagged
Drying with primary solids	>90 % TS	When applied or bagged
Equivalent Process	Approved by the Department	Varies with process
Injection	-	When applied
Incorporation	-	Within 6 hours of application

4.2.1.4 Daily Land Application Log

Daily Land Application Log		
Discharge Monitoring Requirements and Limitations		
<p>The permittee shall maintain a daily land application log for biosolids land applied each day when land application occurs. The following minimum records must be kept, in addition to all analytical results for the biosolids land applied. The log book records shall form the basis for the annual land application report requirements.</p>		
Parameters	Units	Sample Frequency
DNR Site Number(s)	Number	Daily as used
Outfall number applied	Number	Daily as used
Acres applied	Acres	Daily as used
Amount applied	As appropriate * /day	Daily as used
Application rate per acre	unit */acre	Daily as used
Nitrogen applied per acre	lb/acre	Daily as used
Method of Application	Injection, Incorporation, or surface applied	Daily as used

* gallons, cubic yards, dry US Tons or dry Metric Tons

4.2.1.5 Sludge Monitoring for PFAS

Sampling shall occur for perfluoroalkyl and polyfluoroalkyl compounds (PFAS) listed in the table below and as indicated in sampling point sections above. Monitoring shall occur at each sample point when sludge is generated regardless of the end use (i.e. land applied, hauled to another facility, landfilled).

PERFLUOROALKYLCARBOXYLIC Acids (PFCAs)	
PFBA	Perfluorobutanoic acid
PFPeA	Perfluoropentanoic acid
PFHxA	Perfluorohexanoic acid
PFHpA	Perfluoroheptanoic acid
PFOA	Perfluorooctanoic acid
PFNA	Perfluorononanoic acid
PFDA	Perfluorodecanoic acid
PFUnA	Perfluoroundecanoic acid
PFDoA	Perfluorododecanoic acid
PFTriA	Perfluorotridecanoic acid
PFTeDA	Perfluorotetradecanoic acid
PERFLUOROALKYLSULFONIC Acids (PFSAs)	
PFBS	Perfluorobutane sulfonic acid
PFPeS	Perfluoropentane sulfonic acid
PFHxS	Perfluorohexane sulfonic acid
PFHpS	Perfluoroheptane sulfonic acid
PFOS	Perfluorooctane sulfonic acid
PFNS	Perfluorononane sulfonic acid
PFDS	Perfluorodecane sulfonic acid
PFDoS	Perfluorododecane sulfonic acid
TELOMER SULFONIC Acids	
4:2 FTSA	4:2 fluorotelomersulfonic acid
6:2 FTSA	6:2 fluorotelomersulfonic acid
8:2 FTSA	8:2 fluorotelomersulfonic acid
PERFLUOROOCETANESULFONAMIDES (FOSAs)	
PFOSA	Perfluorooctane sulfonamide
N-MeFOSA	N-Methyl perfluorooctane sulfonamide
N-EtFOSA	N-Ethyl perfluorooctane sulfonamide
PERFLUOROOCETANESULFONAMIDOACETIC Acids	
N-MeFOSAA	N-Methyl perfluorooctane sulfonamidoacetic acid
N-EtFOSAA	N-Ethyl perfluorooctane sulfonamidoacetic acid
NATIVE PERFLUOROOCETANESULFONAMIDOETHANOLS (FOSEs)	
N-MeFOSE	N-Methyl perfluorooctane sulfonamidoethanol
N-EtFOSE	N-Ethyl perfluorooctane sulfonamidoethanol
PERFLUOROALKYLETHERCARBOXYLIC Acids (PFECAs)	
HFPO-DA	Hexafluoropropylene oxide dimer acid
DONA	4,8-dioxa-3H-perfluorononanoic acid

CHLORO-PERFLUOROALKYLSULFONATE	
F-53B Major	9-chlorohexadecafluoro-3-oxanone-1-sulfonic acid
F-53B Minor	11-chloroelcosafluoro-3-oxaundecane-1-sulfonic acid

Note: If WDNR Lab Certification removes a particular compound from the reporting list above and upon receiving written communication from the department, reporting for that compound is no longer required.

4.2.1.6 Sampling and Reporting Sludge Samples for PFAS

Representative sludge samples shall be collected at each sample point as listed. At minimum, liquid sludge storage/digesters should be thoroughly mixed prior to sampling. Cake sludge samples should consist of seven equal size discrete samples and be collected from different areas and depths then composited into one sample for laboratory analysis.

Note: If additional equipment is used for collecting sludge samples (i.e., shovels, compositing buckets, bottles, etc.), then a one-time equipment blank is recommended to be collected with the first sample. An equipment blank sample is collected by passing laboratory verified PFAS-free water over or through field sampling equipment before the collection of a representative sludge sample. The equipment blank result shall be reported on the annual Sludge Characteristics Form (3400-049) in the comment section when reporting PFAS concentrations in the sludge.

The permittee shall report each of the PFAS sludge monitoring results on the annual Sludge Characteristics and Monitoring Form (3400-049) as provided by the department. The permittee shall also report the summation of PFOS and PFOA on this same form. All results shall be reported in dry weight. The annual Sludge Characteristics and Monitoring Form (3400-049) are due January 31, of the year following the collection of the sludge samples.

The laboratory performing the analysis on any samples shall be certified for the applicable PFAS compounds in the solids matrix by the Wisconsin Laboratory Certification Program established under s. 299.11, Wis. Stats., and in accordance with s. NR 149.41, Wis. Adm. Code. If the EPA Office of Water publishes a 1600 series isotope dilution method for the analysis of PFAS in solids, the department recommends the use of the EPA method. The department may reject any sample results if results are produced by a laboratory that is not in compliance with certification requirements under ch. NR 149, Wis. Adm. Code.

4.2.1.7 PFAS Land Application Requirements

The department recommends the landspreading and/or land application of sludge be done in a manner consistent with the most recent version of the “Interim Strategy for Land Application of Biosolids and Industrial Sludges containing PFAS”.

5 Schedules

5.1 Chloride Source Reduction Measures (Target Value)

As a condition of the variance to the water quality based effluent limitation(s) for chloride granted in accordance with s. NR 106.83(2), Wis. Adm. Code, the permittee shall perform the following actions.

Required Action	Due Date
<p>Annual Chloride Progress Report: Submit an annual chloride progress report related to the source reduction activities for the previous year. The annual chloride progress report shall:</p> <p>Indicate which chloride source reduction measures or activities in the Source Reduction Plan have been implemented and state which, if any, source reduction measures from the Source Reduction Plan were not pursued and why. Include an assessment of whether each implemented source reduction measure appears to be effective or ineffective at reducing pollutant discharge concentrations and identify actions planned for the upcoming year;</p> <p>Include an analysis of trends in weekly, monthly and annual average chloride concentrations and total mass discharge of chloride based on chloride sampling and flow data; and</p> <p>Include an analysis of how effluent chloride varies with time and with significant loadings of chloride. Note that the interim limitation listed in the Surface Water section of this permit remains enforceable until new enforceable limits are established in the next permit issuance.</p> <p>The first annual chloride progress report is to be submitted by the Date Due.</p>	01/31/2026
<p>Annual Chloride Progress Report #2: Submit the chloride progress report, related to the source reduction activities for the previous year, as defined above.</p>	01/31/2027
<p>Annual Chloride Progress Report #3: Submit the chloride progress report, related to the source reduction activities for the previous year, as defined above.</p>	01/31/2028
<p>Annual Chloride Progress Report #4: Submit the chloride progress report, related to the source reduction activities for the previous year, as defined above.</p>	01/31/2029
<p>Final Chloride Report: Submit the final chloride report documenting the success in meeting the chloride target value of 505 mg/L, as well as the anticipated future reduction in chloride sources and chloride effluent concentrations.</p> <p>The report shall:</p> <p>Summarize chloride source reduction measures that have been implemented during the current permit term and state which, if any, source reduction measures from the Source Reduction Plan were not pursued and why;</p> <p>Include an assessment of which source reduction measures appear to have been effective or ineffective. Evaluate any needed changes to the pollutant reduction strategy accordingly;</p> <p>Include an analysis of trends in weekly, monthly and annual average chloride concentrations and total mass discharge of chloride based on chloride sampling and flow data during the current permit term; and</p> <p>Include an analysis of how influent and effluent chloride varies with time and with significant loadings of chloride as identified in the source reduction plan.</p> <p>If the permittee intends to reapply for a chloride variance, for the reissued permit, proposed target limits and a detailed source reduction measures plan, outlining the source reduction activities proposed for the upcoming permit term, shall also be included per ss. NR 106.90 (5) and NR 106.83</p>	09/30/2029

<p>(4), Wis. Adm. Code. An updated source reduction measures plan shall:</p> <p>Include an explanation of why or how each source reduction measure will result in reduced discharge of the target pollutant; and</p> <p>Evaluate any available information on pollutant sources, timing, and concentration to update the mass balance assumptions and expected sources of the pollutant, and</p> <p>Identify any information needs that would help to better determine pollutant sources and make plans to collect that information.</p> <p>Note that the target value is the benchmark for evaluating the effectiveness of the chloride source reduction measures but is not an enforceable limitation under the terms of this permit.</p>	
<p>Annual Chloride Reports After Permit Expiration: In the event that this permit is not reissued by the date the permit expires the permittee shall continue to submit annual chloride reports for the previous year following the due date of Annual Chloride Progress Reports listed above. Annual Chloride Progress Reports shall include the information as defined above.</p>	

5.2 TMDL-Based Effluent Mass Limits for Total Phosphorus

The permittee shall comply with the limits for Phosphorus as specified. No later than 14 days following each compliance date, the permittee shall notify the Department in writing of its compliance or noncompliance. If a submittal is required, a timely submittal fulfills the notification requirement.

Required Action	Due Date
Construction Upgrade Progress Report #1: The permittee shall submit a progress report on construction upgrades.	08/31/2025
Construction Upgrade Progress Report #2: The permittee shall submit a progress report on construction upgrades.	08/31/2026
Complete Construction: The permittee shall complete construction of wastewater treatment system upgrades.	06/30/2027
Achieve Compliance: The permittee shall achieve compliance with final phosphorus TMDL-based effluent mass limits.	07/01/2027

5.3 PFOS/PFOA Minimization Plan Determination of Need

Required Action	Due Date
<p>Report on Effluent Discharge: Submit a report on effluent PFOS and PFOA concentrations and include an analysis of trends in monthly and annual average PFOS and PFOA concentrations. This analysis should also include a comparison to the applicable narrative standard in s. NR 102.04(8)(d), Wis. Adm. Code.</p> <p>This report shall include all additional PFOS and PFOA data that may be collected including any influent, intake, in-plant, collection system sampling, and blank sample results.</p>	03/31/2026
<p>Report on Effluent Discharge and Evaluation of Need: Submit a final report on effluent PFOS and PFOA concentrations and include an analysis of trends in monthly and annual average PFOS and PFOA concentrations of data collected over the last 24 months. The report shall also provide a comparison on the likelihood of the facility needing to develop a PFOS/PFOA minimization plan.</p> <p>This report shall include all additional PFOS and PFOA data that may be collected including any</p>	03/31/2027

<p>influent, intake, in-plant, collection system sampling, and blank sample results.</p> <p>The permittee shall also submit a request to the department to evaluate the need for a PFOS/PFOA minimization plan.</p> <p>If the Department determines a PFOS/PFOA minimization plan is needed based on a reasonable potential evaluation, the permittee will be required to develop a minimization plan for Department approval no later than 90 days after written notification was sent from the Department. The Department will modify or revoke and reissue the permit to include PFOS/PFOA minimization plan reporting requirements along with a schedule of compliance to meet WQBELs. Effluent monitoring of PFOS and PFOA shall continue as specified in the permit until the modified permit is issued.</p> <p>If, however, the Department determines there is no reasonable potential for the facility to discharge PFOS or PFOA above the narrative standard in s. NR 102.04(8)(d), Wis. Adm. Code, no further action is required and effluent monitoring of PFOS and PFOA shall continue as specified in the permit.</p>	
--	--

5.4 Install Continuous Flow Recording Device

The permittee shall install a continuous flow recording device at Sampling Point 105 (In-Plant) in accordance with the following schedule.

Required Action	Due Date
Plans and Specifications: Submit plans and specifications per ch. NR 108, Wis. Adm. Code, for installing a continuous flow recording device at Sampling Point 105 (In-Plant).	03/31/2027
Complete Install: The permittee shall complete installation of the continuous flow recording device at Sampling Point 105 (In-Plant).	03/31/2028

5.5 Dissipative Cooling Study

Required Action	Due Date
<p>Complete Dissipative Cooling Study: Submit an updated dissipative cooling study for the existing outfall meeting the following requirements for determining the need for sub-lethal effluent limitations at the time of next permit reissuance: 1) A written description of the physical characteristics of the receiving water or outfall that encourage rapid dilution, diffusion, dispersion, or dissipation of heat; 2) A written description of the presence or absence of other thermal loads to the receiving stream; 3) The minimum and maximum effluent temperature for each calendar week monitored.</p> <p>Note: The month of October is when the difference between the calculated limit and effluent data is the greatest; therefore, the dissipative cooling study shall be conducted in October.</p> <p>The study shall also include any site-specific information collected as part of the study, including: 1) Information regarding the biological quality of the animal and plant community of the receiving water including, but not limited to, species composition, richness, diversity, density, distribution, age structure, spawning incidence, and presence of any state or federally listed threatened or endangered species; 2) Data concerning the physical characteristics of the receiving water or permitted outfalls that encourage rapid dilution, diffusion, dispersion, and/or dissipation of heat; 3) The minimum and maximum temperature of the receiving water upstream of all permitted outfalls for each calendar month monitored.</p>	03/01/2029

5.6 SS (Sanitary Sewage Collection System) Subclass

The permittee is required to have a designated collection system operator-in-charge (OIC) for the sanitary sewage collection system. The designated OIC shall have passed and be certified in the SS (Sanitary Sewage Collection System) subclass pursuant to s. NR 114.53(2), Wis. Adm. Code.

Required Action	Due Date
<p>Operator Certification: The permittee shall designate one person to be the operator-in-charge (OIC) for the sanitary sewage collection system and obtain the SS (Sanitary Sewage Collection System) subclass at the basic level. The designated OIC will have 12 months to pass the exam for the SS (Sanitary Sewage Collection System) subclass and submit the operator experience form for one year of subclass specific experience to be certified at the basic level pursuant to s. NR 114.53(4), Wis. Adm. Code.</p>	03/31/2026

5.7 Sludge Management Plan

A sludge management plan is required 60 days prior to sludge removal.

Required Action	Due Date
<p>Sludge Management Plan Submittal: Submit a management plan to optimize the land application system performance and demonstrate compliance with ch. NR 204, Wis. Adm. Code. This management plan shall 1) specify information on pretreatment processes (if any); 2) identify land application sites; 3) describe site limitations; 4) address vegetative cover management and removal; 5) specify availability of storage; 6) describe the type of transporting and spreading vehicle(s); 7) specify monitoring procedures; 8) track site loading; 9) address contingency plans for adverse weather and odor/nuisance abatement; and 10) include any other pertinent information. Once approved, all landspreading activities shall be conducted in accordance with the plan. Any changes to the plan must be approved by the Department prior to implementing the changes.</p>	03/31/2026

6 Standard Requirements

Chapter NR 205, Wisconsin Administrative Code: The conditions in ss. NR 205.07(1) and NR 205.07(2), Wis. Adm. Code, are included by reference in this permit. The permittee shall comply with all of these requirements. Some of these requirements are outlined in the Standard Requirements section of this permit. Requirements not specifically outlined in the Standard Requirement section of this permit can be found in ss. NR 205.07(1) and NR 205.07(2), Wis. Adm. Code.

6.1 Reporting and Monitoring Requirements

6.1.1 Monitoring Results

Monitoring results obtained during the previous month shall be summarized and reported on a Department Wastewater Discharge Monitoring Report. The report may require reporting of any or all of the information specified below under 'Recording of Results'. This report is to be returned to the Department no later than the date indicated on the form. A copy of the Wastewater Discharge Monitoring Report Form or an electronic file of the report shall be retained by the permittee.

Monitoring results shall be reported on an electronic discharge monitoring report (eDMR). The eDMR shall be certified electronically by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

If the permittee monitors any pollutant more frequently than required by this permit, the results of such monitoring shall be included on the Wastewater Discharge Monitoring Report.

The permittee shall comply with all limits for each parameter regardless of monitoring frequency. For example, monthly, weekly, and/or daily limits shall be met even with monthly monitoring. The permittee may monitor more frequently than required for any parameter.

6.1.2 Sampling and Testing Procedures

Sampling and laboratory testing procedures shall be performed in accordance with Chapters NR 218 and NR 219, Wis. Adm. Code, and completed by a laboratory certified or registered in accordance with the requirements of ch. NR 149, Wis. Adm. Code. Groundwater sampling shall be performed in accordance with procedures contained in s. NR 140.16, Wis. Adm. Code, and the WDNR publications, Groundwater Sampling Desk Reference (PUBL-DG-037-96) and Groundwater Sampling Field Manual (PUBL-DG-038-96). The analytical methodologies used shall enable the laboratory to quantitate all substances for which monitoring is required at levels below the effluent limitation and/or groundwater standard. If the required level cannot be met by any of the methods available in ch. NR 219, Wis. Adm. Code, then the method with the lowest limit of detection shall be selected. Additional test procedures may be specified in this permit.

6.1.3 Recording of Results

The permittee shall maintain records which provide the following information for each effluent measurement or sample taken:

- the date, exact place, method and time of sampling or measurements;
- the individual who performed the sampling or measurements;
- the date the analysis was performed;
- the individual who performed the analysis;
- the analytical techniques or methods used; and
- the results of the analysis.

6.1.4 Reporting of Monitoring Results

The permittee shall use the following conventions when reporting effluent monitoring results:

- Pollutant concentrations less than the limit of detection shall be reported as < (less than) the value of the limit of detection. For example, if a substance is not detected at a detection limit of 0.1 mg/L, report the pollutant concentration as < 0.1 mg/L.
- Pollutant concentrations equal to or greater than the limit of detection, but less than the limit of quantitation, shall be reported and the limit of quantitation shall be specified.
- For purposes of calculating fees under ch. NR 101, Wis. Adm. Code, a reporting limit of 2.0 mg/L for BOD₅ and 2.5 mg/L Total Suspended Solids shall be considered to be limits of quantitation.
- For the purposes of reporting a calculated result, average or a mass discharge value, the permittee may substitute a “0” (zero) for any pollutant concentration that is less than the limit of detection. However, if the effluent limitation is less than the limit of detection, the department may substitute a value other than zero for results less than the limit of detection, after considering the number of monitoring results that are greater than the limit of detection and if warranted when applying appropriate statistical techniques.
- If no discharge occurs through an outfall, flow related parameters (e.g. flow rate, hydraulic application rate, volume, etc.) should be reported as “0” (zero) at the required sample frequency specified for the outfall. For example: if the sample frequency is daily, “0” would be reported for any day during the month that no discharge occurred.

6.1.5 Compliance Maintenance Annual Reports

Compliance Maintenance Annual Reports (CMAR) shall be completed using information obtained over each calendar year regarding the wastewater conveyance and treatment system. The CMAR shall be submitted and certified by the permittee in accordance with ch. NR 208, Wis. Adm. Code, by June 30, each year on an electronic report form provided by the Department.

In the case of a publicly owned treatment works, a resolution shall be passed by the governing body and submitted as part of the CMAR, verifying its review of the report and providing responses as required. Private owners of wastewater treatment works are not required to pass a resolution; but they must provide an Owner Statement and responses as required, as part of the CMAR submittal.

The CMAR shall be certified electronically by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The certification verifies that the electronic report is true, accurate and complete.

6.1.6 Records Retention

The permittee shall retain records of all monitoring information, including all calibration and maintenance records and all original strip chart recordings or electronic data records for continuous monitoring instrumentation, copies of all reports required by the permit, and records of all data used to complete the application for the permit for a period of at least 3 years from the date of the sample, measurement, report or application. All pertinent sludge information, including permit application information and other documents specified in this permit or s. NR 204.06(9), Wis. Adm. Code shall be retained for a minimum of 5 years.

6.1.7 Other Information

Where the permittee becomes aware that it failed to submit any relevant facts in a permit application or submitted incorrect information in a permit application or in any report to the Department, it shall promptly submit such facts or correct information to the Department.

6.1.8 Reporting Requirements – Alterations or Additions

The permittee shall give notice to the Department as soon as possible of any planned physical alterations or additions to the permitted facility. Notice is only required when:

- The alteration or addition to the permitted facility may meet one of the criteria for determining whether a facility is a new source.
- The alteration or addition could significantly change the nature or increase the quantity of pollutants discharged. This notification requirement applies to pollutants which are not subject to effluent limitations in the existing permit.
- The alteration or addition results in a significant change in the permittee's sludge use or disposal practices, and such alteration, addition, or change may justify the application of permit conditions that are different from or absent in the existing permit, including notification of additional use of disposal sites not reported during the permit application process nor reported pursuant to an approved land application plan. Additional sites may not be used for the land application of sludge until department approval is received.

6.2 System Operating Requirements

6.2.1 Noncompliance Reporting

Sanitary sewer overflows and sewage treatment facility overflows shall be reported according to the 'Sanitary Sewer Overflows and Sewage Treatment Facility Overflows' section of this permit.

The permittee shall report the following types of noncompliance by a telephone call to the Department's regional office within 24 hours after becoming aware of the noncompliance:

- any noncompliance which may endanger health or the environment;
- any violation of an effluent limitation resulting from a bypass;
- any violation of an effluent limitation resulting from an upset; and
- any violation of a maximum discharge limitation for any of the pollutants listed by the Department in the permit, either for effluent or sludge.

A written report describing the noncompliance shall also be submitted to the Department's regional office within 5 days after the permittee becomes aware of the noncompliance. On a case-by-case basis, the Department may waive the requirement for submittal of a written report within 5 days and instruct the permittee to submit the written report with the next regularly scheduled monitoring report. In either case, the written report shall contain a description of the noncompliance and its cause; the period of noncompliance, including exact dates and times; the steps taken or planned to reduce, eliminate and prevent reoccurrence of the noncompliance; and if the noncompliance has not been corrected, the length of time it is expected to continue.

A scheduled bypass approved by the Department under the 'Scheduled Bypass' section of this permit shall not be subject to the reporting required under this section.

NOTE: Section 292.11(2)(a), Wisconsin Statutes, requires any person who possesses or controls a hazardous substance or who causes the discharge of a hazardous substance to notify the Department of Natural Resources immediately of any discharge not authorized by the permit. **The discharge of a hazardous substance that is not authorized by this permit or that violates this permit may be a hazardous substance spill. To report a hazardous substance spill, call DNR's 24-hour HOTLINE at 1-800-943-0003.**

6.2.2 Flow Meters

Flow meters shall be calibrated annually, as per s. NR 218.06, Wis. Adm. Code.

6.2.3 Raw Grit and Screenings

All raw grit and screenings shall be disposed of at a properly licensed solid waste facility or picked up by a licensed waste hauler. If the facility or hauler are located in Wisconsin, then they shall be licensed under chs. NR 500-555, Wis. Adm. Code.

6.2.4 Sludge Management

All sludge management activities shall be conducted in compliance with ch. NR 204 "Domestic Sewage Sludge Management", Wis. Adm. Code.

6.2.5 Prohibited Wastes

Under no circumstances may the introduction of wastes prohibited by s. NR 211.10, Wis. Adm. Code, be allowed into the waste treatment system. Prohibited wastes include those:

- which create a fire or explosion hazard in the treatment work;
- which will cause corrosive structural damage to the treatment work;
- solid or viscous substances in amounts which cause obstructions to the flow in sewers or interference with the proper operation of the treatment work;
- wastewaters at a flow rate or pollutant loading which are excessive over relatively short time periods so as to cause a loss of treatment efficiency; and
- changes in discharge volume or composition from contributing industries which overload the treatment works or cause a loss of treatment efficiency.

6.2.6 Bypass

This condition applies only to bypassing at a sewage treatment facility that is not a scheduled bypass, approved blending as a specific condition of this permit, a sewage treatment facility overflow or a controlled diversion as provided in the sections titled 'Scheduled Bypass', 'Blending' (if approved), 'SSO's and Sewage Treatment Facility Overflows' and 'Controlled Diversions' of this permit. Any other bypass at the sewage treatment facility is prohibited and the Department may take enforcement action against a permittee for such occurrences under s. 283.89, Wis. Stats. The Department may approve a bypass if the permittee demonstrates all the following conditions apply:

- The bypass was unavoidable to prevent loss of life, personal injury, or severe property damage;
- There were no feasible alternatives to the bypass, such as the use of auxiliary treatment facilities or adequate back-up equipment, retention of untreated wastes, reduction of inflow and infiltration, or maintenance during normal periods of equipment downtime. This condition is not satisfied if adequate back-up equipment should have been installed in the exercise of reasonable engineering judgment to prevent a bypass which occurred during normal periods of equipment downtime or preventive maintenance. When evaluating feasibility of alternatives, the department may consider factors such as technical achievability, costs and affordability of implementation and risks to public health, the environment and, where the permittee is a municipality, the welfare of the community served; and
- The bypass was reported in accordance with the Noncompliance Reporting section of this permit.

6.2.7 Scheduled Bypass

Whenever the permittee anticipates the need to bypass for purposes of efficient operations and maintenance and the permittee may not meet the conditions for controlled diversions in the 'Controlled Diversions' section of this permit, the permittee shall obtain prior written approval from the Department for the scheduled bypass. A permittee's written request for Department approval of a scheduled bypass shall demonstrate that the conditions for bypassing specified in the above section titled 'Bypass' are met and include the proposed date and reason for the bypass, estimated volume and duration of the bypass, alternatives to bypassing and measures to mitigate environmental harm caused by the bypass. The department may require the permittee to provide public notification for a scheduled bypass if it is determined there is significant public interest in the proposed action and may recommend mitigation measures to minimize the impact of such bypass.

6.2.8 Controlled Diversions

Controlled diversions are allowed only when necessary for essential maintenance to assure efficient operation. Sewage treatment facilities that have multiple treatment units to treat variable or seasonal loading conditions may shut down redundant treatment units when necessary for efficient operation. The following requirements shall be met during controlled diversions:

- Effluent from the sewage treatment facility shall meet the effluent limitations established in the permit. Wastewater that is diverted around a treatment unit or treatment process during a controlled diversion shall be recombined with wastewater that is not diverted prior to the effluent sampling location and prior to effluent discharge;
- A controlled diversion does not include blending as defined in s. NR 210.03(2e), Wis. Adm. Code, and as may only be approved under s. NR 210.12, Wis. Adm. Code. A controlled diversion may not occur during periods of excessive flow or other abnormal wastewater characteristics;
- A controlled diversion may not result in a wastewater treatment facility overflow; and
- All instances of controlled diversions shall be documented in sewage treatment facility records and such records shall be available to the department on request.

6.2.9 Proper Operation and Maintenance

The permittee shall at all times properly operate and maintain all facilities and systems of treatment and control which are installed or used by the permittee to achieve compliance with the conditions of this permit. Proper operation and maintenance includes effective performance, adequate funding, adequate operator staffing and training as required in ch. NR 114, Wis. Adm. Code, and adequate laboratory and process controls, including appropriate quality assurance procedures. This provision requires the operation of back-up or auxiliary facilities or similar systems only when necessary to achieve compliance with the conditions of the permit.

6.2.10 Operator Certification

The wastewater treatment facility shall be under the direct supervision of a state certified operator. In accordance with s. NR 114.53, Wis. Adm. Code, every WPDES permitted treatment plant shall have a designated operator-in-charge holding a current and valid certificate. The designated operator-in-charge shall be certified at the level and in all subclasses of the treatment plant, except laboratory. Treatment plant owners shall notify the department of any changes in the operator-in-charge within 30 days. Note that s. NR 114.52(22), Wis. Adm. Code, lists types of facilities that are excluded from operator certification requirements (i.e. private sewage systems, pretreatment facilities discharging to public sewers, industrial wastewater treatment that consists solely of land disposal, agricultural digesters and concentrated aquatic production facilities with no biological treatment).

6.3 Sewage Collection Systems

6.3.1 Sanitary Sewage Overflows and Sewage Treatment Facility Overflows

6.3.1.1 Overflows Prohibited

Any overflow or discharge of wastewater from the sewage collection system or at the sewage treatment facility, other than from permitted outfalls, is prohibited. The permittee shall provide information on whether any of the following conditions existed when an overflow occurred:

- The sanitary sewer overflow or sewage treatment facility overflow was unavoidable to prevent loss of life, personal injury or severe property damage;
- There were no feasible alternatives to the sanitary sewer overflow or sewage treatment facility overflow such as the use of auxiliary treatment facilities or adequate back-up equipment, retention of untreated wastes, reduction of inflow and infiltration, or preventive maintenance activities;

- The sanitary sewer overflow or the sewage treatment facility overflow was caused by unusual or severe weather-related conditions such as large or successive precipitation events, snowmelt, saturated soil conditions, or severe weather occurring in the area served by the sewage collection system or sewage treatment facility; and
- The sanitary sewer overflow or the sewage treatment facility overflow was unintentional, temporary, and caused by an accident or other factors beyond the reasonable control of the permittee.

6.3.1.2 Permittee Response to Overflows

Whenever a sanitary sewer overflow or sewage treatment facility overflow occurs, the permittee shall take all feasible steps to control or limit the volume of untreated or partially treated wastewater discharged, and terminate the discharge as soon as practicable. Remedial actions, including those in s. NR 210.21 (3), Wis. Adm. Code, shall be implemented consistent with an emergency response plan developed under the CMOM program.

6.3.1.3 Permittee Reporting

Permittees shall report all sanitary sewer overflows and sewage treatment overflows as follows:

- The permittee shall notify the department by telephone, fax or email as soon as practicable, but no later than 24 hours from the time the permittee becomes aware of the overflow;
- The permittee shall, no later than five days from the time the permittee becomes aware of the overflow, provide to the department the information identified in this paragraph using department form number 3400-184. If an overflow lasts for more than five days, an initial report shall be submitted within 5 days as required in this paragraph and an updated report submitted following cessation of the overflow. At a minimum, the following information shall be included in the report:
 - The date and location of the overflow;
 - The surface water to which the discharge occurred, if any;
 - The duration of the overflow and an estimate of the volume of the overflow;
 - A description of the sewer system or treatment facility component from which the discharge occurred such as manhole, lift station, constructed overflow pipe, or crack or other opening in a pipe;
 - The estimated date and time when the overflow began and stopped or will be stopped;
 - The cause or suspected cause of the overflow including, if appropriate, precipitation, runoff conditions, areas of flooding, soil moisture and other relevant information;
 - Steps taken or planned to reduce, eliminate and prevent reoccurrence of the overflow and a schedule of major milestones for those steps;
 - A description of the actual or potential for human exposure and contact with the wastewater from the overflow;
 - Steps taken or planned to mitigate the impacts of the overflow and a schedule of major milestones for those steps;
 - To the extent known at the time of reporting, the number and location of building backups caused by excessive flow or other hydraulic constraints in the sewage collection system that occurred concurrently with the sanitary sewer overflow and that were within the same area of the sewage collection system as the sanitary sewer overflow; and
 - The reason the overflow occurred or explanation of other contributing circumstances that resulted in the overflow event. This includes any information available including whether the overflow was unavoidable to prevent loss of life, personal injury, or severe property damage and whether there were feasible alternatives to the overflow.

NOTE: A copy of form 3400-184 for reporting sanitary sewer overflows and sewage treatment facility overflows may be obtained from the department or accessed on the department's web site at

<http://dnr.wi.gov/topic/wastewater/SSOreport.html>. As indicated on the form, additional information may be submitted to supplement the information required by the form.

- The permittee shall identify each specific location and each day on which a sanitary sewer overflow or sewage treatment facility overflow occurs as a discrete sanitary sewer overflow or sewage treatment facility overflow occurrence. An occurrence may be more than one day if the circumstances causing the sanitary sewer overflow or sewage treatment facility overflow results in a discharge duration of greater than 24 hours. If there is a stop and restart of the overflow at the same location within 24 hours and the overflow is caused by the same circumstance, it may be reported as one occurrence. Sanitary sewer overflow occurrences at a specific location that are separated by more than 24 hours shall be reported as separate occurrences; and
- A permittee that is required to submit wastewater discharge monitoring reports under s. NR 205.07 (1) (r), Wis. Adm. Code, shall also report all sanitary sewer overflows and sewage treatment facility overflows on that report.

6.3.1.4 Public Notification

The permittee shall notify the public of any sanitary sewer and sewage treatment facility overflows consistent with its emergency response plan required under the CMOM (Capacity, Management, Operation and Maintenance) section of this permit and s. NR 210.23 (4) (f), Wis. Adm. Code. Such public notification shall occur promptly following any overflow event using the most effective and efficient communications available in the community. At minimum, a daily newspaper of general circulation in the county(s) and municipality whose waters may be affected by the overflow shall be notified by written or electronic communication.

6.3.2 Capacity, Management, Operation and Maintenance (CMOM) Program

- The permittee shall have written documentation of the Capacity, Management, Operation and Maintenance (CMOM) program components in accordance with s. NR 210.23(4), Wis. Adm. Code. Such documentation shall be available for Department review upon request. The Department may request that the permittee provide this documentation or prepare a summary of the permittee's CMOM program at the time of application for reissuance of the WPDES permit.
- The permittee shall implement a CMOM program in accordance with s. NR 210.23, Wis. Adm. Code.
- The permittee shall at least annually conduct a self-audit of activities conducted under the permittee's CMOM program to ensure CMOM components are being implemented as necessary to meet the general standards of s. NR 210.23(3), Wis. Adm. Code.

6.3.3 Sewer Cleaning Debris and Materials

All debris and material removed from cleaning sanitary sewers shall be managed to prevent nuisances, run-off, ground infiltration or prohibited discharges.

- Debris and solid waste shall be dewatered, dried and then disposed of at a licensed solid waste facility.
- Liquid waste from the cleaning and dewatering operations shall be collected and disposed of at a permitted wastewater treatment facility.
- Combination waste including liquid waste along with debris and solid waste may be disposed of at a licensed solid waste facility or wastewater treatment facility willing to accept the waste.

6.4 Surface Water Requirements

6.4.1 Permittee-Determined Limit of Quantitation Incorporated into this Permit

For pollutants with water quality-based effluent limits below the Limit of Quantitation (LOQ) in this permit, the LOQ calculated by the permittee and reported on the Discharge Monitoring Reports (DMRs) is incorporated by reference into this permit. The LOQ shall be reported on the DMRs, shall be the lowest quantifiable level practicable, and shall

be no greater than the minimum level (ML) specified in or approved under 40 CFR Part 136 for the pollutant at the time this permit was issued, unless this permit specifies a higher LOQ.

6.4.2 Appropriate Formulas for Effluent Calculations

The permittee shall use the following formulas for calculating effluent results to determine compliance with average concentration limits and mass limits and total load limits:

Weekly/Monthly/Six-Month/Annual Average Concentration = the sum of all daily results for that week/month/six-month/year, divided by the number of results during that time period. [Note: When a six-month average effluent limit is specified for Total Phosphorus the applicable periods are May through October and November through April, except in cases of Water Quality Trading, wherein the applicable periods are January through June and July through December.]

Weekly Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the week.

Monthly Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the month.

Six-Month Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the six-month period. [Note: When a six-month average effluent limit is specified for Total Phosphorus the applicable periods are May through October and November through April.]

Annual Average Mass Discharge (lbs/day): Daily mass = daily concentration (mg/L) x daily flow (MGD) x 8.34, then average the daily mass values for the entire year.

Total Monthly Discharge: = monthly average concentration (mg/L) x total flow for the month (MG/month) x 8.34.

Total Annual Discharge: = sum of total monthly discharges for the calendar year.

12-Month Rolling Sum of Total Monthly Discharge: = the sum of the most recent 12 consecutive months of Total Monthly Discharges.

6.4.3 Effluent Temperature Requirements

Weekly Average Temperature – If temperature limits are included in this permit, Weekly Average Temperature shall be calculated as the sum of all daily maximum results for that week divided by the number of daily maximum results during that time period.

Cold Shock Standard – Water temperatures of the discharge shall be controlled in a manner as to protect fish and aquatic life uses from the deleterious effects of cold shock pursuant to Wis. Adm. Code, s. NR 102.28. ‘Cold Shock’ means exposure of aquatic organisms to a rapid decrease in temperature and a sustained exposure to low temperature that induces abnormal behavior or physiological performance and may lead to death.

Rate of Temperature Change Standard – Temperature of a water of the state or discharge to a water of the state may not be artificially raised or lowered at such a rate that it causes detrimental health or reproductive effects to fish or aquatic life of the water of the state pursuant to Wis. Adm. Code, s. NR 102.29.

6.4.4 Visible Foam or Floating Solids

There shall be no discharge of floating solids or visible foam in other than trace amounts.

6.4.5 Surface Water Uses and Criteria

In accordance with NR 102.04, Wis. Adm. Code, surface water uses and criteria are established to govern water management decisions. Practices attributable to municipal, industrial, commercial, domestic, agricultural, land development or other activities shall be controlled so that all surface waters including the mixing zone meet the following conditions at all times and under all flow and water level conditions:

- a) Substances that will cause objectionable deposits on the shore or in the bed of a body of water, shall not be present in such amounts as to interfere with public rights in waters of the state.
- b) Floating or submerged debris, oil, scum or other material shall not be present in such amounts as to interfere with public rights in waters of the state.
- c) Materials producing color, odor, taste or unsightliness shall not be present in such amounts as to interfere with public rights in waters of the state.
- d) Substances in concentrations or in combinations which are toxic or harmful to humans shall not be present in amounts found to be of public health significance, nor shall substances be present in amounts which are acutely harmful to animal, plant or aquatic life.

6.4.6 Percent Removal

During any 30 consecutive days, the average effluent concentrations of BOD₅ and of total suspended solids shall not exceed 15% of the average influent concentrations, respectively. This requirement does not apply to removal of total suspended solids if the permittee operates a lagoon system and has received a variance for suspended solids granted under NR 210.07(2), Wis. Adm. Code.

6.4.7 *E. coli*

The monthly limit for *E. coli* shall be expressed as a geometric mean. In calculating the geometric mean, a value of 1 is used for any result of 0.

6.4.8 Seasonal Disinfection

Disinfection shall be provided from May 1 through September 30 of each year. Monitoring requirements and the limitations for Fecal Coliform (interim) and *E. coli* apply only during the period in which disinfection is required. Whenever chlorine is used for disinfection or other uses, the limitations and monitoring requirements for residual chlorine shall apply. A dechlorination process shall be in operation whenever chlorine is used.

6.4.9 Total Residual Chlorine Requirements

When total residual chlorine (TRC) limit(s) or monitoring are included in a permit, the permittee shall comply with the following conditions:

- a) The permittee shall perform TRC monitoring required in this permit using an approved method from ch. NR 219, Wis. Adm. Code, which produces a detection limit that is less than or equal to the permitted limit or produces the lowest economically feasible detection limit if the approved methods cannot meet the permit limit. If the facility cannot achieve a detection limit less than or equal to the permit limit using the approved methods, contact the laboratory accreditation program for guidance.
- b) The permittee shall determine the limit of detection (LOD) as specified in s. NR 149.48 (2)(b), Wis. Adm. Code, or the permittee shall contact the laboratory accreditation program for information on how to determine a verified detection limit allowed just for TRC. If the verified detection limit is determined using the special procedure, then the LOD and limit of quantitation (LOQ) shall be set to be equal to the verified detection limit determined from this special procedure.
- c) The permittee shall determine compliance with the TRC limit(s) as follows:
 1. If the facility determines a statistical LOD as specified in s. NR 149.48 (2)(b), Wis. Adm. Code, and the measured TRC levels are less than the LOD, the permittee shall report the results as less than the LOD (<LOD). For this situation the LOQ shall be established at 3.33 times the LOD or at the concentration of the lowest standard in the calibration curve. TRC levels that are < LOD are in compliance with the TRC limit.

2. If the facility determines the verified detection limit using the laboratory accreditation program special procedure, this verified detection limit shall be reported as the LOD and LOQ. If the measured TRC levels are less than the LOD, the permittee shall report the results as < LOD. TRC levels that are < LOD are in compliance with the TRC limit.
3. If the facility determines the statistical LOD as specified in s. NR 149.48 (2)(b), Wis. Adm. Code, and the measured TRC levels are greater than the statistical LOD but less than the LOQ, TRC levels are in compliance with the TRC limit - except when the measured levels are consistently reported between the LOD and LOQ. When the measured TRC levels are consistently reported between the LOD and LOQ, the facility shall take action to determine the reliability of detected results (such as resampling and/or re-calculating dosages) and shall adjust the chemical feed system if necessary to reduce the chances of detecting levels between the statistical LOD and LOQ.
4. If the facility determines the statistical LOQ as specified in s. NR 149.48 (2)(b), Wis. Adm. Code, or determines the verified detection limit using the laboratory accreditation program special procedure, TRC measured levels that are greater than the statistical LOQ and the TRC limit, are not in compliance with the TRC limit. The permittee shall report the level as a limit exceedance.
5. If the facility determines the statistical LOD as specified in s. NR 149.48 (2)(b), Wis. Adm. Code, and the measured level is < LOD, then a "0" (zero) value may be substituted for any test result less than the statistical LOD when calculating the average or mass discharge values. Calculated values shall then be compared directly to the average or mass limits to determine compliance.
6. If the facility determines the verified detection limit using the laboratory accreditation program special procedure and the measured level is < LOD (set equal to the verified detection limit), then a "0" (zero) value may be substituted for any test result less than the LOD when calculating the average or mass discharge values. Calculated values shall then be compared directly to the average or mass limits to determine compliance.

6.4.10 Whole Effluent Toxicity (WET) Monitoring Requirements

In order to determine the potential impact of the discharge on aquatic organisms, static-renewal toxicity tests shall be performed on the effluent in accordance with the procedures specified in the *"State of Wisconsin Aquatic Life Toxicity Testing Methods Manual, 2nd Edition"* (PUB-WT-797, November 2004) as required by NR 219.04, Table A, Wis. Adm. Code). All of the WET tests required in this permit, including any required retests, shall be conducted on the *Ceriodaphnia dubia* and fathead minnow species. Receiving water samples shall not be collected from any point in contact with the permittee's mixing zone and every attempt shall be made to avoid contact with any other discharge's mixing zone.

6.4.11 Whole Effluent Toxicity (WET) Identification and Reduction

Within 60 days of a retest which showed positive results, the permittee shall submit a written report to the Biomonitoring Coordinator, Bureau of Water Quality, 101 S. Webster St., PO Box 7921, Madison, WI 53707-7921, which details the following:

- A description of actions the permittee has taken or will take to remove toxicity and to prevent the recurrence of toxicity;
- A description of toxicity reduction evaluation (TRE) investigations that have been or will be done to identify potential sources of toxicity, including the following actions:
 - a) Evaluate the performance of the treatment system to identify deficiencies contributing to effluent toxicity (e.g., operational problems, chemical additives, incomplete treatment)
 - b) Identify the compound(s) causing toxicity. Conduct toxicity screening tests on the effluent at a minimum of once per month for six months to determine if toxicity recurs. Screening tests are WET

tests using fewer effluent concentrations conducted on the most sensitive species. If any of the screening tests contain toxicity, conduct a toxicity identification evaluation (TIE) to determine the cause. TIE methods are available from USEPA “Methods for Aquatic Toxicity Identification Evaluations: Phase I Toxicity Characterization Procedures (EPA/600/6-91/003) and “Toxicity Identification Evaluation: Characterization of Chronically Toxic Effluents, Phase I” (EPA/600/6-91/005F).

- c) Trace the compound(s) causing toxicity to their sources (e.g., industrial, commercial, domestic)
 - d) Evaluate, select, and implement methods or technologies to control effluent toxicity (e.g., in-plant or pretreatment controls, source reduction or removal)
- Where corrective actions including a TRE have not been completed, an expeditious schedule under which corrective actions will be implemented;
 - If no actions have been taken, the reason for not taking action.

The permittee may also request approval from the Department to postpone additional retests in order to investigate the source(s) of toxicity. Postponed retests must be completed after toxicity is believed to have been removed.

6.4.12 Reopener Clause

Pursuant to s. 283.15(11), Wis. Stat. and 40 CFR 131.20, the Department may modify or revoke and reissue this permit if, through the triennial standard review process, the Department determines that the terms and conditions of this permit need to be updated to reflect the highest attainable condition of the receiving water.

6.4.13 PFOS and PFOA Requirements

The laboratory performing the analysis on any samples shall be certified for the applicable PFAS compounds in the aqueous matrix by the Wisconsin Laboratory Certification Program established under s. 299.11, Wis. Stats., in accordance with s. NR 149.41, Wis. Adm. Code. If the EPA Office of Water publishes a 1600 series isotope dilution method for the analysis of PFAS in wastewater, the department recommends the use of the EPA method.

The Department may reject any sample results if results are produced by a laboratory that is not in compliance with certification requirements under ch. NR 149, Wis. Adm. Code.

6.5 Land Application Requirements

6.5.1 Sludge Management Program Standards And Requirements Based Upon Federally Promulgated Regulations

In the event that new federal sewage sludge standards or regulations are promulgated, the permittee shall comply with the new sewage sludge requirements by the dates established in the regulations, if required by federal law, even if the permit has not yet been modified to incorporate the new federal regulations.

6.5.2 General Sludge Management Information

The General Sludge Management Form 3400-48 shall be completed and submitted prior to any significant sludge management changes.

6.5.3 Sludge Samples

All sludge samples shall be collected at a point and in a manner which will yield sample results which are representative of the sludge being tested, and collected at the time which is appropriate for the specific test.

6.5.4 Land Application Characteristic Report

Each report shall consist of a Characteristic Form 3400-49 and Lab Report. The Characteristic Report Form 3400-49 shall be submitted electronically by January 31 following each year of analysis.

Following submittal of the electronic Characteristic Report Form 3400-49, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report is true, accurate and complete. The Lab Report must be sent directly to the facility's DNR sludge representative or basin engineer unless approval for not submitting the lab reports has been given.

The permittee shall use the following convention when reporting sludge monitoring results: Pollutant concentrations less than the limit of detection shall be reported as < (less than) the value of the limit of detection. For example, if a substance is not detected at a detection limit of 1.0 mg/kg, report the pollutant concentration as < 1.0 mg/kg .

All results shall be reported on a dry weight basis.

6.5.5 Calculation of Water Extractable Phosphorus

When sludge analysis for Water Extractable Phosphorus is required by this permit, the permittee shall use the following formula to calculate and report Water Extractable Phosphorus:

Water Extractable Phosphorus (% of Total P) =

$$[\text{Water Extractable Phosphorus (mg/kg, dry wt)} \div \text{Total Phosphorus (mg/kg, dry wt)}] \times 100$$

6.5.6 Annual Land Application Report

Land Application Report Form 3400-55 shall be submitted electronically by January 31, each year whether or not non-exceptional quality sludge is land applied. Non-exceptional quality sludge is defined in s. NR 204.07(4), Wis. Adm. Code. Following submittal of the electronic Annual Land Application Report Form 3400-55, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

6.5.7 Other Methods of Disposal or Distribution Report

The permittee shall submit electronically the Other Methods of Disposal or Distribution Report Form 3400-52 by January 31, each year whether or not sludge is hauled, landfilled, incinerated, or exceptional quality sludge is distributed or land applied. Following submittal of the electronic Report Form 3400-52, this form shall be certified electronically via the 'eReport Certify' page by a responsible executive or municipal officer, manager, partner or proprietor as specified in s. 283.37(3), Wis. Stats., or a duly authorized representative of the officer, manager, partner or proprietor that has been delegated signature authority pursuant to s. NR 205.07(1)(g)2, Wis. Adm. Code. The 'eReport Certify' page certifies that the electronic report form is true, accurate and complete.

6.5.8 Approval to Land Apply

Bulk non-exceptional quality sludge as defined in s. NR 204.07(4), Wis. Adm. Code, may not be applied to land without a written approval letter or Form 3400-122 from the Department unless the Permittee has obtained permission from the Department to self-approve sites in accordance with s. NR 204.06(6), Wis. Adm. Code. Analysis of sludge characteristics is required prior to land application. Application on frozen or snow-covered ground is restricted to the extent specified in s. NR 204.07(3)(1), Wis. Adm. Code.

6.5.9 Soil Analysis Requirements

Each site requested for approval for land application must have the soil tested prior to use. Each approved site used for land application must subsequently be soil tested such that there is at least one valid soil test in the four years prior to land application. All soil sampling and submittal of information to the testing laboratory shall be done in accordance with UW Extension Bulletin A-2100. The testing shall be done by the UW Soils Lab in Madison or Marshfield, WI or at a lab approved by UW. The test results including the crop recommendations shall be submitted

to the DNR contact listed for this permit, as they are available. Application rates shall be determined based on the crop nitrogen recommendations and with consideration for other sources of nitrogen applied to the site.

6.5.10 Land Application Site Evaluation

For non-exceptional quality sludge, as defined in s. NR 204.07(4), Wis. Adm. Code, a Land Application Site Request Form 3400-053 shall be submitted to the Department for the proposed land application site. The Department will evaluate the proposed site for acceptability and will either approve or deny use of the proposed site. The permittee may obtain permission to approve their own sites in accordance with s. NR 204.06(6), Wis. Adm. Code.

6.5.11 Class B Sludge: Fecal Coliform Limitation

Compliance with the fecal coliform limitation for Class B sludge shall be demonstrated by calculating the geometric mean of at least 7 separate samples. (Note that a Total Solids analysis must be done on each sample). The geometric mean shall be less than 2,000,000 MPN or CFU/g TS. Calculation of the geometric mean can be done using one of the following 2 methods.

Method 1:

$$\text{Geometric Mean} = (X_1 \times X_2 \times X_3 \dots \times X_n)^{1/n}$$

Where X = Coliform Density value of the sludge sample, and where n = number of samples (at least 7)

Method 2:

$$\text{Geometric Mean} = \text{antilog}[(X_1 + X_2 + X_3 \dots + X_n) \div n]$$

Where X = log₁₀ of Coliform Density value of the sludge sample, and where n = number of samples (at least 7)

Example for Method 2

Sample Number	Coliform Density of Sludge Sample	log ₁₀
1	6.0 x 10 ⁵	5.78
2	4.2 x 10 ⁶	6.62
3	1.6 x 10 ⁶	6.20
4	9.0 x 10 ⁵	5.95
5	4.0 x 10 ⁵	5.60
6	1.0 x 10 ⁶	6.00
7	5.1 x 10 ⁵	5.71

The geometric mean for the seven samples is determined by averaging the log₁₀ values of the coliform density and taking the antilog of that value.

$$(5.78 + 6.62 + 6.20 + 5.95 + 5.60 + 6.00 + 5.71) \div 7 = 5.98$$

$$\text{The antilog of } 5.98 = 9.5 \times 10^5$$

6.5.12 Class B Sludge - Vector Control: Injection

No significant amount of the sewage sludge shall be present on the land surface within one hour after the sludge is injected.

6.5.13 Class B Sludge - Vector Control: Incorporation

Class B sludge shall be incorporated within 6 hours of surface application, or as approved by the Department.

7 Summary of Reports Due

FOR INFORMATIONAL PURPOSES ONLY

Description	Date	Page
Chloride Source Reduction Measures (Target Value) -Annual Chloride Progress Report	January 31, 2026	21
Chloride Source Reduction Measures (Target Value) -Annual Chloride Progress Report #2	January 31, 2027	21
Chloride Source Reduction Measures (Target Value) -Annual Chloride Progress Report #3	January 31, 2028	21
Chloride Source Reduction Measures (Target Value) -Annual Chloride Progress Report #4	January 31, 2029	21
Chloride Source Reduction Measures (Target Value) -Final Chloride Report	September 30, 2029	21
Chloride Source Reduction Measures (Target Value) -Annual Chloride Reports After Permit Expiration	See Permit	22
TMDL-Based Effluent Mass Limits for Total Phosphorus -Construction Upgrade Progress Report #1	August 31, 2025	22
TMDL-Based Effluent Mass Limits for Total Phosphorus -Construction Upgrade Progress Report #2	August 31, 2026	22
TMDL-Based Effluent Mass Limits for Total Phosphorus -Complete Construction	June 30, 2027	22
TMDL-Based Effluent Mass Limits for Total Phosphorus -Achieve Compliance	July 1, 2027	22
PFOS/PFOA Minimization Plan Determination of Need -Report on Effluent Discharge	March 31, 2026	22
PFOS/PFOA Minimization Plan Determination of Need -Report on Effluent Discharge and Evaluation of Need	March 31, 2027	22
Install Continuous Flow Recording Device -Plans and Specifications	March 31, 2027	23
Install Continuous Flow Recording Device -Complete Install	March 31, 2028	23
Dissipative Cooling Study -Complete Dissipative Cooling Study	March 1, 2029	23
SS (Sanitary Sewage Collection System) Subclass -Operator Certification	March 31, 2026	24
Sludge Management Plan -Sludge Management Plan Submittal	March 31, 2026	24
Compliance Maintenance Annual Reports (CMAR)	by June 30, each year	26
General Sludge Management Form 3400-48	prior to any significant sludge management changes	35
Characteristic Form 3400-49 and Lab Report	by January 31 following each year of analysis	35
Land Application Report Form 3400-55	by January 31, each year whether or not non-exceptional	36

	quality sludge is land applied	
Other Methods of Disposal or Distribution Report Form 3400-52	by January 31, each year whether or not sludge is hauled, landfilled, incinerated, or exceptional quality sludge is distributed or land applied	36
Wastewater Discharge Monitoring Report	no later than the date indicated on the form	25

Report forms shall be submitted electronically in accordance with the reporting requirements herein. Any facility plans or plans and specifications for municipal, industrial, industrial pretreatment and non industrial wastewater systems shall be submitted to the Bureau of Water Quality, P.O. Box 7921, Madison, WI 53707-7921. All other submittals required by this permit shall be submitted to:
Northeast Region - Oshkosh, 625 E Cty Rd Y, Suite 700, Oshkosh, WI 54901