WATER QUALITY TRADING PLAN

Submitted: May 16, 2023
Revised: March 29, 2024
Revised: June 11, 2024
Revised: April 3, 2025



Village of La Farge
Wastewater Treatment Facility

WPDES Permit No. WI-0024465-11-0
HWY 131 South
La Farge, Wisconsin 54639

Prepared by:

Delta 3 Engineering, Inc.

875 S Chestnut St. | Platteville, WI 53818
Phone: (608) 348-5355
mail@delta3eng.biz

www.delta3eng.biz

DELTA 3
EVERY ANGLE COVERED

Project Number: D22-145

TABLE OF CONTENTS

I. Executive Summary 1

II. Background 2

III. Location and Description of Credit Generation Sites 6

IV. Methods for Nonpoint Source Load Reduction 7

V. Trade Timeline 12

VI. Inspection and Reporting 13

VII. Certification 15

Attachments

1) Notice of Intent to Conduct Water Quality Trading
2) Water Quality Trading Checklist
3) Location & Topography Map
4) Sanitary Sewer Map
5) Wastewater Treatment Facility Flow Schematic
6) HUC-12 Watershed Map
7) Wetland Map
8) Soils Map and Testing Data
9) Current State of Eroding Streambanks Documentation
10) NRCS Streambank Erosion Estimator Report
11) Operation and Maintenance (O&M) Plan
12) WQT Plans and Specifications

I. Executive Summary -

This Water Quality Trading Plan summarizes the Village of La Farge's (Village) plan to utilize Water Quality Trading (WQT) for compliance with the final total phosphorus limit as provided in the Wisconsin Pollutant Discharge Elimination System (WPDES) Permit #WI 0024465-11-0. The Wastewater Treatment Facility (WWTF) treated 0.066 MGD with an average effluent Total Phosphorus (TP) concentration of 0.49 mg/L in 2023. The WWTF plans to continue chemical Phosphorus treatment and offset a minimum 78.3 lbs of TP with WQT Credits in order to meet the final annual six-month average limit of 0.100 mg/L and a monthly average limit of 0.300 mg/L, which became effective following DNR reissuance of the WPDES Permit.

NRCS Streambank Erosion modeling methods were used to calculate the total phosphorus credits that would be generated based on the installation of best management practices (BMPs). These credits will be used to demonstrate compliance with the final total phosphorus limit as proposed in the WPDES Permit.

As demonstrated in modeling results from Table 1.1, the WWTF has the ability to register approximately 201 credits. The implementation of this WQT Plan will result in compliance with the final TP limits. The WWTF intends to monitor TP credit usage and intends to perform construction of additional BMPs as needed for future effluent TP to comply with WPDES Permits Limits. A new Water Quality Trading Plan will be submitted at that time for new BMP practices and credit production.

Table 1.1 – Modeling Results

Reach	Lateral Recession Rate (ft/yr.)	Current Phosphorus Loading (lbs./yr.)	Proposed Phosphorus Loading (lbs./yr.)	Proposed Phosphorus Reductions (lbs./yr.)	Trade Ratio	Proposed Phosphorus Credits
1.1 (Left)	0.40	63	0	63	3:1	21.0
1.2 (Left)	0.40	46	0	46	3:1	15.5
1.3 (Left)	0.30	28	0	28	3:1	9.5
1.4 (Left)	0.50	92	0	92	3:1	30.5
1.5 (Left)	0.30	137	0	137	3:1	45.5
2.1 (Left)	0.30	18	0	18	3:1	6.0
2.2 (Left)	0.30	41	0	41	3:1	13.5
3 (Left)	0.50	178	0	178	3:1	59.5
					Total	**201.0**

NOTE:

Trade Ratio = (Delivery + Downstream + Equivalency + Uncertainty-Habitat Adjustment):1

Delivery = 0 (Trading within same HUC-12 Watershed)

Downstream = 0 (For trades upstream of Outfall 001)

Equivalency = 0 (Not necessary of Total Phosphorus)

Uncertainty: *Streambank Stabilization with Habitat Restoration* = 3

II. Background -

The purpose of this Water Quality Trading Plan (Plan) is to describe the Village's use of Water Quality Trading to comply with the total phosphorus limits as provided in the Village's WPDES Permit #WI-0024465-11-0. The Plan was developed following the Notice of Intent to Conduct Water Quality Trading, provided in Attachment #1. The Water Quality Trading Checklist Form 3400-208 is provided in Attachment #2.

The Village of La Farge (Village) is located along Wisconsin State Highway '131' and Wisconsin State Highway '82' in Vernon County in southwest Wisconsin. The Village owns and operates a Wastewater Treatment Facility (WWTF) which serves a population of approximately 730 residents.

The Village is comprised primarily of commercial and residential development. The Village is situated on a flatter plain area located between bluffs and the Kickapoo River with the grade typically sloping between 2% and 10%. The topography of the area is shown in Attachment #3.

The existing sanitary sewer collection consists of approximately 258 sanitary manholes; 800 feet of six-inch (6") sanitary sewer; 27,650 feet of eight-inch (8") sanitary sewer; and 3,080 feet of 10" sanitary sewer. Two (2) lift stations are utilized throughout the system, along with approximately 1,850 feet of six-inch (6") sanitary force main and 975 feet of eight-inch (8") sanitary force main to assist with the delivery of wastewater to the treatment facility. Please refer to Attachment #4 – Sanitary Sewer Map for location of sanitary sewer collection system components.

The Village operates an extended-aeration activated sludge system. Wastewater enters the WWTF by first passing through primary treatment. Primary treatments consist of a fine screen and grit removal. Wastewater then proceeds to the equalization tank followed by the aeration tank. Activated sludge is settled out in the final clarifier. Effluent is chlorinated/dechlorinated seasonally prior to discharge to the Kickapoo River. The Village's WWTF has one (1) receiving water and effluent discharge location, Outfall 001: Kickapoo River (Middle Kickapoo Watershed, LW05 – Lower Wisconsin River Drainage Basin in Vernon County). Activated sludge is either returned to the head of the process for further treatment or wasted to aerobic sludge digester. Sludge is then transferred to the sludge drying beds where sludge is dried and stored prior to land application on DNR-approved sites. The WWTF adds Aluminum Sulfate (Alum) to the aeration tank prior to entering the final clarifier for chemical treatment of Phosphorus. The Alum causes coagulation, flocculation, and settling of TP containing solids within the final clarifier. TP is then ultimately removed with the sludge. The Village of La Farge has conducted its annual operations and maintenance at the WWTF in order maintain current performance levels of the facility and not regress treatment production. The current WWTF treats 0.066 MGD on an annual average with a design flow of 0.172 MGD. Please see Attachment #5 for the WWTF flow schematic.

The monthly average influent and effluent flows and loadings at the WWTF for 2021, 2022, and 2023 are provided in Table 2.1 Table 2.2, and Table 2.3, respectively.

Table 2.1 – 2021 Monthly Averages

Month	Flow	BOD_5		Suspended Solids		Total Phosphorus		Total Phosphorus
	(MGD)	(mg/L)		(mg/L)		(mg/L)		(lbs./day)
	Effluent	Influent	Effluent	Influent	Effluent	Influent	Effluent	Effluent
Jan. (’21)	0.084	100	2	67	1	-	0.31	0.22
Feb. (’21)	0.081	90	3	63	3	-	0.38	0.26
Mar. (’21)	0.110	65	1	52	2	-	0.27	0.25
Apr. (’21)	0.099	108	1	86	2	-	0.31	0.26
May (’21)	0.094	68	2	56	2	-	0.41	0.32
June (’21)	0.105	51	2	45	2	-	0.50	0.44
July (’21)	0.128	51	2	47	1	-	0.47	0.50
Aug. (’21)	0.225	23	1	29	1	-	0.34	0.64
Sept. (’21)	0.131	60	1	62	1	-	0.40	0.44
Oct. (’21)	0.088	54	1	52	1	-	0.60	0.44
Nov. (’21)	0.078	62	1	54	1	-	0.46	0.30
Dec. (’21)	0.079	77	1	64	1	-	0.38	0.25
Annual Average =	**0.109**	**67**	**2**	**56**	**2**	-	**0.40**	**0.36**

Table 2.2 – 2022 Monthly Averages

Month	Flow	BOD_5		Suspended Solids		Total Phosphorus		Total Phosphorus
	(MGD)	(mg/L)		(mg/L)		(mg/L)		(lbs./day)
	Effluent	Influent	Effluent	Influent	Effluent	Influent	Effluent	Effluent
Jan. (’22)	0.074	75	1	52	1	-	0.27	0.17
Feb. (’22)	0.071	95	1	73	2	-	0.28	0.17
Mar. (’22)	0.110	65	1	49	5	-	0.37	0.34
Apr. (’22)	0.113	68	1	49	1	-	0.31	0.29
May (’22)	0.115	66	2	55	2	-	0.37	0.35
June (’22)	0.113	64	2	53	1	-	0.47	0.44
July (’22)	0.096	64	8	47	5	-	0.72	0.58
Aug. (’22)	0.120	50	4	33	1	-	0.36	0.36
Sept. (’22)	0.103	43	4	35	2	-	1.02	0.88
Oct. (’22)	0.079	69	5	57	1	-	0.66	0.43
Nov. (’22)	0.101	68	1	50	1	-	0.34	0.29
Dec. (’22)	0.067	96	1	73	1	-	0.27	0.15
Annual Average =	**0.097**	**69**	**3**	**52**	**2**	-	**0.45**	**0.37**

Table 2.3 – 2023 Monthly Averages

Month	Flow	BOD_5		Suspended Solids		Total Phosphorus		Total Phosphorus
	(MGD)	(mg/L)		(mg/L)		(mg/L)		(lbs./day)
	Effluent	Influent	Effluent	Influent	Effluent	Influent	Effluent	Effluent
Jan. ('23)	0.074	79	1	54	3	-	0.46	0.28
Feb. ('23)	0.073	94	1	65	1	-	0.37	0.22
Mar. ('23)	0.125	56	0	44	2	-	0.28	0.30
Apr. ('23)	0.135	39	1	54	2	-	0.27	0.31
May ('23)	0.075	68	2	50	2	-	0.48	0.30
June ('23)	0.041	95	2	59	2	-	0.45	0.15
July ('23)	0.037	117	4	71	1	-	0.98	0.30
Aug. ('23)	0.031	115	0	71	2	-	0.77	0.20
Sept. ('23)	0.036	114	1	75	1	-	0.62	0.18
Oct. ('23)	0.047	92	1	69	3	-	0.33	0.13
Nov. ('23)	0.050	98	4	67	7	-	0.53	0.22
Dec. ('23)	0.066	87	3	58	4	-	0.30	0.17
Annual Average =	**0.066**	**88**	**2**	**61**	**3**	-	**0.49**	**0.27**

Currently, the Village has an average effluent Total Phosphorus of 0.49 mg/L which is well within the WPDES interim limit of 1.0 mg/L. The Village will continue to investigate options for TP removal at the WWTF. To reduce effluent TP, the Village has made efforts to optimize TP reduction at the WWTF. The Village has also implemented source reduction measures such as investigating potential TP contributors. The Village has checked with the following businesses for Phosphorus contribution and will continue its investigation of Phosphorus contributors:

1. Bergum's Food Mart
2. A Little Moore then Hair
3. La Farge State Bank
4. Lawton Memorial Library
5. Premier Co-Op
6. Ewetopia Fiber Mill
7. Organic Valley
8. Ron's Towing
9. La Farge Truck Center
10. Albright Electric and Solar
11. B&W Concrete Construction
12. Carps Construction
13. Mikes Handyman Services
14. Walker Door
15. Cowboy David's Bake Shoppe
16. Goose Barn
17. Phil and Deb's Town Tap
18. Rockton Bar
19. Twisted Raven Lounge
20. La Farge Hardware
21. Chicken Coop
22. Green Apple Inn
23. Kickapoo retreat
24. Bear Creek Cottage Rental

During the initial evaluation of sanitary dischargers, it was determined that Organic Valley was a major contributor of Phosphorus. The Village contacted the Organic Valley about Phosphorus reduction measures. The Village intends to continue educating sewer users in 2024.

Additionally, the Village has investigated watershed compliance alternatives such as Water Quality Trading (WQT) and Adaptive Management (AM). Stream monitoring in 2009/2010 confirmed that the Kickapoo River was an impaired water due to TP. Background TP concentration monitored from Station #533027 Kickapoo River in Banker Park in Viola demonstrated a rolling median TP concentration of 0.186 mg/L. The median average was well over the applicable Water Quality Standard (WQS) of 0.100 mg/L. Following discussion with the DNR and initial investigation, the Village elected to move forward with WQT. Utilizing the results from PRESTO, the watershed of the WWTF has a nonpoint source ratio of 1:99 at the point of discharge and is considered to be nonpoint-source dominated. Therefore, the Village intends to perform WQT projects upstream of the outfall and within the Village's Hydrological Unit Code – 12 (HUC-12) watersheds #070700060306 and #070700060307 as provided in Attachment #6.

Flow and loading data from 2023 was utilized to determine credits needed. Annual effluent TP was estimated at 98.4 lbs. The final limit would allow annual discharge of 20.1 lbs. The Village would be required to offset at least 68.4 lbs of effluent TP. Calculations for required WQT reductions are provided below.

1) The current annual Phosphorus loading discharged at the WWTF is calculated as follows:

Seasonal Average Daily Flow (Q) = 0.066 MGD
Average Phosphorus concentration = 0.49 mg/L

0.49 mg/L x 0.066 MGD x 8.34 x 365 days/yr. = 98.4 lbs./yr.

2) The proposed allowable annual Phosphorus mass limit at the WWTF is calculated as follows:

Seasonal Average Daily Flow (Q) = 0.066 MGD
Proposed Seasonal Phosphorus Concentration Limit = 0.100 mg/L

0.100 mg/L x 0.066 MGD x 8.34 x 365 days/yr. = 20.1 lbs./yr.

3) Reduction of Total Phosphorus required at WWTF

98.4 lbs./yr. – 20.1 lbs./yr. = 78.3 lbs./yr.

To generate the required TP credits, the Village intends to perform streambank stabilization. The La Farge intends to generate additional credits as a factor of safety and for future growth.

III. Location and Description of Credit Generation Sites –

The Village discharges to the Kickapoo River (Middle Kickapoo Watershed, LW05 – Lower Wisconsin River Drainage Basin in Vernon County). As mentioned previously, the Village intends to perform WQT projects within the Village's HUC-12 #070700060306 and #070700060307. The Village plans to perform streambank stabilization which will utilize grading and/or riprap to prevent the erosion of sediment from the streambanks. Projects will occur on property owned by the Village of La Farge. Streambank stabilization will not only prevent sediment from entering the stream, but will also prevent phosphorus, nitrogen, and other pollutants from discharging to the Kickapoo River. See Figure 3.1 for additional project location information.

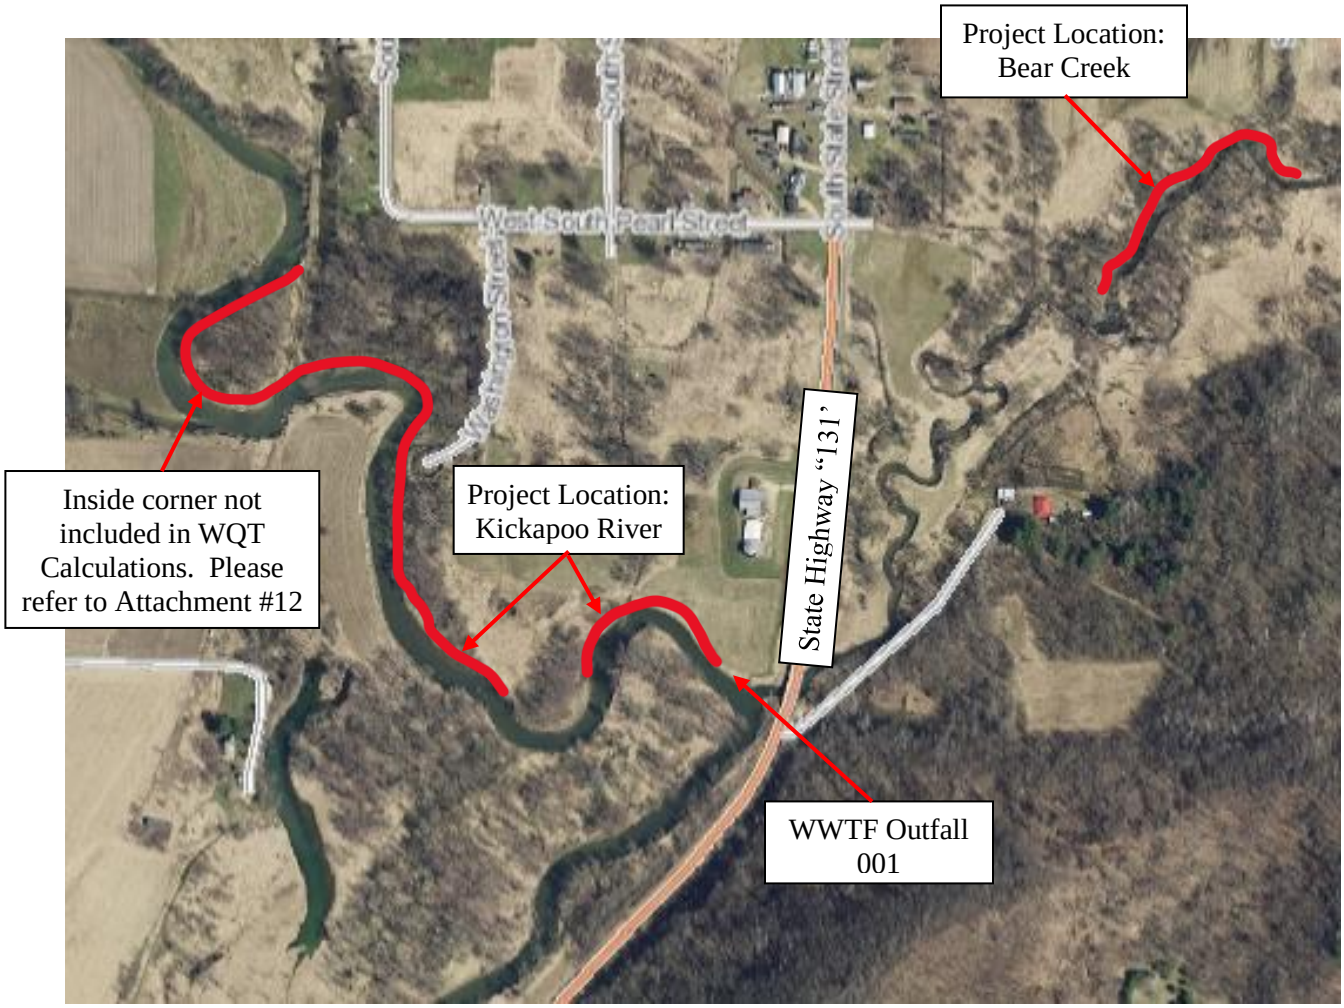


Figure 3.1 – Project location in relation to Outfall 001

IV. Methods for Nonpoint Source Load Reduction –

A. Methods Used to Generate Load Reductions

The Water Quality Trading Plan identifies streambank stabilization practices that will reduce TP runoff from nonpoint sources. The Village has the ability to generate TP load reductions through streambank grading of approximately 2,920 lineal feet of streambank.

Streambank Stabilization will be performed as per NR 328 *Shore Erosion Control Structures in Navigable Waterways and* NRCS 580 *Streambank and Shoreline Protection*. Streambank shaping and riprapping will eliminate the discharge of sediment to the stream. The streambank stabilization project will occur within HUC-12 #070700060306 and #070700060307 in order to generate TP credits. Standard Plans and Specifications for the Project Site will be provided by a Professional Engineer. The Village will also acquire all required permits and authorizations for the Projects.

B. History of Project Site

The Project Site is planned within the Middle Kickapoo River Watershed. The project location is along the Kickapoo River and Bear Creek on property owned by the Village of La Farge. Land use consists of agricultural crop field and undeveloped land. The vegetative cover is a mix of 50% floodplain forest; 35% hay, 10% floodplain grassland, and 5% manicured lawn. The project location consists of undeveloped wetland as indicated in Attachment #7 – Wetland Maps. No fill shall be deposited within the floodplain or wetlands.

The streambanks have experienced significant erosion as the watershed has been cleared for residential and agricultural use. Residential development and agricultural practices caused long term deposition of silt within the floodplain followed by decades of stream morphology eroding a new channel through the deposition.

The Kickapoo River has been included on the Impaired Waters List for Total Phosphorus. Water quality issues caused by sedimentation were included in Wisconsin DNR evaluation for *Kickapoo River Region.* Stream improvements will reduce sediment which was identified as the main reason for habitat degradation in the Kickapoo River. The watershed has also experienced reduction of large woody debris along the streambanks due to agricultural development which reduces available habitat and bank roughness. Stream improvements will also include in-stream habitat improvements.

The banks are bare with slumps, rills and sever vegetative overhang throughout. Severe erosion indicators such as undercuts, slumps, tree roots, and fallen trees are readily visible throughout the site. The erosion indicators demonstrate the lateral recession rate is Severe (0.3-0.5 ft/yr) based on the NRCS Recession Rate Table.

C. Trade Ratio

The Plan identifies trading practices that will reduce TP runoff. However, the DNR requires a trade ratio to provide a safety factor for meeting water quality standards. Trade ratios consider pollutant reductions of varying certainty, location, and type. For the given WQT practice, a trade ratio of 3:1 was calculated. The trade ratio is derived as follows:

Trade Ratio = (Delivery + Downstream + Equivalency + Uncertainty – Habitat Adjustment):1
Delivery = 0 (Trading within same HUC-12 Watershed)
Downstream = 0 (For trades upstream of Outfall 001)
Equivalency = 0 (Not necessary of Total Phosphorus)
Uncertainty: *Streambank Stabilization with Habitat Restoration* = 3

Uncertainty factor was determined from Appendix H – Management Practices and Associated Information of the Wisconsin Department of Natural Resources *Guidance for implementing Water Quality Trading in WPDES Permits (Edition 2)*.

Habitat restoration will consist of bed logs installed approximately every 300 feet within each reach. Bed logs will provide the following habitat benefits:

- Increase roughness within the channel which creates current breaks, shelter, and resting areas for aquatic organisms.
- The log will provide an environment beneficial for algae, macroinvertebrates, and other aquatic organisms that support aquatic food chains.
- Reduce water velocity and ability of the flow to erode and carry sediment.

Table 4.1 - Habitat Restoration Summary

Reach	In-Stream Habitat Structures
1 (Left)	8
2 (Left)	2
3 (Left)	2

D. Model Used to Derive Load Reductions

NRCS Streambank Erosion modeling methods were used to calculate the total phosphorus credits that would be generated based on the installation of BMPs. These credits will be used to demonstrate compliance with the final total phosphorus limit as proposed in the WPDES Permit. Modeling results are provided in Table 4.2. If the Plan or model inputs change during construction, the Village will submit to the DNR the revised models and calculations to more accurately reflect and number of credits generated.

Table 4.2 – Modeling Results

Reach	Lateral Recession Rate (ft/yr.)	Current Phosphorus Loading (lbs./yr.)	Proposed Phosphorus Loading (lbs./yr.)	Proposed Phosphorus Reductions (lbs./yr.)	Trade Ratio	Proposed Phosphorus Credits
1.1 (Left)	0.40	63	0	63	3:1	21.0
1.2 (Left)	0.40	46	0	46	3:1	15.5
1.3 (Left)	0.30	28	0	28	3:1	9.5
1.4 (Left)	0.50	92	0	92	3:1	30.5
1.5 (Left)	0.30	137	0	137	3:1	45.5
2.1 (Left)	0.30	18	0	18	3:1	6.0
2.2 (Left)	0.30	41	0	41	3:1	13.5
3 (Left)	0.50	178	0	178	3:1	59.5
					Total	**201.0**

NOTE:

Trade Ratio = (Delivery + Downstream + Equivalency + Uncertainty-Habitat Adjustment):1

Delivery = 0 (Trading within same HUC-12 Watershed)
Downstream = 0 (For trades upstream of Outfall 001)
Equivalency = 0 (Not necessary of Total Phosphorus)
Uncertainty: *Streambank Stabilization with Habitat Restoration* = 3

Soil testing has been completed to determine TP concentrations within the soil. Soil sampling was performed approximately every 250 feet and included the use of a soil sampler which pulled ¾" cores at 8" depth. Approximately six (6) cores were taken at each sampling location to provide a representative sample. Soils maps and soil testing data is provided in Attachment #8.

Streambank cross sections were surveyed approximately every 100 feet with global position system (GPS) equipment. The site was also surveyed with an aerial drone. The bank height was calculated by using the horizontal distance and vertical difference of GPS survey points located at the water line and the top of eroded area. Bank heights were calculated using the Pythagorean Theorem:

$c = \sqrt{a^2 + b^2}$)
c = bank height (hypotenuse) (feet)
a = vertical bank (feet)
b = horizontal bank (feet)

Streambank heights were calculated as per guidance for the NRCS Streambank Erosion Estimator. An average height was determined for each reach for input to the NRCS Streambank Erosion Estimator. An onsite evaluation has been conducted to estimate stream bank recession rate. The data, narrative, and photos documenting the current state of eroding stream banks are provided in Attachment #9.

Table 4.3 - Reach Summary

Reach	Length	Number of Cross Sections	Average Vertical Bank	Average Horizontal Bank	Average Bank Height
1.1	450	5	6.68	10.12	12.15
1.2	250	3	7.04	9.73	12.20
1.3	150	3	5.75	14.57	15.68
1.4	400	4	6.58	8.10	10.74
1.5	600	5	5.84	13.24	14.52
2.1	125	2	5.60	13.95	15.04
2.2	375	4	6.00	7.00	9.24
3	571	5	5.38	8.42	10.51

An example of the bank height calculation is provided below:

$c = \sqrt{a^2 + b^2}$)

c = bank height (hypotenuse) (feet)

a = vertical bank (feet)

b = horizontal bank (feet)

a = 105.00' – 100.00' = 5.00'

b = 2.50' (horizontal difference from AutoCAD Civil3D)

$c = \sqrt{5.00^2 + 2.50^2}$) = 5.59'

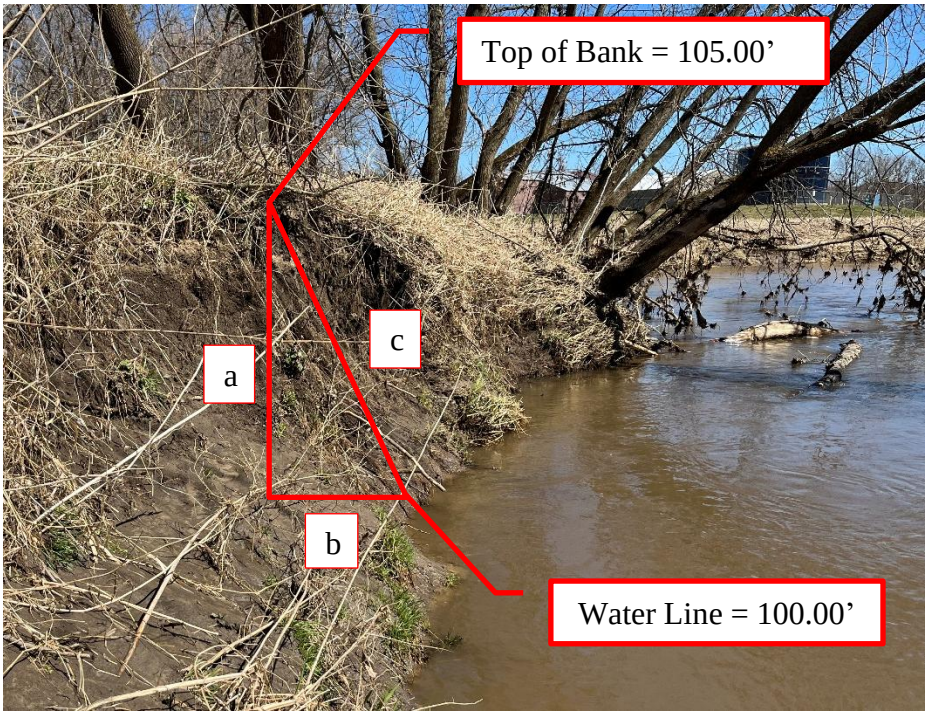


Figure 4.1 – Bank Hight Calculation Example

With the collected data, the NRCS Streambank Erosion Estimator was used to calculate TP loss from each reach of the eroding streambank. The modeling data for the NRCS Streambank Erosion Estimator is available in Attachment #10. The streambank grading and riprap design will eliminate streambank recession thus eliminating TP inputs within the Project areas.

E. Operation and Maintenance

An Operation and Maintenance (O&M) Plan is provided in Attachment #11. The O&M plan describes how the Stream Stabilization Practices will be operated and maintained. The O&M Plan also addresses response procedures for Practice Registration, Noncompliance Notification, and Notification of Trade Agreement Termination.

As previously mentioned, the Village is planning to perform streambank stabilization by implementing BMPs along the Kickapoo River and Bear Creek streambanks. The stabilization practices will be installed and maintained per the Plans and Specifications as provided in Attachment #12. BMPs are to follow NR 328 Shore Erosion Control Structures in Navigable Waterways and NRCS 580 Streambank and Shoreline Protection. Restoration landscaping and seeding will be installed following construction and will be closely monitored for a minimum of two (2) growing seasons to ensure the new seeding grows and erosion is not prevalent. Weeds and invasive vegetation growth will be addressed if present. The riprap will be inspected following heavy rain events at a minimum. Inspection will be used to determine appropriate actions in order to maintain the riprap for continuous and ongoing streambank stabilization and TP credit generation.

The BMPs will be inspected annually by a licensed Professional Engineer to ensure that the BMPs are functioning as intended in order to meet the requirements of this WQT Plan.

V. Trade Timeline –

Schedule for Installation of the above mentioned trading practices for Total Phosphorus Credit Generation for TP compliance is provided in Table 5.1 below.

Table 5.1 – Trade Timeline

Item	Completion Timeline
Site Investigation	Winter 2022
Conceptual Design	Winter 2023
Final Design	Spring 2023
Construction Permits	Spring 2023
DNR Review of Final Design	Spring 2023
Construction of BMPs	Summer/Fall 2023
Phosphorus Credit Registration	Following DNR approval of the WQT Plan
Use of Phosphorus Credits (Ongoing for Permit Compliance)	Following DNR reissuance of the WPDES Permit

Credits will be used by the Village following DNR reissuance of the WPDES Permit. Credits will continue as long as the trading practices are maintained as outlined in this WQT Plan.

VI. Inspection Reporting –

A. Tracking Procedures

The Village will track credits used monthly. The Village will report credit usage to the DNR on a monthly basis in the Discharge Monitoring Reports (DMRs). The annual report will summarize the 12 months of credit usage and credit generation. The Village will report to DNR any concern that they have that may result in a need to modify the trade agreement and/or this trade plan. For example, a need to generate additional credits based on discharge.

B. Inspection

Inspection of the BMPs shall occur during construction phase to ensure they are installed per the design and meet all applicable codes and permits. Once completed, inspections of the established BMPs shall occur each month at a minimum or following heavy rain events. A licensed professional engineer will perform an annual certification to ensure the practice is performing as designed and the Village remains in compliance.

The inspection reports will include:

i. Name and contact information of the inspector
ii. Inspection Date
iii. Relevant standards set forth in the Design Plan or Operation and Maintenance Plan
iv. Issues identified
v. When and how any issues identified were addressed
vi. When and how any issues identified will be addressed in the future

Inspection reports generated during each routine or after rain event inspection will be included with the Annual Water Quality Trading Report submitted by the Village to DNR. Annual inspections by a professional engineer will typically occur in April or May. This time of year is ideal for evaluating the condition of BMPs as it follows the freeze/thaw which poses the greatest potential for changes to the BMPs. Minimal vegetation cover will allow for adequate visual inspection.

C. Management Practice Registration Form

The Village will file a completed registration form 3400-207 for Water Quality Trading Management Practice Registration separately from this Plan.

D. Annual Water Quality Trading Report Submittal

The following shall be submitted to the DNR by January 31 of each year:

i. The number of pollutant reduction credits (lbs./month) used each month of the previous year to demonstrate compliance;
ii. A summary of the annual inspection of the practice that generated any of the pollutant reduction credits used during the previous year, this inspection shall be completed by a licensed Professional Engineer;
iii. All monthly inspection reports;

iv. Identification of noncompliance or failure to implement any terms or conditions of this permit with respect to water quality trading that have not been reported in discharge monitoring reports;
v. A list of all noncompliance and the correction measures and timing to address the issues throughout the year; and
vi. An updated WQT plan if management practices have or will change.

E. Monthly Certification of Management Practices

Each month, the Village will certify that the BMPs are maintained and operating in a manner consistent with this Water Quality Trading Plan or provide a statement noting noncompliance with this Plan. The monthly Discharge Monitoring Report (DMR) will include the following statement as a certification of compliance when the Credit Generating Practice is operating in a manner consistent with the Plan:

> "I certify that to the best of my knowledge that the management practices identified in the approved water quality trading plan as the source of phosphorus credits is installed, established and properly maintained."

F. Notification of Failure to Generate Credits

The Village will notify DNR by telephone call to DNR's regional wastewater compliance engineer within 24 hours or next business day of becoming aware that phosphorus credits used or intended for use by Village are not being generated as outlined in this Water Quality Trading Plan.

The Village will submit a written notification within five days after the Village recognizes that the phosphorus credits are not being generated as outlined in the Trading Plan. DNR may waive the requirement for submittal for a written notice within five days and instruct the Village to submit the written notice with the next regularly scheduled monitoring report required by Village's WPDES Permit.

The written notice will contain a description of how and why the TP credits are not being generated as outlined in the Water Quality Trading Plan, the steps taken or planned to prevent reoccurrence of the identified problems and the length of time anticipated it will take to address the issue.

The Village will work to rectify the problem as laid out in the Operation and Maintenance Plans.

G. Conditions under which Management Practices May Be Inspected

Any DNR authorized officer, employee, or representative has the right to access and inspect the credit generating practice so long as the Village's trade agreement with the property owner(s) and this Water Quality Trading Plan remain in effect.

VII. Certification –

The undersigned hereby certifies that this Water Quality Trading Plan is accurate and correct to the best of his knowledge.

Village of La Farge Wastewater Treatment Facility

By: Wayne Haugrud

Wayne Haugrud
Director of Public Works
Village of La Farge
105 W. Main Street
P.O. Box 37
La Farge, WI 54639
Telephone: (608) 625-2333
Email: waynelaf@mwt.net

Attachment #1

State of WisconsinDepartment of
Natural Resources101 South Webster
Street
Madison WI 53707-7921dnr.wi.gov

Notice of Intent to Conduct Water Quality Trading

Form 3400-206 (1/14)

Notice: Pursuant to s. 283.84, Wis. Stats., and ch. NR 217 Wis. Adm. Code, this form must be completed by any WPDES permittee that is using water quality trading as a method of complying with a permit limitation. Failure to complete this form would not result in penalties. Personal information collected will be used for administrative purposes and may be provided to requesters to the extent required by Wisconsin's Open Records Law (ss. 19.31 - 19.39, Wis. Stats.).

Applicant Information

Permittee Name	Permit Number	Facility Site Number
Village of La Farge	WI- 0024465-11-0	

Facility Address	City	State	ZIP Code
S4459 State HWY 131	La Farge	WI	54639

Project Contact Name (if applicable)	Address	City	State	ZIP Code
Jordan Fure (Delta 3 Eng.)	875 South Chestnut Street	Platteville	WI	53818

Project Name
Proposed 2022 Stream Improvements - Kickapoo River

Receiving Water Name	Parameter(s) being traded	HUC 12(s)
Kickapoo River	Total Phosphorus	070700060307

Is the permittee in a point or nonpoint source dominated watershed? (See PRESTO results - http://dnr.wi.gov/topic/surfacewater/presto.html)
- ○ Point source dominated
- ○ Nonpoint source dominated

Credit Generator Information

Credit generator type (select all that apply):
- ☐ Permitted Discharge (non-MS4/CAFO)
- ☐ Permitted MS4
- ☐ Permitted CAFO
- ☑ Urban nonpoint source discharge
- ☑ Agricultural nonpoint source discharge
- ☐ Other - Specify: _____

Are any of the credit generators in a different HUC 12 than the applicant?
- ○ Yes; HUC 12: _____
- ◉ No
- ○ Unsure

Are any of the credit generators downstream of the applicant?
- ◉ Yes
- ○ No
- ○ Unsure

Will a broker/exchange be used to facilitate trade?
- ○ Yes; Name: _____
- ◉ No
- ○ Unsure

Point to Point Trades (Traditional Municipal / Industrial Discharge, MS4, CAFO)

Discharge Type	Permit Number	Name	Contact Address	Is the point source credit generator currently in compliance with their permit requirements?
○ Traditional ○ MS4 ○ CAFO				○ Yes ○ No ○ Unsure
○ Traditional ○ MS4 ○ CAFO				○ Yes ○ No ○ Unsure
○ Traditional ○ MS4 ○ CAFO				○ Yes ○ No ○ Unsure
○ Traditional ○ MS4 ○ CAFO				○ Yes ○ No ○ Unsure
○ Traditional ○ MS4 ○ CAFO				○ Yes ○ No ○ Unsure

Point to Nonpoint Trades (Non-permitted Agricultural, Non-Permitted Urban, etc.)

List the practices that will be used to generate credits:

Streambank Stabilization

Method for quantifying credits generated:
- ☐ Monitoring
- ☑ Modeling, Names: NRCS Streambank Erosion Estimator
- ☐ Other: _____

Projected date credits will be available:

The preparer certifies all of the following:

- I am familiar with the specifications submitted for this application, and I believe all applicable items in this checklist have been addressed.
- I have completed this document to the best of my knowledge and have not excluded pertinent information.

Signature of Preparer	Date Signed
[signature]	11-7-2022

Authorized Representative Signature

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision. Based on my inquiry of those persons directly responsible for gathering and entering the information, the information is, to the best of my knowledge and belief, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature of Authorized Representative	Date Signed
Wayne Haugrud	11 8 2022

Attachment #2

State of WisconsinDepartment of Natural Resources101 South Webster Street
Madison WI 53707-7921dnr.wi.gov

Water Quality Trading Checklist

Form 3400-208 (1/14)

Notice: Pursuant to s. 283.84, Wis. Stats., this form must be completed by any WPDES permittee that intends to pursue pollutant trading as a method of complying with a permit limitation. Failure to complete this form would not result in penalties. Personal information collected will be used for administrative purposes and may be provided to requesters to the extent required by Wisconsin's Open Records Law (ss. 19.31 - 19.39, Wis. Stats.).

Applicant Information

Permittee Name	Permit Number	Facility Site Number
Village of La Farge	WI- 0024465	

Facility Address	City	State	ZIP Code
S4459 STH 133	La Farge	WI	54639

Project Contact Name (if applicable)	Address	City	State	ZIP Code
Jordan Fure (Delta 3 Eng.)	875 South Chestnut Street	Platteville	WI	53818

Project Name
Proposed 2023 Stream Improvements - Kickapoo River & Bear Creek

Receiving Water Name	Parameter(s) being traded	HUC 12(s)
Kickapoo River	Total Phosphorus	070700060306 & 070700060307

Credit Generator Information

Credit generator type (select all that apply):
- ☐ Permitted Discharge (non-MS4CAFO)
- ☐ Urban nonpoint source discharge
- ☐ Permitted MS4
- ☑ Agricultural nonpoint source discharge
- ☐ Permitted CAFO
- ☐ Other - Specify: _____

Are any of the credit generators in a different HUC 12 than the applicant?
- ○ Yes; HUC 12: _____
- ◉ No

Are any of the credit generators downstream of the applicant?
- ◉ Yes
- ○ No

Will a broker/exchange be used to facilitate trade?
- ○ Yes *(include description and contact information in WQT plan)*
- ◉ No

Point to Point Trades (Traditional Municipal / Industrial, MS4, CAFO)

Are each of the point source credit generators identified in this section in compliance with their WDPES permit requirements?
- ○ Yes
- ○ No

Discharge Type	Permit Number	Name	Contact Information	Trade Agreement Number
○ Traditional ○ MS4 ○ CAFO				
○ Traditional ○ MS4 ○ CAFO				
○ Traditional ○ MS4 ○ CAFO				
○ Traditional ○ MS4 ○ CAFO				
○ Traditional ○ MS4 ○ CAFO				

Point to Point Trades (Traditional Municipal / Industrial, MS4, CAFO) *cont.*

Does plan have a narrative that describes:			Plan Section
a. Summary of discharge and existing treatment including optimization	○ Yes	○ No	
b. Amount of credit being generated	○ Yes	○ No	
c. Timeline for credits and agreements	○ Yes	○ No	
d. Method for quantifying credits	○ Yes	○ No	
e. Tracking and verification procedures	○ Yes	○ No	
f. Location of credit generator in proximity to receiving water and credit user	○ Yes	○ No	
g. Other: _____	○ Yes	○ No	

Point to Nonpoint Trades (Non-Permitted Urban, Agricultural, Other)

Discharge Type	Practices Used to Generate Credits	Method of Quantification	Trade Agreement Number	Have the practice(s) been formally registered?
○ Urban NPS ◉ Agricultural NPS ○ Other	Streambank Stabilization	NRCS Streambank Erosion Estimator		○ Yes ◉ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part
○ Urban NPS ○ Agricultural NPS ○ Other				○ Yes ○ No ○ Only in part

Does plan have a narrative that describes:			Plan Section
a. Description of existing land uses	◉ Yes	○ No	*Section IV*
b. Management practices used to generate credits	◉ Yes	○ No	*Section IV*
c. Amount of credit being generated	◉ Yes	○ No	*Section IV*
d. Description of applicable trade ratio per agreement/management practice	◉ Yes	○ No	*Section IV*
e. Location where credits will be generated	◉ Yes	○ No	*Section III*
f. Timeline for credits and agreements	◉ Yes	○ No	*Section V*
g. Method for quantifying credits	◉ Yes	○ No	*Section IV*

Does plan have a narrative that describes:			Plan Section
h. Tracking procedures	◉ Yes	○ No	Section IV
i. Conditions under which the management practices may be inspected	◉ Yes	○ No	Section VI
j. Reporting requirements should the management practice fail	◉ Yes	○ No	Section VI
k. Operation and maintenance plan for each management practice	◉ Yes	○ No	Section IV
l. Location of credit generator in proximity to receiving water and credit user	◉ Yes	○ No	Section III
m. Practice registration documents, if available	○ Yes	◉ No	
n. History of project site(s)	◉ Yes	○ No	Section IV
o. Other: _____	○ Yes	○ No	

The preparer certifies all of the following:

- I am familiar with the specifications submitted for this application, and I believe all applicable items in this checklist have been addressed.
- I have completed this document to the best of my knowledge and have not excluded pertinent information.
- I certify that the information in this document is true to the best of my knowledge.

Signature of Preparer	Date Signed
Jordan Fine	5-16-2023

Authorized Representative Signature

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision. Based on my inquiry of those persons directly responsible for gathering and entering the information, the information is, to the best of my knowledge and belief, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature of Authorized Representative	Date Signed
Wayne Haugrud	5-16-2023

Attachment #3

Location Map



Legend

- Municipality
- State Boundaries
- County Boundaries
- Major Roads
  - Interstate Highway
  - State Highway
  - US Highway
- County and Local Roads
  - County HWY
  - Local Road
- Railroads
- Tribal Lands
- Index to EN_Image_Basemap_Leaf_Off

Notes

0.3 0 0.13 0.3 Miles

NAD_1983_HARN_Wisconsin_TM

1: 7,920


DISCLAIMER: The information shown on these maps has been obtained from various sources, and are of varying age, reliability and resolution. These maps are not intended to be used for navigation, nor are these maps an authoritative source of information about legal land ownership or public access. No warranty, expressed or implied, is made regarding accuracy, applicability for a particular use, completeness, or legality of the information depicted on this map. For more information, see the DNR Legal Notices web page: http://dnr.wi.gov/legal/

Attachment #4

Sanitary Sewer System Map

Village of La Farge

La Farge, Wisconsin

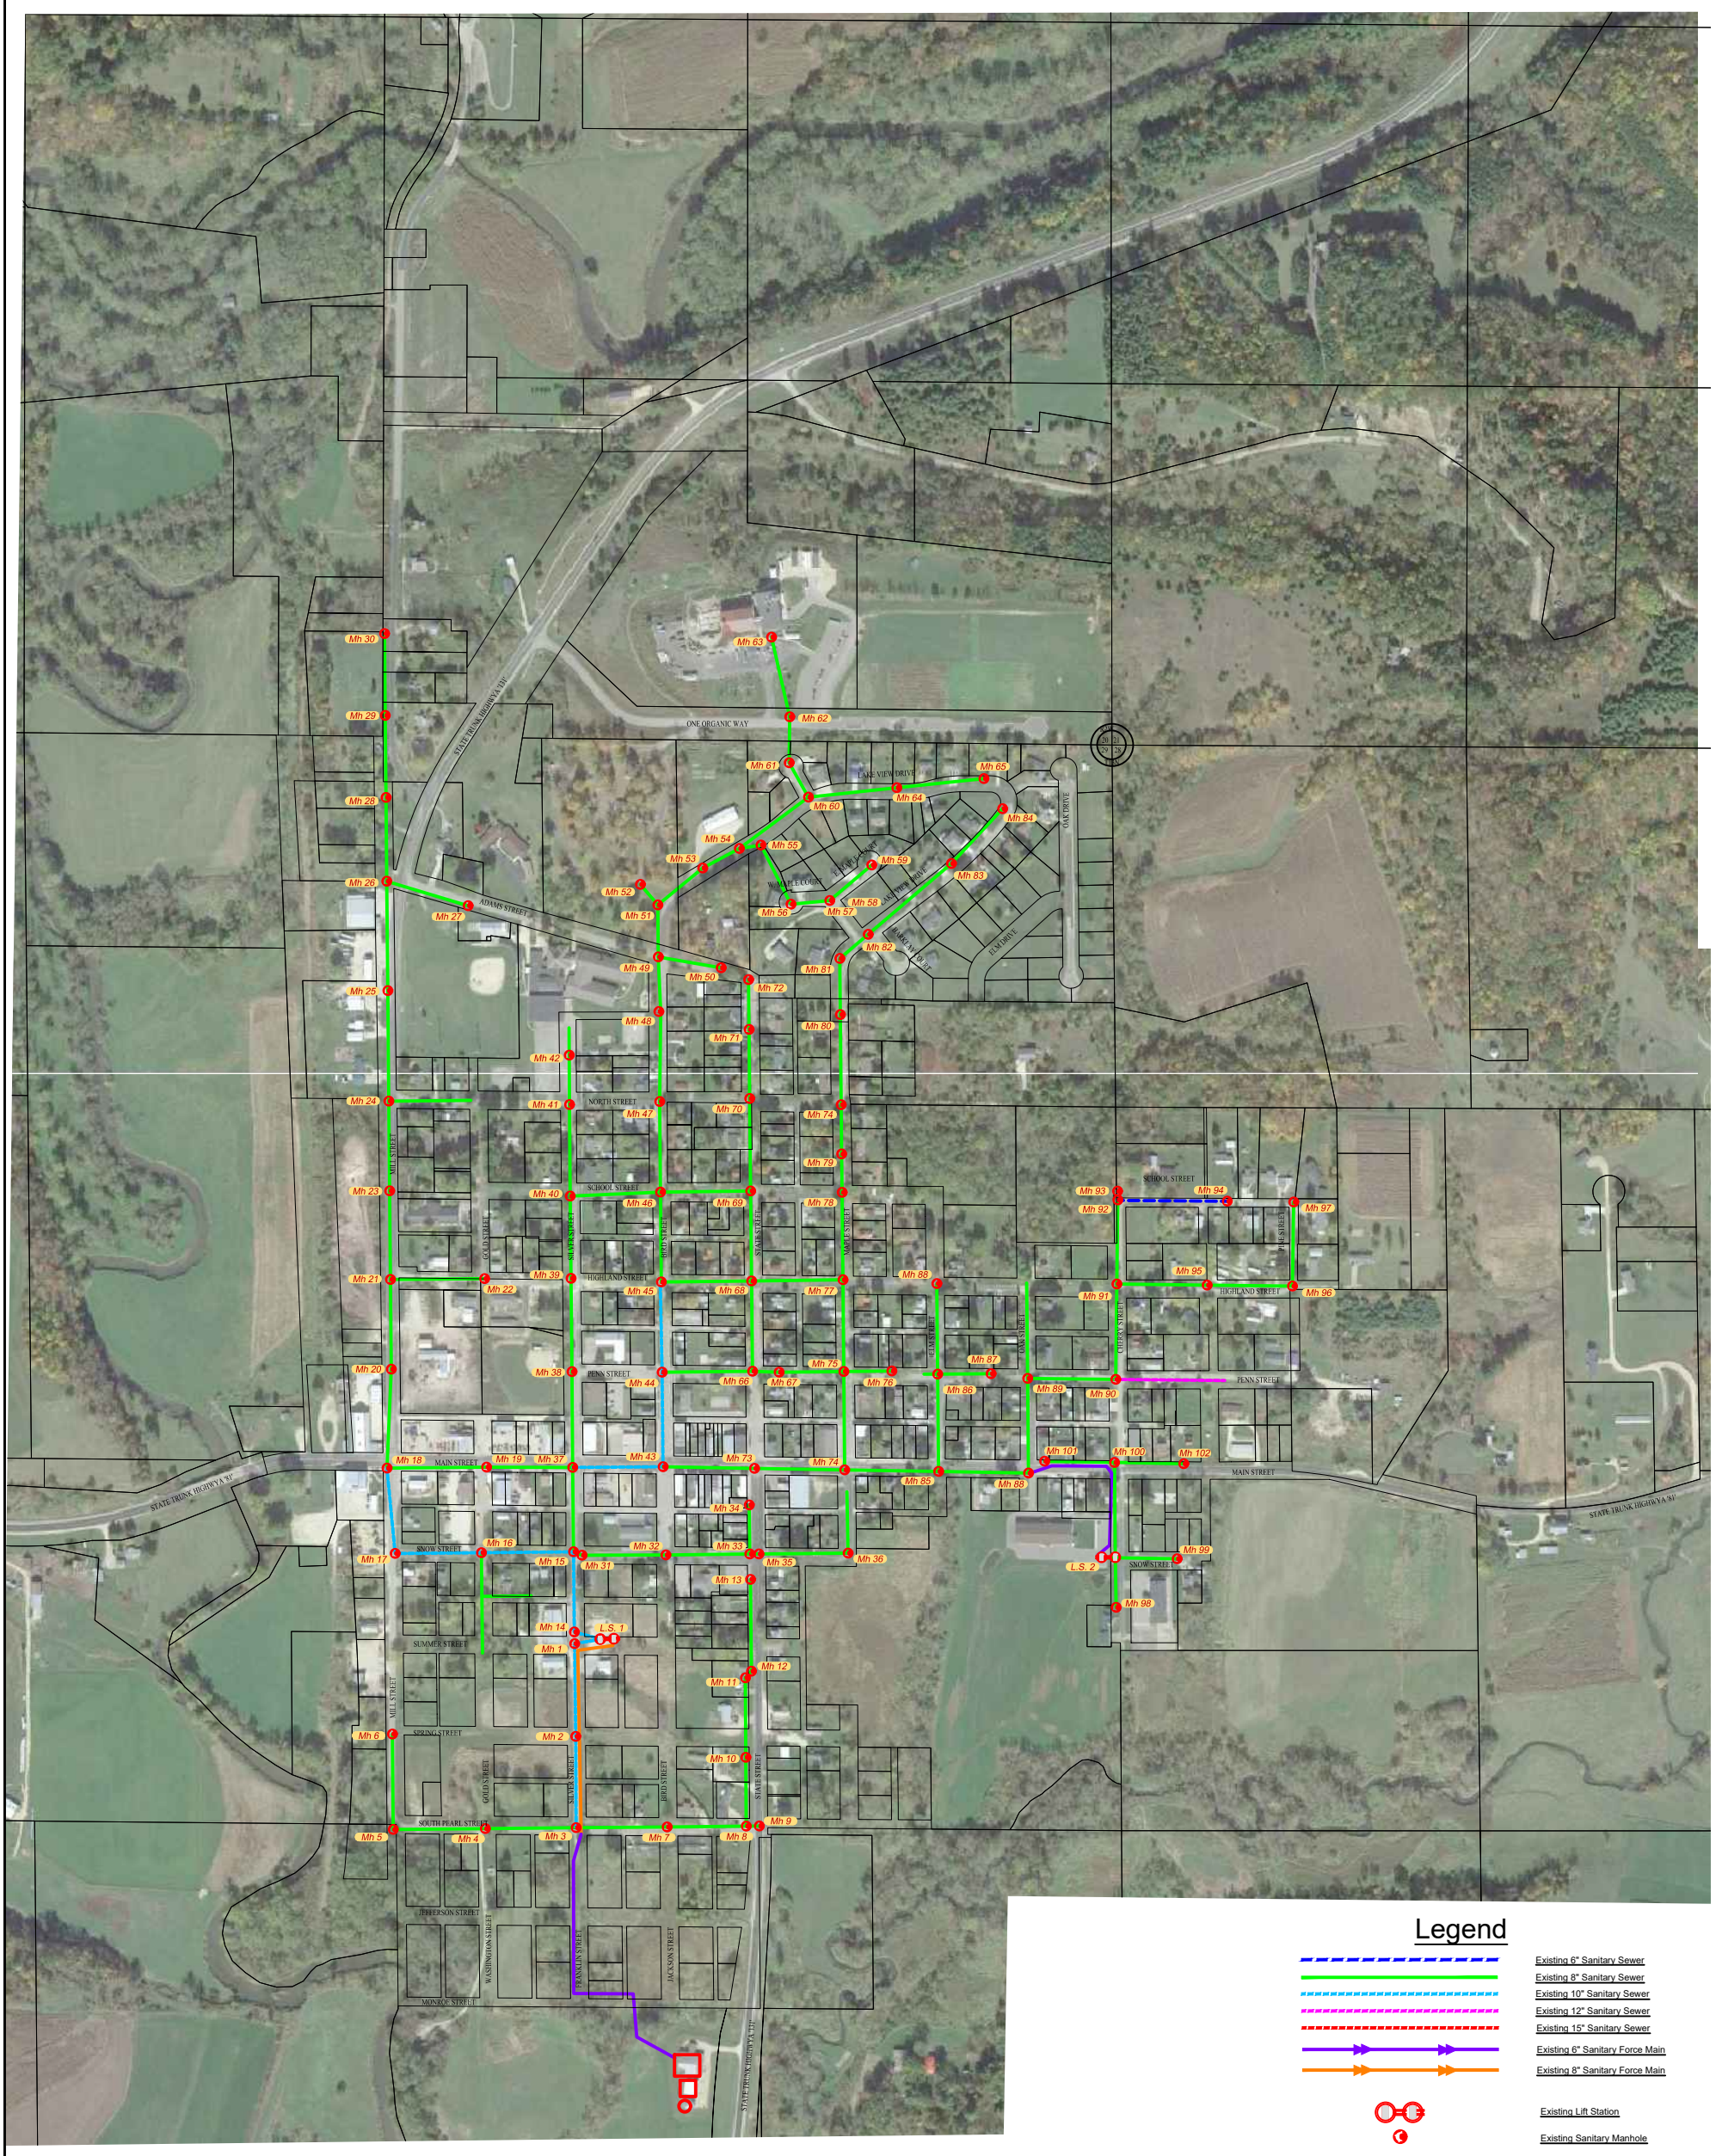

Legend

- Existing 6" Sanitary Sewer
- Existing 8" Sanitary Sewer
- Existing 10" Sanitary Sewer
- Existing 12" Sanitary Sewer
- Existing 15" Sanitary Sewer
- Existing 6" Sanitary Force Main
- Existing 8" Sanitary Force Main
- Existing Lift Station
- Existing Sanitary Manhole

0 300 600

Drawn by: C.Coyier
Date: April 9, 2020
Revised by: M.Digman
Date: April 13, 2022

DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING • ARCHITECTURE
GRANT WRITING • LAND DEVELOPMENT • PLANNING & CADD SERVICES
875 SOUTH CHESTNUT STREET PLATTEVILLE, WISCONSIN 53818 PHONE: (608) 348-5355
898 JACKSON STREET DUBUQUE, IOWA 52001 PHONE: (563) 542-9005

G:\Projects\LaFarge\Maps\Utilities_SanitaryS.dwg

Attachment #5


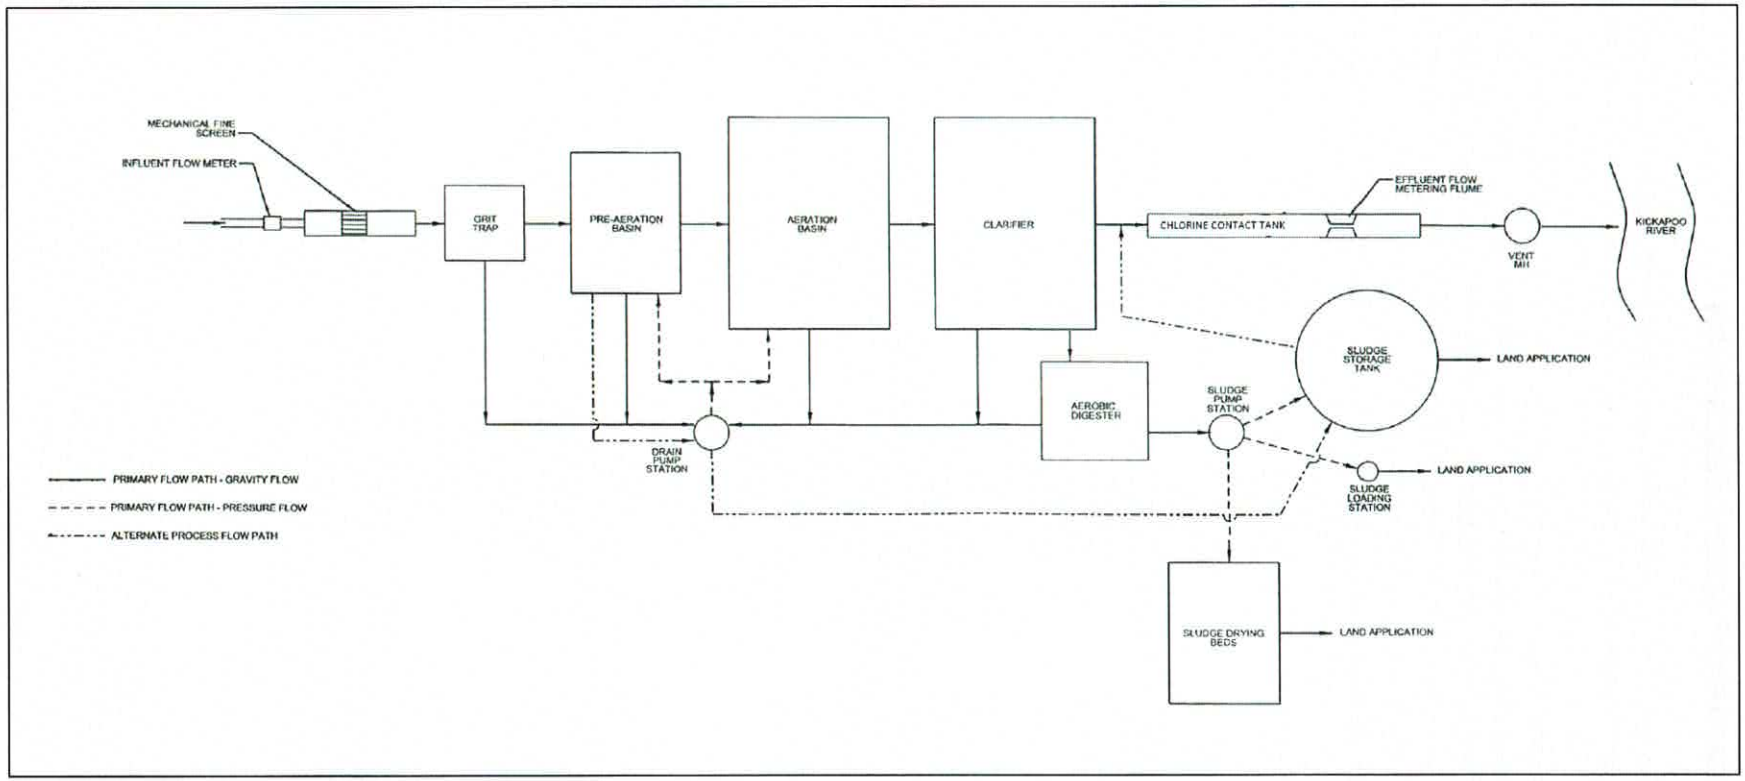


Figure 1-2: Wastewater Treatment Facility Flow Schematic

© August 2016 MSA Professional Services, Inc.

Attachment #6

HUC-12 Watershed Map

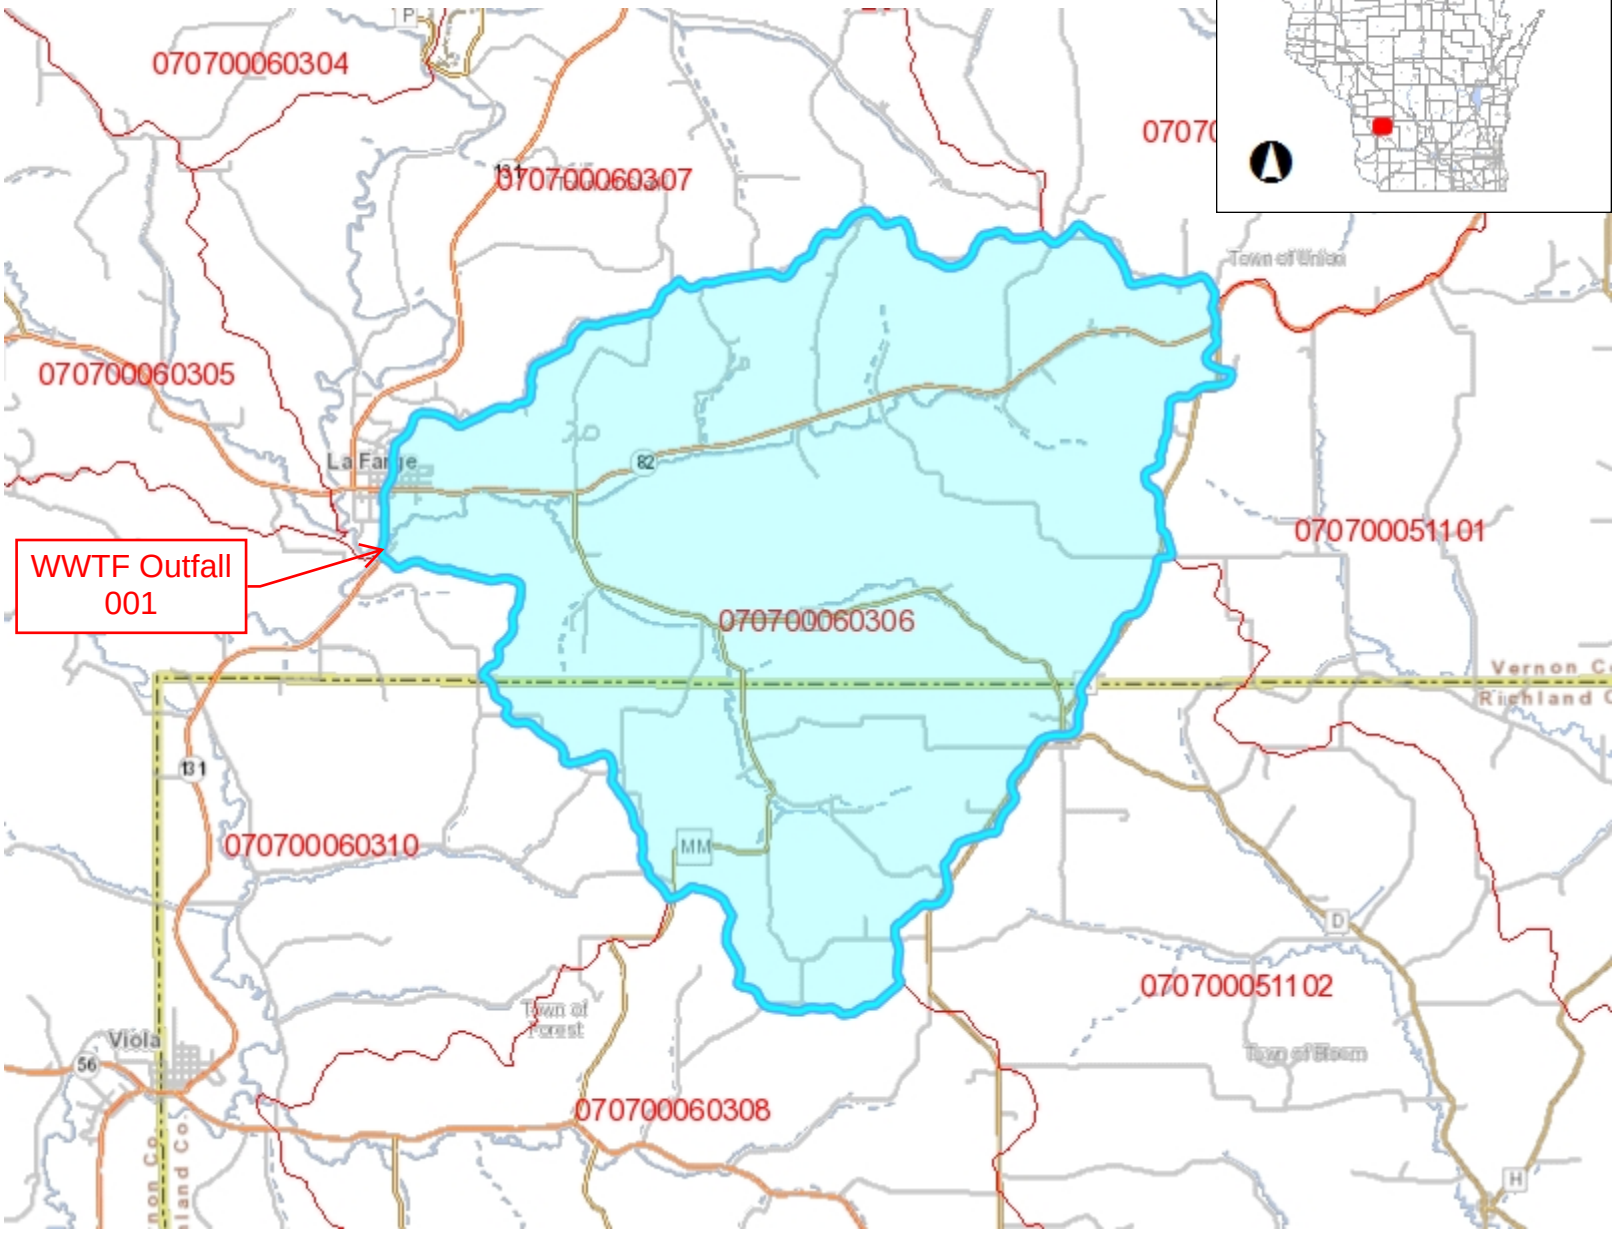

Legend

- 12-digit HUCs (Subwatersheds)
- Municipality
- State Boundaries
- County Boundaries
- Major Roads
  - Interstate Highway
  - State Highway
  - US Highway
- County and Local Roads
  - County HWY
  - Local Road
- Railroads
- Tribal Lands
- Rivers and Streams
- Intermittent Streams
- Lakes and Open water

Notes


3.0 0 1.50 3.0 Miles

NAD_1983_HARN_Wisconsin_TM

1: 95,040

DISCLAIMER: The information shown on these maps has been obtained from various sources, and are of varying age, reliability and resolution. These maps are not intended to be used for navigation, nor are these maps an authoritative source of information about legal land ownership or public access. No warranty, expressed or implied, is made regarding accuracy, applicability for a particular use, completeness, or legality of the information depicted on this map. For more information, see the DNR Legal Notices web page: http://dnr.wi.gov/legal/

HUC-12 Watershed Map

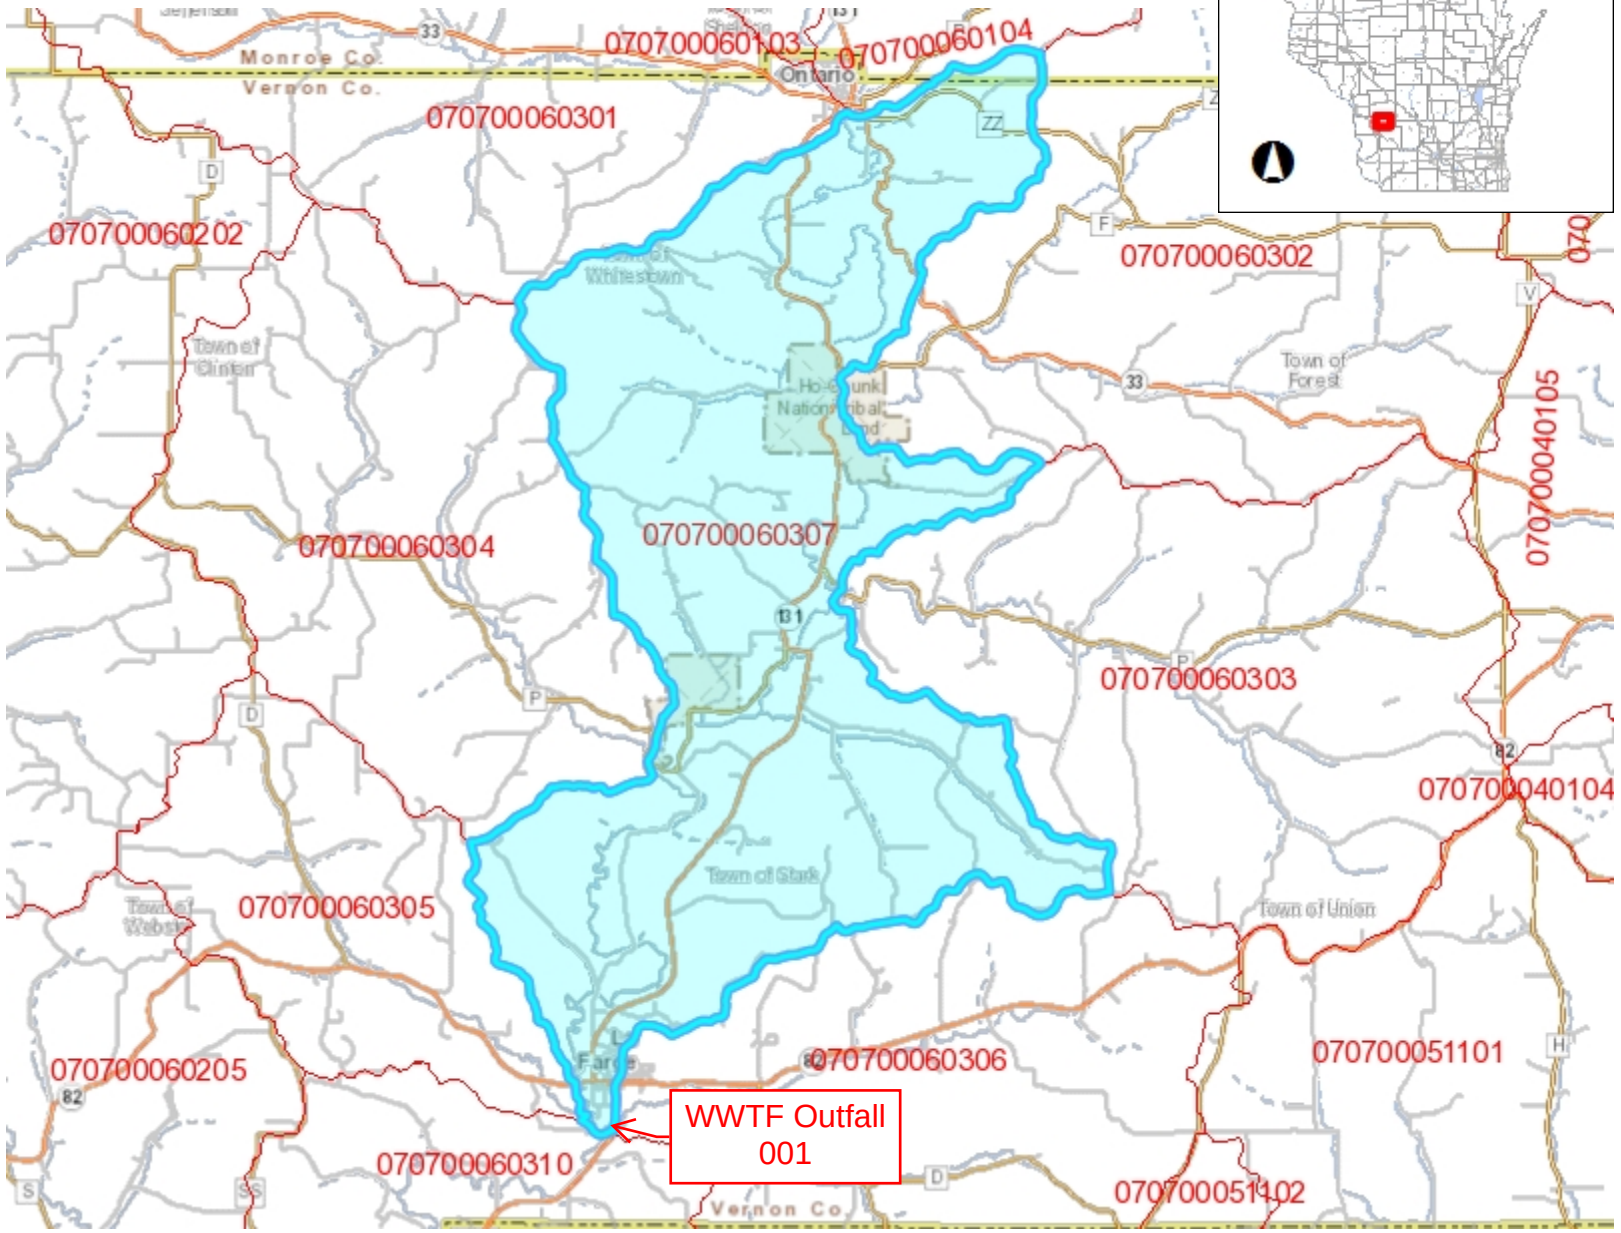

Legend

- 12-digit HUCs (Subwatersheds)
- Municipality
- State Boundaries
- County Boundaries
- Major Roads
  - Interstate Highway
  - State Highway
  - US Highway
- County and Local Roads
  - County HWY
  - Local Road
- Railroads
- Tribal Lands
- Rivers and Streams
- Intermittent Streams
- Lakes and Open water

Notes

Village of La Farge

4.0 0 2.00 4.0 Miles

NAD_1983_HARN_Wisconsin_TM

1: 126,720

DISCLAIMER: The information shown on these maps has been obtained from various sources, and are of varying age, reliability and resolution. These maps are not intended to be used for navigation, nor are these maps an authoritative source of information about legal land ownership or public access. No warranty, expressed or implied, is made regarding accuracy, applicability for a particular use, completeness, or legality of the information depicted on this map. For more information, see the DNR Legal Notices web page: http://dnr.wi.gov/legal/

Attachment #7

Wetland Map



Legend

- Wetland Indicators
- Wetland Class Areas
- Wetland Class Points
  - Dammed pond
  - Excavated pond
  - Filled/drained wetland
  - Wetland too small to delineate
  - Filled excavated pond
- Filled Points
- Wetland Class Areas
- Filled Areas
- Wetland Class Areas
- Wetland Class Points
  - Dammed pond
  - Excavated pond
  - Filled/drained wetland
  - Wetland too small to delineate
  - Filled excavated pond
- Filled Points
- Wetland Class Areas
- Filled Areas
- Wetland Identifications and Confirmations
- NRCS Wetspots
- Municipality
- State Boundaries
- County Boundaries
- Major Roads
  - Interstate Highway
  - State Highway
  - US Highway
- County and Local Roads
  - County HWY
  - Local Road

Notes

0.3 0 0.13 0.3 Miles


NAD_1983_HARN_Wisconsin_TM

1: 7,920

DISCLAIMER: The information shown on these maps has been obtained from various sources, and are of varying age, reliability and resolution. These maps are not intended to be used for navigation, nor are these maps an authoritative source of information about legal land ownership or public access. No warranty, expressed or implied, is made regarding accuracy, applicability for a particular use, completeness, or legality of the information depicted on this map. For more information, see the DNR Legal Notices web page: http://dnr.wi.gov/legal/

Attachment #8

Soil Map—Vernon County, Wisconsin

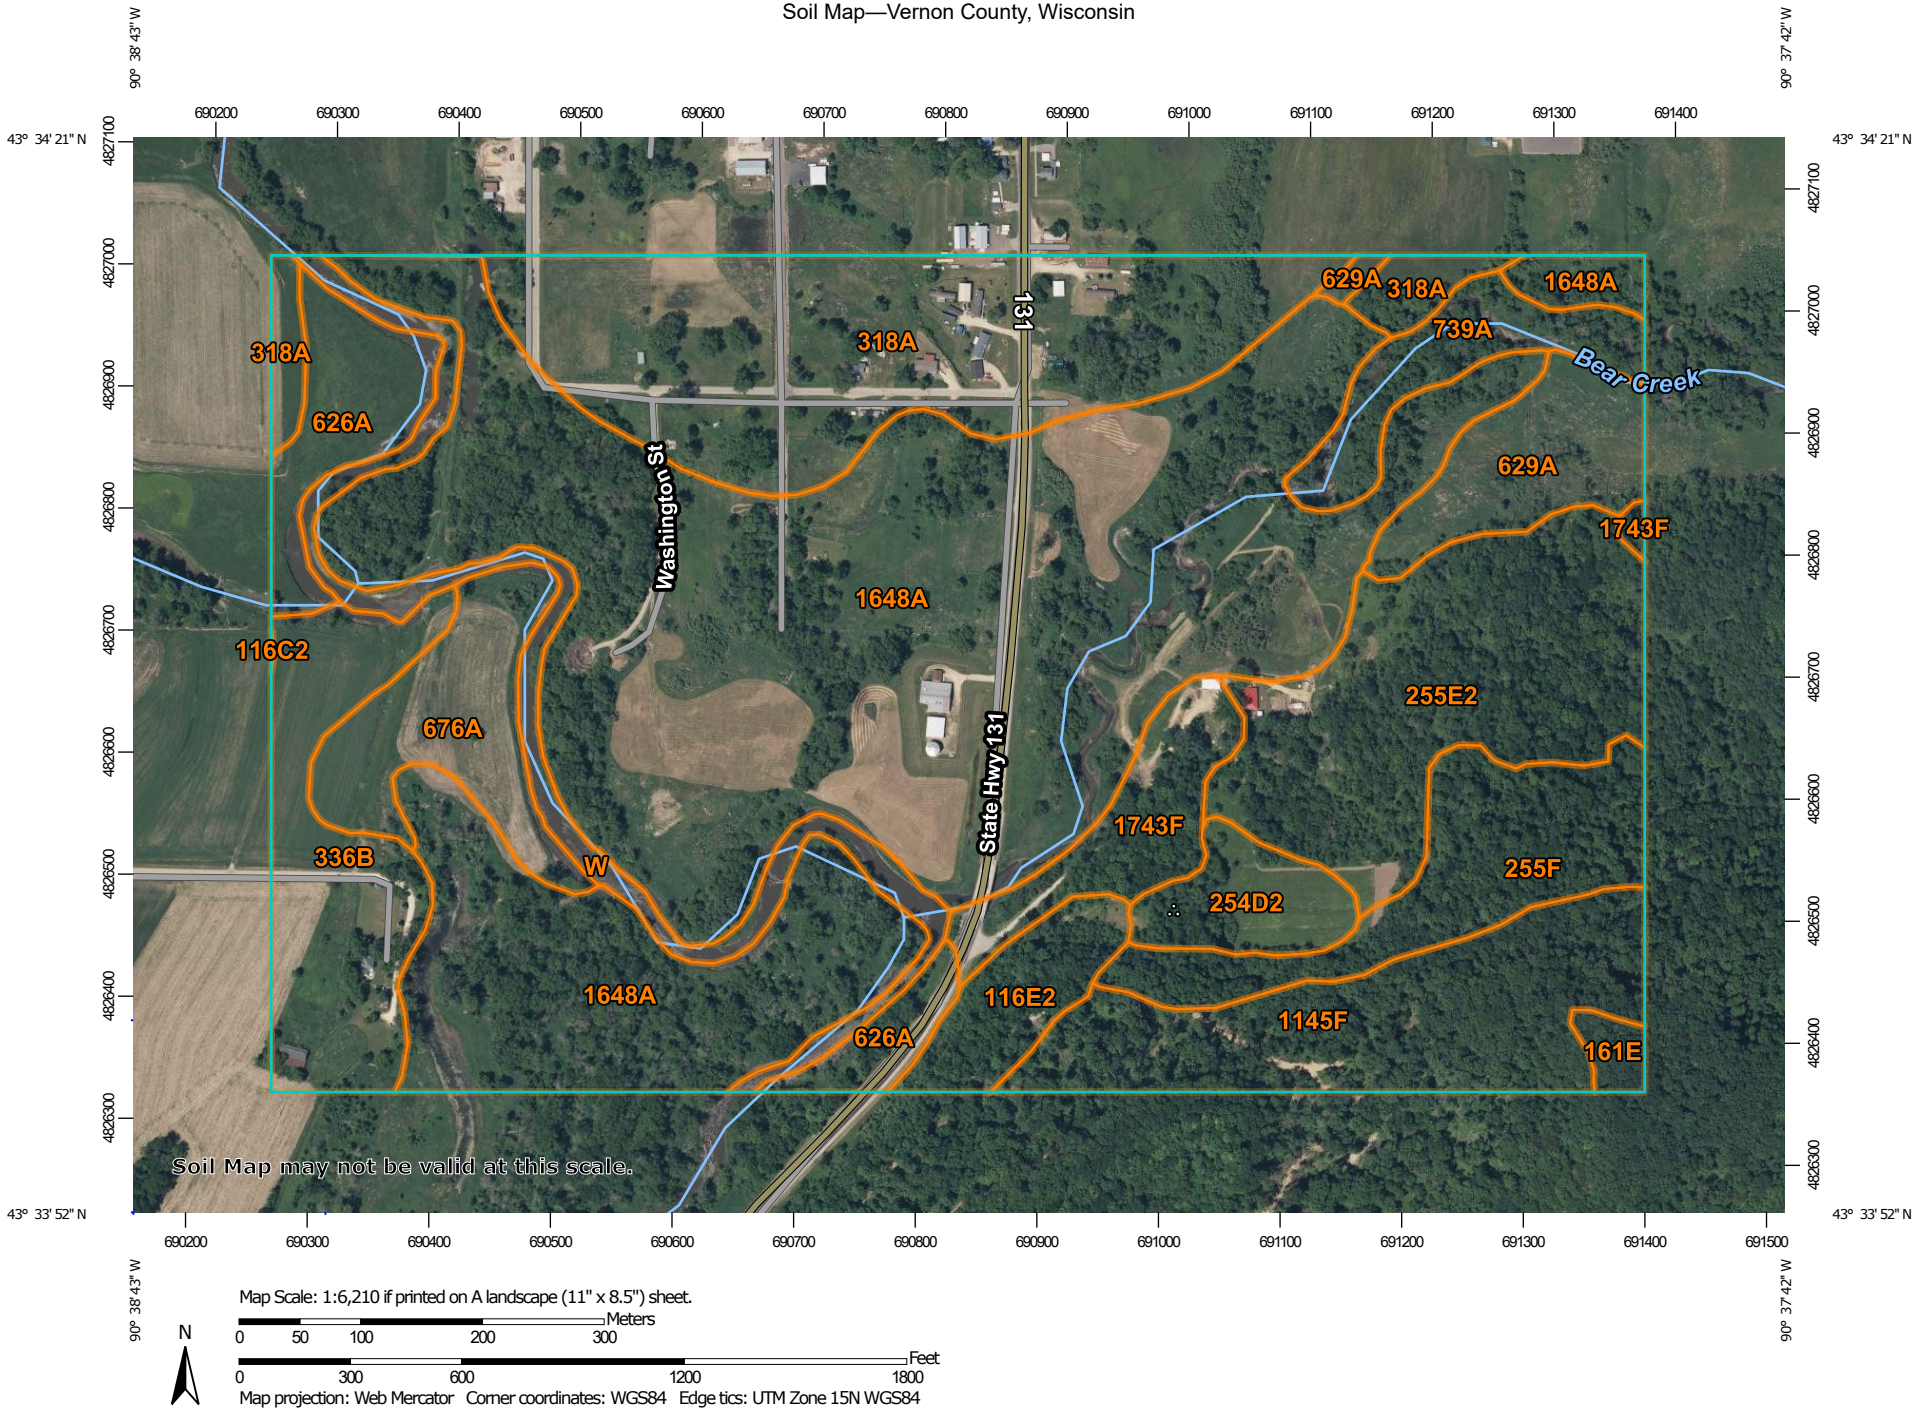

Map Scale: 1:6,210 if printed on A landscape (11" x 8.5") sheet.

N

Meters: 0 50 100 200 300

Feet: 0 300 600 1200 1800

Map projection: Web Mercator Corner coordinates: WGS84 Edge tics: UTM Zone 15N WGS84

MAP LEGEND

Area of Interest (AOI)
- Area of Interest (AOI)

Soils
- Soil Map Unit Polygons
- Soil Map Unit Lines
- Soil Map Unit Points

Special Point Features
- Blowout
- Borrow Pit
- Clay Spot
- Closed Depression
- Gravel Pit
- Gravelly Spot
- Landfill
- Lava Flow
- Marsh or swamp
- Mine or Quarry
- Miscellaneous Water
- Perennial Water
- Rock Outcrop
- Saline Spot
- Sandy Spot
- Severely Eroded Spot
- Sinkhole
- Slide or Slip
- Sodic Spot
- Spoil Area
- Stony Spot
- Very Stony Spot
- Wet Spot
- Other
- Special Line Features

Water Features
- Streams and Canals

Transportation
- Rails
- Interstate Highways
- US Routes
- Major Roads
- Local Roads

Background
- Aerial Photography

MAP INFORMATION

The soil surveys that comprise your AOI were mapped at 1:12,000.

Warning: Soil Map may not be valid at this scale.

Enlargement of maps beyond the scale of mapping can cause misunderstanding of the detail of mapping and accuracy of soil line placement. The maps do not show the small areas of contrasting soils that could have been shown at a more detailed scale.

Please rely on the bar scale on each map sheet for map measurements.

Source of Map: Natural Resources Conservation Service
Web Soil Survey URL:
Coordinate System: Web Mercator (EPSG:3857)

Maps from the Web Soil Survey are based on the Web Mercator projection, which preserves direction and shape but distorts distance and area. A projection that preserves area, such as the Albers equal-area conic projection, should be used if more accurate calculations of distance or area are required.

This product is generated from the USDA-NRCS certified data as of the version date(s) listed below.

Soil Survey Area: Vernon County, Wisconsin
Survey Area Data: Version 17, Sep 6, 2022

Soil map units are labeled (as space allows) for map scales 1:50,000 or larger.

Date(s) aerial images were photographed: Apr 1, 2020—Oct 1, 2020

The orthophoto or other base map on which the soil lines were compiled and digitized probably differs from the background imagery displayed on these maps. As a result, some minor shifting of map unit boundaries may be evident.

Map Unit Legend

Map Unit Symbol	Map Unit Name	Acres in AOI	Percent of AOI
116C2	Churchtown silt loam, 6 to 12 percent slopes, moderately eroded	0.0	0.0%
116E2	Churchtown silt loam, 20 to 30 percent slopes, moderately eroded	3.6	1.9%
161E	Fivepoints silt loam, 20 to 30 percent slopes, moderately eroded	0.7	0.4%
254D2	Norden silt loam, 12 to 20 percent slopes, moderately eroded	3.3	1.7%
255E2	Urne fine sandy loam, 20 to 30 percent slopes, moderately eroded	16.2	8.4%
255F	Urne fine sandy loam, 30 to 45 percent slopes	8.4	4.4%
318A	Bearpen silt loam, 0 to 3 percent slopes, rarely flooded	24.7	12.9%
336B	Toddville silt loam, 1 to 6 percent slopes	9.5	4.9%
626A	Arenzville silt loam, 0 to 3 percent slopes, occasionally flooded	6.1	3.2%
629A	Ettrick silt loam, 0 to 2 percent slopes, frequently flooded	5.5	2.9%
676A	Kickapoo fine sandy loam, 0 to 3 percent slopes, occasionally flooded	6.6	3.4%
739A	Root loam, 0 to 2 percent slopes, frequently flooded	4.3	2.2%
1145F	Gaphill-Rockbluff complex, 30 to 60 percent slopes	12.5	6.5%
1648A	Northbend-Ettrick silt loams, 0 to 3 percent slopes, frequently flooded	79.8	41.5%
1743F	Council-Elevasil-Norden complex, 20 to 45 percent slopes, rocky	4.8	2.5%
W	Water	5.9	3.1%
Totals for Area of Interest		**192.1**	**100.0%**

ROCK RIVER LABORATORY, INC.
AGRICULTURAL ANALYSIS

710 Commerce Drive
PO Box 169
Watertown, WI 53094

920-261-0446 phone
920-261-1365 fax
www.rockriverlab.com

Insight FS Darlington, WI - Total Phosphorus Analysis 12/09/2022

Field ID	Sample ID	Total P (ppm)
Lafarge 1E	1	344.2
Lafarge 1E	5	337.2
Lafarge 1E	9	605
Lafarge 1E	13	444.6
Lafarge 1E	17	502.1
Lafarge 1E	21	482.8
Creek	34N	337.5
Creek	38N	592.9
Creek	42N	386.5
Creek	36S	294.8
Creek	40S	314.3
Creek	43	251.4


Reach 2

Reach 1

Reach 3

Field ID	Sample ID	Total P (ppm)
Latarge WQT	26N	802.9
Latarge WQT	28N	373.7
Latarge WQT	30N	406.8
Latarge WQT	32N	532
Lafarge 1 E	25	754.4
Lafarge 1W	3	325.2
Lafarge 1W	7	510.3
Lafarge 1W	15	364.2
Lafarge 1W	11	429.4
Lafarge 1W	23	74.6
Lafarge 1W	19	760.7

Soil Total P

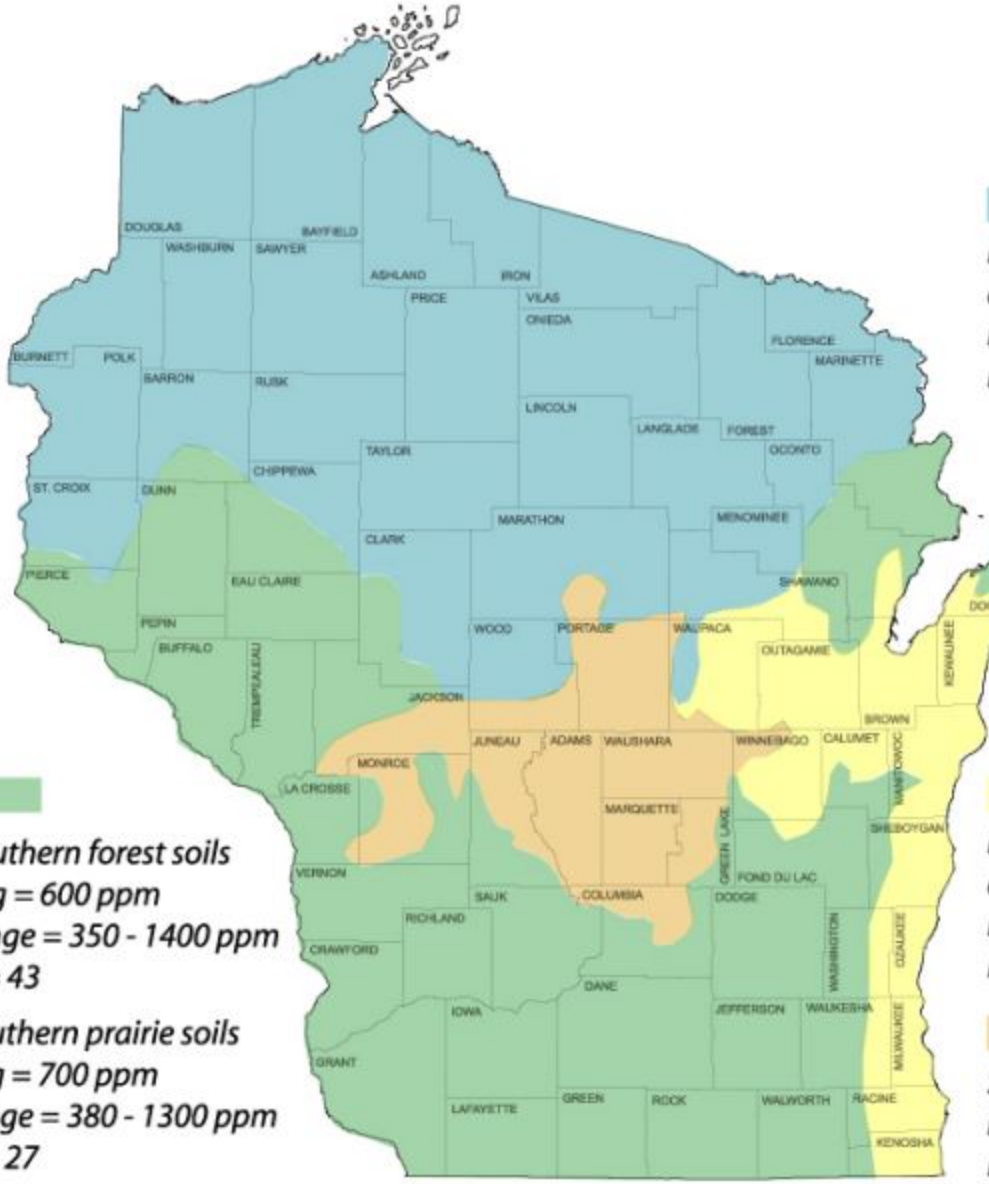

Northern loamy soils
avg = 540 ppm
range = 480-580 ppm
n = 4

Southern forest soils
avg = 600 ppm
range = 350 - 1400 ppm
n = 43

Southern prairie soils
avg = 700 ppm
range = 380 - 1300 ppm
n = 27

Eastern red soils
avg = 950 ppm
range = 430 - 2820 ppm
n = 12

Sandy soils
range = 250 - 400 ppm
n = 2

Organic soils: range = 1330 - 1350 ppm, n = 2

Attachment #9

Photo	Station Number
1	104+00
2	107+25
3	107+50
4	115+25
5	117+75
6	119+75
7	127+50
8	133+50
9	135+75
10	136+75
11	203+50
12	204+00
13	205+00
14	207+25
15	206+00
16	206+75

ATTACHEMENT #9
TABLE OF CONTENTS

I. Introduction 1

II. Reach 1 1

III. Reach 2 5

III. Reach 3 7

I. Introduction

The lateral recession rate of the eroding bank is a critical component for the NRCS Streambank Erosion Estimator. The following documentation provides the justification for the lateral recession rates used in the NRCS Streambank Erosin Estimator. Lateral recession rate was estimated based on the photos provided, description, and on site evaluation. The following includes representative photos of the Project Extents to be stabilized through installation of Best Management Practices (BMPs).

II. Reach 1



Image 1 – Severe undercut with slump, vegetative overhang, bare soil visible, and fallen trees.



Image 2 – Severe undercut with slump, vegetative overhang, bare soil visible, and fallen trees.



Image 3 – Severe undercut with slump, vegetative overhang, bare soil visible, and fallen trees.



Image 4 – Severe undercut with slump, vegetative overhang, bare soil visible, and slumped trees.



Image 5 – Severe undercut with slump, vegetative overhang, bare soil visible, and fallen trees.



Image 6 – Severe undercut with slump, vegetative overhang, bare soil visible, exposed tree roots, and slumped trees.



Image 7 – Severe undercut with slump, vegetative overhang, bare soil visible, and fallen trees.

Reach 2



Image 8 – Near vertical banks with bare soil and vegetative overhang.



Image 9 – Near vertical banks with bare soil, vegetative overhang, slumped trees, and fallen trees.



Image 10 – Severe undercut with vegetative overhang. Note that the grass overhang is hiding some of the eroded bank. Severe scarp areas are visible as noted.

III. Reach 3



Image 11 – Near vertical banks with bare soil, vegetative overhang, slumped trees, and fallen trees.



Image 12 – Severe undercut with slump and vegetative overhang.



Image 13 – Severe undercut with slump, vegetative overhang, bare soil visible, and slumped trees.



Image 14 – Severe undercut with slump and vegetative overhang.



Image 15 – Severe undercut with slump, vegetative overhang, and fallen trees.



Image 16 – Severe undercut with slump and vegetative overhang.

Attachment #10

NRCS Excel Workbook Estimating 'Other' Erosion Types June 2006

Annual soil loss predictions for conservation planning purposes are made with current soil loss prediction technology (RUSLE2). RUSLE2 estimates sheet, rill and interrill erosion. Erosion that is seasonal in nature and caused by concentrated flow, however, is not predicted by RUSLE2.

This workbook provides conservation planners with simple tools and processes to help estimate the amount of erosion occurring in ephemeral gullies, classic gullies and on streambank erosion sites.

Definitions:

Rill Erosion: consists of the removal of soil by concentrated water running through little streamlets, or headcuts. Detachment in a rill occurs if the sediment in the flow is below the amount the load can transport and if the flow exceeds the soil's resistance to detachment. As detachment continues or flow increases, rills will become wider and deeper. Rills may be of any size but are usually less than four inches deep. Rills are:

<> generally parallel on the slope, but may converge,
<> generally of uniform spacing and dimension,
<> generally appear at different locations on the landscape from year to year,
<> generally shorter than ephemeral cropland gullies,
<> usually end at a concentrated flow channel, or an area where the slope flattens and deposition occurs,
<> are on the same portion of the slope that is used to determine the length of slope (L) for RUSLE2,
<> many small, but conspicuous channels running in the direction of slope gradient

Rill erosion is considered in the RUSLE2 calculations.

Ephemeral Gully Erosion: Small erosion channels formed on crop fields as a result of concentrated flow of runoff water. These channels are routinely eliminated by tillage of the field but return following subsequent runoff events. Ephemeral Gullies are small enough to be eliminated (temporarily) with the use of typical farm tillage equipment and they:

<> recur in the same area of concentrated flow each time they form,
<> frequently form in well-defined depressions in natural drainage ways,
<> are generally wider, deeper, and longer than the rills in the field,

Ephemeral Gullies are **not** calculated by the RUSLE2 program.

Gully Erosion: Permanent gullies are formed when channel development has progressed to the point where the gully is too wide and too deep to be tilled across. These channels carry large amounts of water after rains and deposit eroded material at the foot of the gully. They disfigure landscape and make the land unfit for growing crops. Gullies:

<> may grow or enlarge from year to year by head cutting and lateral enlarging,
<> often occur in depressions or natural drainage ways,
<> may begin as ephemeral gullies that were left in the field untreated,
<> may, over time, become partially stabilized by grass, weeds or woody vegetation,

Gully erosion is not calculated by the RUSLE2 program.

Streambank Erosion: The wearing away of streambanks by flowing water. The removal of soil from streambanks is typically caused by the direct action of stream flow and/or wind/wave action, typically occurring during periods of high flow. Streambank erosion:

<> is a natural process that generally increases when unprotected streambanks (e.g. no woody vegetation) are subject to the actions of flowing water and ice damage.

<> is a common occurrence on many Vermont river channels that are experiencing geomorphic adjustments

---

The soil loss from ephemeral gullies, gullies and streambank erosion areas can be estimated by calculating the volume of soil removed by erosion processes. The volume of soil loss can be multiplied by the typical unit weight of the soil (based on soil texture) which is eroded. Approximate soil unit weights are expressed below[1]:

Soil Texture	Estimated Dry Density lb/ft^3
Gravel	110
Sand	105
Loamy Sand	100
Sandy Loam	100
Fine Sandy Loam	100
Sandy Clay Loam	90
Silt Loam	85
Silty Clay Loam	85
Silty Clay	85
Clay Loam	85
Organic	22

Procedure for estimating Ephemeral Soil Erosion:

The following formula will be used to calculate annual estimated ephemeral gully erosion:

$$\frac{\text{Ephemeral Gully } \mathbf{Length} \times \text{Gully Average } \mathbf{Width} \times \text{Gully Average } \mathbf{Depth}}{2000} \times \text{Soil Weight (lbs/ft}^3\text{)} \times \text{Occurrences per Year} = \mathbf{Estimated} \text{ Soil Loss (Tons per Year)}$$

***** Ephemeral gully erosion may reform multiple times per year, and under certain conditions it may not form in a given year. The voided volume which would be calculated after a runoff event is not necessarily representative of an annual rate, but is representative of only the specific event. This erosion can be calculated for individual storms and can be summed for a yearly estimate.

1 Data from published soil surveys, laboratory data, and soil interpretation record are to be used where available. Parent materials, soil consistency, soil structure, pore space, soil texture, and coarse fragments all influence unit weight.

Procedure for estimating Gully Soil Erosion:

The following formula will be used to calculate annual estimated classic gully erosion:


$$\frac{\text{Gully } \textbf{Length} \text{ X (Average } \textbf{Width} \text{ X Average } \textbf{Depth} \text{ X 0.5) X } \textbf{Soil Weight} \text{ (lbs/ft3)}}{2000} \; / \; \text{Formation Years} = \textbf{Estimated} \text{ Soil Loss Per Year (Tons)}$$

Procedure for estimating Streambank Soil Erosion (Direct Volume Method):

The following formula will be used to calculate annual estimated streambank erosion unless a field measurement procedure[2] is used:

$$\frac{\text{ing Bank } \textbf{Length} \text{ X Eroding Bank Height X Lateral Recession Rate (FT/YR) X Soil Weight (lb}}{2000} = \textbf{Estimated} \text{ Soil Loss Per Year (Tons)}$$

** Eroding bank height is measured along the bank, not the vertical height of bank. Example: if vertical height of an eroding streambank is 5 feet, and the bank is on a 2:1 slope, the total eroding bank distance is 25 feet -- 1/2 (Base X Height).

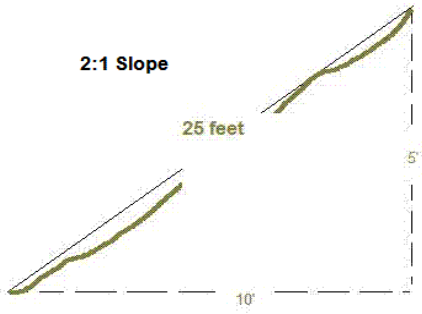

***The average annual recession rate is the thickness of soil eroded from a bank surface (perpendicular to the face) in an average year.

Stream bank erosion sometimes presents itself as a major occurance in a given year, whereas the same bank may not erode significantly for a period of years if no major runoff events occur. Recession rates need to be calculated as an average of years when erosion does and does not occur. Recession rate is not calculated as the erosion occurring after a single event.

Use available resources to assist in the estimation of recession rate: use past and present aerial photography, old survey records, and any other information that helps to determine the bank condition at known times in the past. When such information is lacking or insufficient, field observations and professional judgement are needed to estimate recession rates.
It is often not possible to directly measure recession rates in the field. Therefore, the following table has been included which relates recession rates to narrative descriptions of banks eroding at different rates (Table from NRCS Wisconsin guidance).

Lateral Recession Rate (ft/yr)	Category	Description
0.01-0.05	Slight	Some bare bank but active erosion not readily apparent. Some rills but no vegetative overhang. No exposed tree roots.
0.06-0.2	Moderate	Bank is predominantly bare with some rills and vegetative overhang. Some exposed tree roots but no slumps or slips.
0.3-0.5	Severe	Bank is bare with rills and severe vegetative overhang. Many exposed tree roots and some fallen trees and slumps or slips. Some changes in cultural features such as fence corners missing and realignment of roads or trails. Channel cross section becomes U-shaped as opposed to V-shaped.
0.5+	Very Severe	Bank is bare with gullies and severe vegetative overhang. Many fallen trees, drains and culverts eroding out and changes in cultural features as above. Massive slips or washouts common. Channel cross section is U-shaped and stream course may be meandering.

2 The best way to quantify streambank erosion is to measure it directly in the field. The basic procedure in measuring streambank erosion is to survey, flag, or in some way fix a “before" image of the channel you are evaluating in order to establish the baseline condition. Changes due to erosion can then be monitored over time by going back to the study area and re-measuring from the fixed reference points.
Channel cross-sections can be surveyed and plotted on a periodic basis to monitor change. Stakes or pins can be driven into channel banks flush with the surface. The amount of stake or pin exposed due to erosion is the amount of change at the streambank erosion site between your times of observation.
The time required to monitor a site often precludes this method of data collection. The Direct Volume Method can be used to estimate streambank erosion at your site.

Acknowledgements: This Excel workbook was created as a planning tool for use by conservation planners. The basic format and content of the tool is a compilation of various similar tools, processes and procedures employed by NRCS in several states including: Indiana, Iowa, Kansas, Maryland, Michigan, Missouri, Nebraska, Oklahoma, South Dakota and Wisconsin. Some of the terminology in the 'Definitions' section of this Readme document closely mirrors these sources.

NRCS Streambank and Irrigation Ditch Erosion Estimator (Direct Volume Method)

Farmer / Cooperator Name:	Village of La Farge	Evaluated By:	J. Fure
Tract Number:	Varies	Evaluation Date:	March 25, 2024

Field Number	*Eroding Strmbnk Reach #; or Ditch Side/Bottom*	*Eroding Bank or Ditch Length (Feet)*	*Eroding Bank Height; or Ditch Bottom Width* (Feet)*	*Area of Eroding Strmbank or Ditch (FT^2)*	*Lateral or Ditch Bottom Recession Rate (Estimated) (FT / Year)*	*Estimated Volume (FT^3) Eroded Annually*	*Soil Texture*	*Approximate Pounds of Soil per FT^3*	*Estimated Soil Loss (Tons/Year)*	*Soil Total Phosphorus (ppm)*	*Estimated Phosphorus Loss (Pounds/Year)*
Village Property	1.1 (Left)	450	12.15	5,468	0.40	2,187.0	Silt Loam	85	92.9	340.70	63
	1.2 (Left)	250	12.20	3,050	0.40	1,220.0	Silt Loam	85	51.9	444.60	46
	1.3 (Left)	150	15.68	2,352	0.30	705.6	Silt Loam	85	30.0	473.35	28
	1.4 (Left)	400	10.74	4,296	0.50	2,148.0	Silt Loam	85	91.3	502.10	92
	1.5 (Left)	600	14.52	8,712	0.30	2,613.6	Silt Loam	85	111.1	618.60	137
	2.1 (Left)	125	15.04	1,880	0.30	564.0	Silt Loam	85	24.0	373.70	18
	2.2 (Left)	375	9.24	3,465	0.30	1,039.5	Silt Loam	85	44.2	469.40	41
	3 (Left)	571	12.34	7,046	0.50	3,523.1	Silt Loam	85	149.7	592.90	178
				TOTAL		14,000.8			595.0		**604**

Reach	ID	STA	Top of Bank Elevation	Water Elevation	Vertical Bank	Horizontal Bank	Bank Height
1.1	1	104+00	792.11	785.32	6.79	9.1	11.35
1.1	2	104+50	792.60	784.71	7.89	13.5	15.64
1.1	3	105+25	790.02	784.38	5.64	7.2	9.15
1.1	4	106+25	790.27	783.86	6.41	11.7	13.34
1.1	5	107+25	790.46	783.79	6.67	9.1	11.28
AVERAGE					**6.68**	**10.12**	**12.15**
1.2	11	114+75	787.60	783.14	4.46	10.7	11.59
1.2	12	115+00	790.63	780.71	9.92	9.3	13.60
1.2	13	116+50	784.26	777.53	6.73	9.2	11.40
AVERAGE					**7.04**	**9.73**	**12.20**
1.3	14	117+25	788.94	782.36	6.58	18.8	19.92
1.3	15	118+00	787.79	782.15	5.64	11.4	12.72
1.3	16	118+50	788.53	783.49	5.04	13.5	14.41
AVERAGE					**5.75**	**14.57**	**15.68**
1.4	17	119+00	790.25	782.89	7.36	3.2	8.03
1.4	18	119+50	789.21	782.57	6.64	11.8	13.54
1.4	19	120+75	789.08	782.77	6.31	7.4	9.73
1.4	20	122+00	788.95	782.94	6.01	10.0	11.67
AVERAGE					**6.58**	**8.10**	**10.74**
1.5	21	123+00	787.85	783.01	4.84	13.9	14.72
1.5	22	124+00	788.48	782.24	6.24	16.5	17.64
1.5	23	125+50	788.95	782.13	6.82	10.4	12.44
1.5	24	126+50	788.23	782.11	6.12	12.3	13.74
1.5	25	127+50	787.25	782.08	5.17	13.1	14.08
AVERAGE					**5.84**	**13.24**	**14.52**
2.1	27	134+50	786.70	782.59	4.11	11.6	12.31
2.2	28	135+50	788.91	781.82	7.09	16.3	17.78
AVERAGE					**5.60**	**13.95**	**15.04**
2.2	29	136+25	787.34	781.30	6.04	5.5	8.17
2.2	30	137+00	788.66	782.29	6.37	7.9	10.15
2.2	31	138+00	788.24	781.98	6.26	8.2	10.32
2.2	32	139+00	787.10	781.76	5.34	6.4	8.34
AVERAGE					**6.00**	**7.00**	**9.24**
3	40	203+75	794.40	788.97	5.43	11.5	12.72
3	39	204+75	794.33	788.47	5.86	12.9	14.17
3	38	205+75	795.16	788.83	6.33	4.2	7.60
3	37	206+75	794.05	788.55	5.5	1.8	5.79
3	36	207+75	792.00	788.23	3.77	11.7	12.29
AVERAGE					**5.38**	**8.42**	**10.51**

Attachment #11

Water Quality Trading
Operation and Maintenance Plan

Introduction:
The Water Quality Trading (WQT) Operation and Maintenance (O&M) Plan is meant to be a working document and should be updated as new trading practices are implemented. Currently, the Operation and Maintenance Plan revolves around the Best Management Practice (BMP) construction along the Kickapoo River and Bear Creek. The attached *BMP Inspection Form* should be completed during annual inspections of BMPs and following major storm events. Inspection forms shall be retained for at least five (5) years to ensure compliance with the WQT Plan.

Publicly Owned BMP:
Village representative to complete inspection form annually and following major storm events. The form will then be provided to the Maintenance Supervisor following inspection. The Village will address maintenance issues identified during inspection within 30 days. Substantial maintenance issues may require an extended timeframe for generation of plans, specifications, and a public bid process to perform the work. Inspections and O&M activities shall be reported in the annual WQT Report sent to the DNR.

Privately Owned BMP:
Village representative to complete inspection form annually and following major storm events. The form will then be provided to the Maintenance Supervisor following inspection. The Village will address maintenance issues identified during inspection within 30 days. Substantial maintenance issues may require an extended timeframe for generation of plans, specifications, and a public bid process to perform the work. Maintenance expenses will be incurred by either by the Village or Private Property Owner depending on agreement with the Village. The Private Property Owner will be allowed to perform maintenance activities at the expense of the Private Property Owner. Inspections and O&M activities shall be reported in the annual WQT Report sent to the DNR.

Quality Assurance:
Riprap gradation and composition shall be provided for each source of material. Streambank shaping and riprap shall be installed per the Vernon County Land Conservation Department and NRCS Standards. Contractors to supply rock that is approved by the NRCS and meets criteria in Wisconsin Construction Spec.9.

Installation:
- Staking provided by the Engineer.
- Do not place riprap over frozen or spongy subgrade surfaces.
- Place riprap as indicated on Construction Plans. Do not dump rip-rap over the bank.
- Blend riprap with existing bank.
- Spread soil out in a layer of less than 4” and seed down. Do not spread soil in wetlands.
- All disturbed areas and soil must be seeded and mulched.
- Install habitat structures per Plans and Specifications.

Practice Registration:
The purpose of the “Water Quality Trading Management Practice Registration” form is to report to DNR that a management practice identified in the trading plan has been properly installed and is established

and effective. This information will be used to track implementation progress, verify compliance and perform audits, as necessary. A registration form should be submitted for every management practice that has been identified in the trading plan. If practices are established prior to trading plan submittal, registration forms may be submitted with the trading plan. Otherwise, registration forms should be submitted during the permit term as practices become effective or with the annual report. A blank *Water Quality Trading Management Practice Registration Form 3400-207* is attached and should be submitted following implementation of the trading practice.

Tracking Procedures:
The Village will track credits used monthly. The Village will report credit usage to the DNR on a monthly basis in the Discharge Monitoring Reports (DMRs). The annual report will summarize the 12 months of credit usage and credit generation. The Village will report to DNR any concern that they have that may result in a need to modify the trade agreement and/or this trade plan. For example, a need to generate additional credits based on discharge.

Inspections/Maintenance Considerations:

- A *BMP Inspection Form* is attached.
    - Site: As noted on Construction Plans
    - Condition of BMP: Excellent; Good; Fair; or Poor
    - Maintenance Estimate: Provide an estimate for how long the maintenance will take to complete or a dollar value for completion. This will help determine if the Village will perform the work or if the Village will hire another entity to perform the work.
    - Date Completed: Following completion of the required maintenance, input the date of completion.
    - Comments: Provide the required maintenance activity along with any other useful information. If the cell provided is not large enough for Comments, write "See Back of Sheet" and provide comments on the reverse side of the Form.
- Following installation, inspect the disturbed areas closely over the next few months to ensure that seeding grows.
- BMPs may settle or shift especially after flooding events or freeze/thaw.
- May need to control weed and brush growth.
- Inspect stabilized areas as needed.
- At a minimum, inspect after major storm events.
- If a BMP has been damaged, repair it promptly to prevent a progressive failure.
- If repairs are needed repeatedly at a location, evaluate the site to determine if the original design conditions have changed.

Routine Maintenance Items that can be performed by Village:

- Evaluate BMP condition
    - Reconstruct/replace BMPs that have settled, shifted, or washed out.
- Manage Vegetation
    - Remove invasive/noxious plants.
- Manage Garbage
    - Remove garbage and other debris that could otherwise impair the streambank stability.
- Habitat Structures
    - Verify structures have remained in place during periods of low flow.

Monthly Certification:
Each month, the Village will certify that the BMPs are maintained and operating in a manner consistent with this Water Quality Trading Plan or provide a statement noting noncompliance with this Plan. The monthly Discharge Monitoring Report (DMR) will include the following statement as a certification of compliance when the Credit Generating Practice is operating in a manner consistent with the Plan:

> "I certify that to the best of my knowledge that the management practices identified in the approved water quality trading plan as the source of phosphorus credits is installed, established and properly maintained."

Annual Inspection:
An annual inspection of the BMPs will be performed by a licensed Professional Engineer to ensure that the BMPs are functioning as intended in order to meet the requirements of the WQT Plan.

Noncompliance:
The Village will notify DNR by telephone call to DNR's regional wastewater compliance engineer within 24 hours or next business day of becoming aware that phosphorus credits used or intended for use by Village are not being generated as outlined in this Water Quality Trading Plan.

The Village will submit a written notification within five days after the Village recognizes that the phosphorus credits are not being generated as outlined in the Trading Plan. DNR may waive the requirement for submittal for a written notice within five days and instruct the Village to submit the written notice with the next regularly scheduled monitoring report required by Village's WPDES Permit.

The written notification should include:

- Description of noncompliance and cause.
- Period of noncompliance including dates and times.
- Schedule for attaining compliance including time and steps toward compliance.
- Plan to prevent reoccurrence of the noncompliance.

Notification of Trade Agreement Termination:
If a trade agreement or the trading plan needs to be terminated during the permit term, the permittee should submit a Notice of Termination to the wastewater engineer/specialist to inform DNR of the termination. DNR staff should use this information to determine if a permit modification is required due to the termination, the termination will result in non-compliance, or other permit actions are required due to the termination. When credits are reduced or eliminated for any reason, the permittee is still required to meet their WQBELs without any grace period. To prevent noncompliance with WQBELs, changes to trading plans must be addressed before credits are lost. Modifying the permit/trading plan will require at least 180 days. A blank *Notification of Water Trade Agreement Termination Form 3400-209* is attached and should be submitted to DNR prior to practice termination, no later than the submittal date of the annual report.

Streambank Inspection Form

Date: _____

Inspector: _____

Reason for Inspection (circle one): Monthly / Precipitation Event / Other: _____

Last Inspection Photos Date: _____
(inspection photos should be taken annually at minimum)

Reach	Condition of BMP	Required Maintenance	Maintenance Estimate (Time or Cost)	Date Completed	Comments
1 (Left)					
2 (Left)					
3 (Left)					

Photos Taken? ☐ Yes ☐ No

All Habitat Structures Verified? ☐ Yes ☐ No
If no, explain

State of Wisconsin
Department of Natural Resources
101 South Webster Street
Madison WI 53707-7921
dnr.wi.gov

Water Quality Trading Management Practice Registration

Form 3400-207 (R 1/14)

Notice: Pursuant to s. 283.84, Wis. Stats., this form must be completed by any WPDES permittee that is using water quality trading as a method of complying with a permit limitation. Failure to complete this form would not result in penalties. Personal information collected will be used for administrative purposes and may be provided to requesters to the extent required by Wisconsin's Open Records Law (ss. 19.31 - 19.39, Wis. Stats.).

Applicant Information

Permittee Name	Permit Number WI-	Facility Site Number

Facility Address	City	State	ZIP Code

Project Contact Name (if applicable)	Address	City	State	ZIP Code

Project Name

Broker/Exchange Information (if applicable)

Was a broker/exchange be used to facilitate trade? ◯ Yes ◯ No

Broker/Exchange Organization Name	Contact Name

Address	Phone Number	Email

Trade Registration Information (Use a separate form for each trade agreement)

Type	Trade Agreement Number	Practices Used to Generate Credits	Anticipated Load Reduction	Trade Ratio	Method of Quantification
◯ Urban NPS ◯ Agricultural NPS ◯ Other					

County	Closest Receiving Water Name	Land Parcel ID(s)	Parameter(s) being traded

The preparer certifies all of the following:

- I have completed this document to the best of my knowledge and have not excluded pertinent information.
- I certify that the information in this document is true to the best of my knowledge.

Signature of Preparer	Date Signed

Authorized Representative Signature

I certify under penalty of law that this document and all attachments were prepared under my direction or supervision. Based on my inquiry of those persons directly responsible for gathering and entering the information, the information is, to the best of my knowledge and belief, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature of Authorized Representative	Date Signed

Leave Blank – For Department Use Only

Date Received		Trade Docket Number
Entered in Tracking System ☐ Yes	Date Entered	Name of Department Reviewer

State of Wisconsin
Department of Natural Resources
101 South Webster Street
Madison WI 53707-7921
dnr.wi.gov

Notification of Water Trade Agreement Termination

Form 3400-209 (1/14)

Notice: Pursuant to s. 283.84, Wis. Stats., and ch. NR 217 Wis. Adm. Code, this form must be completed by any WPDES permittee that is using water quality trading as a method of complying with a permit limitation. Failure to complete this form would not result in penalties. Personal information collected will be used for administrative purposes and may be provided to requesters to the extent required by Wisconsin's Open Records Law (ss. 19.31 - 19.39, Wis. Stats.).

Applicant Information

Permittee Name	Permit Number WI-	Facility Site Number

Facility Address	City	State	ZIP Code

Project Contact Name (if applicable)	Address	City	State	ZIP Code

Project Name

Credit Generator Information

Credit generator type (select all that apply):

- ☐ Permitted Discharge (non-MS4/CAFO)
- ☐ Permitted MS4
- ☐ Permitted CAFO
- ☐ Urban nonpoint source discharge
- ☐ Agricultural nonpoint source discharge
- ☐ Other - Specify:

Trade Agreement number(s) to be terminated including affected land parcel ID(s):

Amount of trading credit being terminated	Effective date of termination

Reason for termination

Is this agreement being updated or replaced?

- ◯ Yes
- ◯ No
- ◯ Unsure

Will this termination result in non-compliance with the effective limit or other permit requirements?

- ◯ Yes; Name: _____
- ◯ No
- ◯ Unsure

The preparer certifies all of the following:

- I am familiar with the specifications submitted for this application, and I believe all applicable items in this checklist have been addressed.
- I have completed this document to the best of my knowledge and have not excluded pertinent information.

Signature of Preparer	Date Signed

Authorized Representative Signature


I certify under penalty of law that this document and all attachments were prepared under my direction or supervision. Based on my inquiry of those persons directly responsible for gathering and entering the information, the information is, to the best of my knowledge and belief, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of fine and imprisonment for knowing violations.

Signature of Authorized Representative	Date Signed

Attachment #12


PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

OWNER: VILLAGE OF LA FARGE

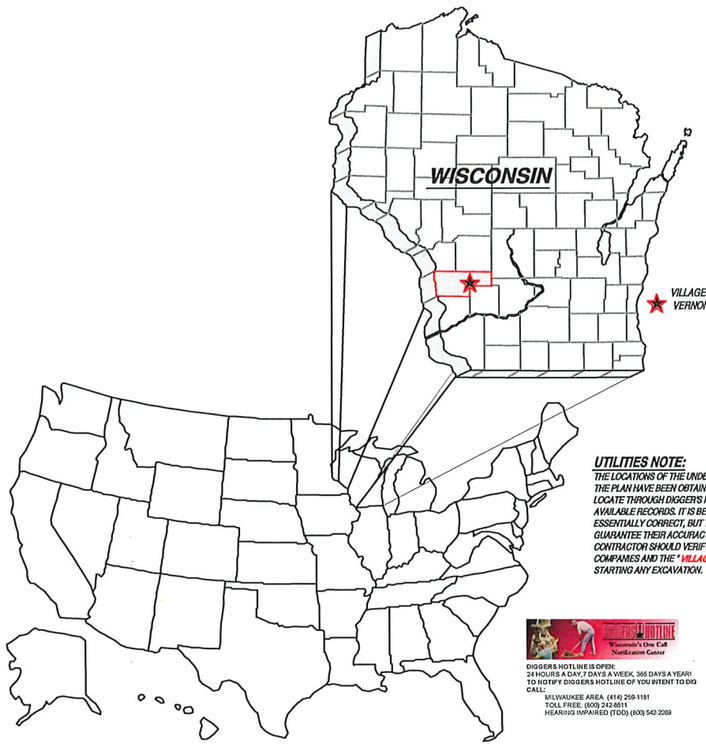

UTILITIES NOTE:
THE LOCATIONS OF THE UNDERGROUND UTILITIES SHOWN ON THE PLAN HAVE BEEN OBTAINED BY FIELD CHECKS, A UTILITY LOCATE THROUGH DIGGERS HOTLINE, AND SEARCHES OF AVAILABLE RECORDS. IT IS BELIEVED THAT THEY ARE ESSENTIALLY CORRECT, BUT THE SURVEYOR DOES NOT GUARANTEE THEIR ACCURACY OR COMPLETENESS. THE CONTRACTOR SHOULD VERIFY LOCATIONS W/ THE UTILITY COMPANIES AND THE * VILLAGE OF LA FARGE * PRIOR TO STARTING ANY EXCAVATION.

DIGGERS HOTLINE IS OPEN:
24 HOURS A DAY,7 DAYS A WEEK, 365 DAYS A YEAR!
TO NOTIFY DIGGERS HOTLINE OF YOU INTENT TO DIG CALL:
MILWAUKEE AREA (414) 259-1181
TOLL FREE: (800) 242-8511
HEARING IMPAIRED (TDD) (800) 542-2289

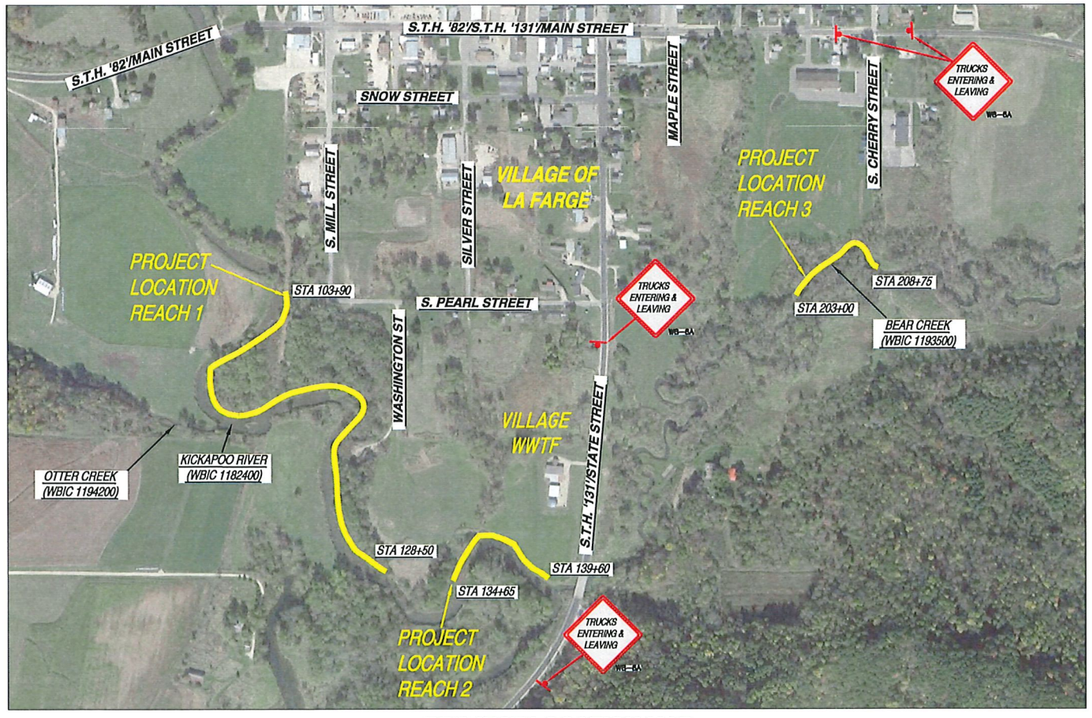

PROJECT LOCATION MAP
SCALE: N.T.S.

SHEET INDEX:

SHEET TITLE:	SHEET DESCRIPTION:	DATE OF ISSUE:	DATE OF REVISION:
G000	TITLE SHEET & PROJECT LOCATION MAP	MARCH 23, 2023	-
G001	LEGEND & GENERAL NOTES	MARCH 23, 2023	-
C101 - C103	PLAN VIEW - REACH 1	MARCH 23, 2023	-
C104	PLAN VIEW - REACH 2	MARCH 23, 2023	-
C105	PLAN VIEW - REACH 3	MARCH 23, 2023	-
C201	DETAILS - EROSION CONTROL & NOTES	MARCH 23, 2023	-
C202	DETAILS - STREAM BANK	MARCH 23, 2023	-

GENERAL NOTES - TRAFFIC CONTROL

1. THE SIGN LOCATIONS SHOWN ARE APPROXIMATE LOCATIONS. CONTRACTOR SHALL INSTALL TRAFFIC CONTROL SIGNS PER WISCONSIN DEPARTMENT OF TRANSPORTATION (DOT) STANDARDS AND THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).
2. THE SIGNS SHOWN ARE THE MINIMUM TRAFFIC CONTROL THAT WILL BE REQUIRED FOR THE PROJECT. CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ADDITIONAL TRAFFIC CONTROL MEASURES DURING CONSTRUCTION TO MEET THE STANDARDS OF THE WISCONSIN DOT AND THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES, AND AS DIRECTED BY THE PROJECT ENGINEER.

WISCONSIN
JORDAN D FURE
E-49226-6
PLATTEVILLE WI.
PROFESSIONAL ENGINEER
3-23-2023

PROJECT INFORMATION:

OWNER:
VILLAGE OF LA FARGE
PRESIDENT
MS. CHERYL PURVIS
105 W. MAIN STREET
LA FARGE, WI 54639
(608) 606-2907

VILLAGE OF LA FARGE
CLERK/TREASURER
MS. KIMBERLY WALKER
105 W. MAIN STREET
LA FARGE, WI 54639
(608) 625-4422

STREET AND STORM SEWER UTILITY:
VILLAGE OF LA FARGE
DIRECTOR OF PUBLIC WORKS
MR. WAYNE HAUGRUD
105 W. MAIN STREET
LA FARGE, WI 54639
(608) 625-2333

SANITARY SEWER AND WATER UTILITY:
VILLAGE OF LA FARGE
DIRECTOR OF PUBLIC WORKS
MR. WAYNE HAUGRUD
105 W. MAIN STREET
LA FARGE, WI 54639
(608) 625-2333

ELECTRIC UTILITY:
VILLAGE OF LA FARGE
DIRECTOR OF PUBLIC WORKS
MR. WAYNE HAUGRUD
105 W. MAIN STREET
LA FARGE, WI 54639
(608) 625-2333

NATURAL GAS UTILITY:
MIDWEST GAS
106 W. STATE STREET
WESTBY, WI 54667
(608) 634- 4617

ELECTRIC UTILITY:
VERNON ELECTRIC CO-OP
110 SAUGSTAD RD
WESTBY, WI 54667
(800) 447- 5051

TELEPHONE & CABLE TELEVISION:
VERNON COMMUNICATIONS CO-OP
103 N. MAIN ST.
P.O. BOX 20
WESTBY, WI 54667
(608) 634- 3136

CABLE TELEVISION:
MEDIACOM, LLC
115 S MARQUETTE RD
PRAIRIE DU CHIEN, WI 53821-1639
(888) 759-6137

MEDIACOM, LLC
ATTN: MR. TIM ORCUTT
3033 ASBURY RD
DUBUQUE, IA 5201
(800) 874-2324
TORCUTT@MEDIACOMCC.COM

ENGINEER:
DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING - LAND DEVELOPMENT - PLANNING & GIS SERVICES
875 SOUTH OAKDALE STREET PLATTEVILLE, WISCONSIN 53818 PHONE: (608) 348-5355
808 JACKSON STREET DUBUQUE, IOWA 52001 PHONE: (563) 542-9005

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:
MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT
ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK
LA FARGE, WISCONSIN
PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI. 54639

REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
-/-/—		-.—

FOR BID

PROJECT NUMBER	D22-145
SHEET SCALE	NOT TO SCALE
DRAWN BY	C.COYIER
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	TITLE SHEET & PROJECT LOCATION MAP

SHEET TITLE:
G000

SHEET NUMBER: 01 of 09

LEGEND

EX. CON. MANHOLE
EX. ECC. MANHOLE
EX. LIFT STATION
EX. CLEAN OUT
EX. FIRE HYDRANT
EX. WATER SERVICE
EX. WATER VALVE
EX. YARD HYDRANT
EX. CATCH BASIN
EX. STORM INLET
EX. NATURAL GAS VALVE
EX. NATURAL GAS METER
EX. POWER POLE
EX. LIGHT POLE
EX. WARNING SIREN
EX. TEL. PEDESTAL
EX. MAILBOX
EX. LP TANK
EX. SATELLITE DISH
Ex. POST OR POLE
EX. STREET SIGN
EX. EVERGREEN TREE
EX. DECIDUOUS TREE
EX. TREE STUMP
EX. BUSH/SHRUB
EX. TREE/BRUSH LINE
EX. WINDMILL
EX. PARK BENCH
EX. BENCHMARK
SURVEY CONTROL POINT
EX. PROPERTY PIN
R/W — RIGHT-OF-WAY
P/L — PROPERTY LINE
EASEMENT
San. Lat. — EX. SAN. S. LATERAL
6" San. S. — EX. 6" SAN. S. MAIN
8" San. S. — EX. 8" SAN. S. MAIN
10" San. S. — EX. 10" SAN. S. MAIN
12" San. S. — EX. 12" SAN. S. MAIN
15" San. S. — EX. 15" SAN. S. MAIN
EX. FLOW DIRECTION
EX. CAPPED SERVICE
EX. WATER SERVICE
4" Water — EX. 4" WATER MAIN
6" Water — EX. 6" WATER MAIN
8" Water — EX. 8" WATER MAIN
10" Water — EX. 10" WATER MAIN
12" Water — EX. 12" WATER MAIN
12" St. Sewer — EX. <12" STORM SEWER
EX. 12" STORM SEWER
15" St. Sewer — EX. 15" STORM SEWER
18" St. Sewer — EX. 18" STORM SEWER
24" St. Sewer — EX. 24" STORM SEWER
27" St. Sewer — EX. 27" STORM SEWER
30" St. Sewer — EX. 30" STORM SEWER
36" St. Sewer — EX. 36" STORM SEWER
42" St. Sewer — EX. 42" STORM SEWER
48" St. Sewer — EX. 48" STORM SEWER
EX. CURB AND GUTTER
GAS — EX. U.GRD N. GAS UTILITY
UGE — EX. U.GRD ELECTRIC UTILITY
UGC — EX. U.GRD CABLE TV UTILITY
TEL — EX. U.GRD TELEPHONE UTILITY
FO — EX. U.GRD FIBER OPTIC UTILITY
OHE — EX. OVERHEAD ELECTRIC
EX. FENCE
EX. RAILROAD TRACKS
99 — EX. CONTOUR
EX. DRAINAGE SWALE

PROP. SANITARY SEWER LATERAL
PROP. <6" SANITARY SEWER MAIN
PROP. 6" SANITARY SEWER MAIN
PROP. 8" SANITARY SEWER MAIN
PROP. 10" SANITARY SEWER MAIN
PROP. 12" SANITARY SEWER MAIN
PROP. 15" SANITARY SEWER MAIN
PROP. 18" SANITARY SEWER MAIN
PROP. CIPP LINER
PROP. FLOW DIRECTION
PROP. WATER SERVICE
PROP. <4" WATER MAIN
PROP. 4" WATER MAIN
PROP. 6" WATER MAIN
PROP. 8" WATER MAIN
PROP. 10" WATER MAIN
PROP. 12" WATER MAIN
PROP. 15" WATER MAIN
PROP. <12" STORM SEWER
PROP. 12" STORM SEWER
PROP. 15" STORM SEWER
PROP. 18" STORM SEWER
PROP. 24" STORM SEWER
PROP. 30" STORM SEWER
PROP. 36" STORM SEWER
PROP. 48" STORM SEWER
PROP. CURB AND GUTTER
PROP. CURB BACK OPENING
GAS — PROP. U.GRD GAS UTILITY
UGE — PROP. U.GRD ELECTRIC UTILITY
UGCTV — PROP. U.GRD CABLE TV UTILITY
UGT — PROP. U.GRD TELEPHONE UTILITY
FIBER — PROP. U.GRD FIBER OPTIC UTILITY
OHE — PROP. OVERHEAD ELECTRIC
PROP. CROSSING OF N. GAS UTILITY
PROP. UTILITY POLE
PROP. LIGHT POLE
PROP. FENCE
TEMPORARY EASEMENT
CONSTRUCTION EASEMENT
ESTIMATED DISTURBANCE LIMITS
99 — PROP. CONTOUR
PROP. DRAINAGE SWALE
PROP. SILT FENCE
PROP. EROSION CONTROL SEDIMENT LOG
PROP. PAVEMENT MARKING
PAINTED TRAFFIC ARROW
ADA PARKING DESIGNATION
10 — PARKING STALL COUNT
5'R + 0+00 — RADIUS POINT/SIZE STA. ON CENTERLINE
PROP. HANDICAP RAMP WITH DETECTABLE WARNING FIELD
SOIL BORING LOCATION
RIVER FLOW DIRECTION
PROP. 4' DIA. SANITARY MANHOLE
PROP. 5' DIA. SANITARY MANHOLE
PROP. MANHOLE CHIMNEY REHABILITATION / TOP ADJUSTMENT
PROP. SANITARY LIFT STATION

PROP. TYPE "X" CURB & GUTTER
PROP. REVERSE-PITCH CURB & GUTTER
PROP. HOT MIX ASPHALT PAVEMENT (DRIVEWAY)
PROP. 4" CONCRETE SIDEWALK
PROP. 6" CONCRETE PAVEMENT
PROP. 8" CONCRETE PAVEMENT
PROP. GRAVEL SHOULDER / DRIVEWAY
EROSION MATTING (MILD SLOPES)
EROSION MATTING (STEEP SLOPES)
PROP. STREAM BANK GRADING (6:1 SLOPES)
PROP. STREAM BANK GRADING W/RIP-RAP (2:1 SLOPES)
PROP. BACKWATER REFUGE
PROP. STORM STRUCTURES - PROFILE
PROP. STORM PIPE(RCP) - PROFILE
PROP. STORM PIPE(CMP OR HDPE) - PROFILE
PROP. SANITARY STRUCTURE - PROFILE
PROP. WATER MAIN PIPE - PROFILE
PROP. CLAY LINER - PROFILE
PROP. SANITARY SEWER FORCE MAIN - PROFILE
PROP. SPOT REPAIR - PROFILE / PLAN VIEW
PROP. CASING PIPE - PROFILE
PROP. CLEARING AND GRUBBING
PROP. BUILDING REMOVAL
PROP. SIDEWALK REMOVAL
PROP. PRESSURE-REDUCING VALVE STATION
PROP. FIRE HYDRANT
PROP. WATER SERVICE
PROP. WATER SERVICE WITH VALVE BOX SLEEVE
PROP. WATER VALVE
PROP. WATER BEND - HORIZONTAL
PROP. WATER BEND - VERTICAL
PROP. WATER BEND <5°
PROP. WATER TEE
PROP. WATER CROSS
PROP. WATER REDUCER
PROP. MJ PLUG
PROP. 4' DIA. STORM MANHOLE
PROP. 5' DIA. STORM MANHOLE
PROP. INLET
PROP. 4' DIA. INLET
PROP. 6' DIA. INLET
PROP. 4' DIA. CATCH BASIN- W/ 2'X3' CASTING
PROP. 5' DIA. CATCH BASIN- W/ 2'X3' CASTING
PROP. 6' DIA. CATCH BASIN- W/ 2'X3' CASTING
PROP. 4'X6' CATCH BASIN W/2'X3' CASTING
PROP. CURB OPENING CASTING
PROP. 2'X3' CATCH BASIN
PROP. ADJUSTED CATCH BASIN TOP
PROP. WISDOT TYPE 8 INLET
PROP. WISDOT TYPE 9 INLET
PROP. CMP ENDWALL
PROP. RCP ENDWALL

KEY NOTES [100] :

100 PROPOSED SILT FENCE FOR EROSION CONTROL.
101 PROPOSED SEDIMENT LOG FOR EROSION CONTROL.
102 PROPOSED TRACKING PAD FOR EROSION CONTROL.
103 RE-GRADE YARD/DITCH LINE (MIN. SLOPE 1.0%).
104 PROPOSED EROSION MAT CLASS I, TYPE 'B'.
105 INSTALL TYPE 'D' INLET PROTECTION.
106 PROPOSED MAIL BOX RELOCATION.
107 ITEM TO REMAIN.
108 CONTRACTOR TO REMOVE ITEM.
109 PROPOSED TURBIDITY BARRIER (TYP.) (SEE DETAIL - SHEET C203).
110 PROPOSED EROSION CONTROL REVEGETATIVE MAT (ECRM).
111 REMOVE AND SALVAGE TO OWNER IN PRE-CONSTRUCTION CONDITION.
112 REINSTALL STREET SIGN AS PER OWNER/WISDOT REQUIREMENTS.
113 PROPOSED STREAM BANK GRADING (2:1 SLOPE) WITH RIP-RAP TO TOP OF BANK (SEE DETAIL - SHEET C202).
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE)(SEE DETAIL - SHEET C202).
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE (SEE DETAIL - SHEET C202).
200 PROPOSED SANITARY SEWER [SIZE].
201 NEW SANITARY SEWER LATERAL [SIZE].
202 REPLACE EXISTING SANITARY SEWER LATERAL.
203 RECONNECT EXISTING SANITARY SEWER LATERAL.
204 CONNECTION TO EXISTING SANITARY SEWER PIPE/STRUCTURE.
205 REMOVE EXISTING SANITARY SEWER PIPE /STRUCTURE.
206 REHABILITATE SANITARY MANHOLE; SEE TABLE 'B'.
207 SANITARY SEWER SPOT REPAIR.
208 ABANDON AND CAP EXISTING SANITARY SEWER.
209 ABANDON EXISTING SANITARY SEWER LATERAL.
210 CONTRACTOR TO FIELD VERIFY SANITARY SEWER LATERAL LOCATION/ACTIVITY AND REPLACE ACCORDING TO ENGINEER.
300 PROPOSED WATER MAIN [SIZE].
301 NEW WATER SERVICE [SIZE].
302 REPLACE EXISTING WATER SERVICE WITH 1" WATER SERVICE.
303 RECONNECT EXISTING WATER SERVICE.
304 DIRECTIONAL DRILL PROPOSED WATER SERVICE.
305 CONNECTION TO EXISTING WATER MAIN.
306 EXISTING HYDRANT TO BE REMOVED AND SALVAGED TO OWNER.
307 REMOVE EXISTING WATER MAIN VALVE BOX/STRUCTURE.
308 ADJUST EXISTING WATER MAIN VALVE BOX.
309 ABANDON, DRAIN, & CAP EXISTING WATER MAIN.
310 ABANDON EXISTING WATER SERVICE.
311 CONTRACTOR TO FIELD VERIFY WATER SERVICE LOCATION/ACTIVITY AND REPLACE ACCORDING TO ENGINEER.
400 PROPOSED STORM SEWER [SIZE].
401 CONNECT EXISTING ROOF DRAIN TO CURB OPENING
402 CONNECTION TO EXISTING STORM SEWER PIPE/STRUCTURE.
403 REMOVE EXISTING STORM SEWER PIPE/STRUCTURE.
404 ABANDON & CAP EXISTING STORM SEWER.
405 ADJUST EXISTING STORM STRUCTURE.
500 TREE & STUMP TO BE REMOVED (LESS THEN 12")
501 TREE & STUMP TO BE REMOVED (12" & GREATER)
502 SHRUB TO BE REMOVED.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.
504 REMOVE AND REINSTALL/REPLACE EXISTING LANDSCAPING, FENCE, RETAINING WALL, ETC. (IF NECESSARY).
505 REMOVE EXISTING LANDSCAPING, FENCE, RETAINING WALL, ETC.
506 POLE/PEDESTAL TO BE SECURED BY UTILITY COMPANY DURING CONSTRUCTION.
507 POLE TO BE RELOCATED BY UTILITY COMPANY.
508 GUY WIRE TO BE RELOCATED BY UTILITY COMPANY.
509 PEDESTAL TO BE RELOCATED BY UTILITY COMPANY.
510 UTILITY CONFLICT - TO BE RELOCATED/ADJUSTED BY UTILITY COMPANY.
511 POTENTIAL UTILITY CONFLICT - VERIFY WITH UTILITY COMPANY.
512 **CAUTION!** - UTILITY CROSSING.
600 REMOVE EXISTING CURB & GUTTER.
601 PROPOSED 24" CONCRETE CURB & GUTTER.
602 PROPOSED 30" CONCRETE CURB & GUTTER.
603 PROPOSED 36" CONCRETE CURB & GUTTER.
604 MATCH TO EXISTING CURB & GUTTER.
605 PROVIDE TYPE 'X' CURB.
606 PROVIDE REVERSE-PITCH CURB & GUTTER.
607 PROVIDE CURB TAPER.
608 REMOVE ASPHALT/CONCRETE/WALL/STEPS.
609 PROPOSED 4" CONCRETE SIDEWALK.
610 PROPOSED 6" CONCRETE SIDEWALK/DRIVEWAY.
611 PROPOSED 6" CONCRETE PAVEMENT.
612 PROPOSED 8" CONCRETE PAVEMENT.
613 PROPOSED CONCRETE STEPS. STEP RISE HEIGHT AND STEP TREAD DEPTH SHALL MEET APPLICABLE BUILDING CODES. CONTRACTOR SHALL CONFIRM REQUIRED NUMBER OF STEPS WITH PROJECT ENGINEER PRIOR TO INSTALL.
614 PROPOSED 2' GRAVEL SHOULDER.
615 REGRADE EXISTING GRAVEL.
616 PROPOSED GRAVEL DRIVEWAY.
617 REMOVE & REPLACE GRAVEL DRIVEWAY.
618 REMOVE GRAVEL DRIVEWAY & REPLACE WITH BITUMINOUS DRIVEWAY/APRON.
619 REMOVE & REPLACE HMA PAVEMENT.
620 REMOVE & REPLACE HMA PAVEMENT DRIVEWAY.
621 PROPOSED HMA PAVEMENT.
622 MATCH TO EXISTING EDGE PAVEMENT.
623 PROPOSED RESIDENTIAL HMA PAVEMENT DRIVEWAY.
624 PROPOSED COMMERCIAL HMA PAVEMENT DRIVEWAY.
625 REMOVE & REPLACE 4" CONCRETE SIDEWALK.
626 REMOVE & REPLACE 6" CONCRETE SIDEWALK/DRIVEWAY.
627 PROPOSED HANDICAP RAMP WITH - D. WARN. FIELD [S.F.].
628 SAW CUT PCC PAVEMENT.
629 SAW CUT HMA PAVEMENT.
630 PROPOSED BITUMINOUS WEDGE CURB.

NOTES:

TRAFFIC CONTROL NOTE:
ALL CONTRACTORS MUST CONFORM TO THE MANUAL OF UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) AND THE REQUIREMENTS OF THE WISCONSIN DEPARTMENT OF TRANSPORTATION. ONE LANE OF TRAFFIC MUST REMAIN OPEN DURING AND AFTER ALL CONSTRUCTION ACTIVITIES FOR EMERGENCY VEHICLE ACCESS.

STREET SIGN NOTE:
CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING, STORING, AND RESETTING ALL PERMANENT SIGNS. CONTRACTOR IS RESPONSIBLE FOR PROTECTING ALL EXISTING SIGNS UNTIL REMOVED. CONTRACTOR IS RESPONSIBLE FOR ANY AND ALL TEMPORARY SIGNS THAT MAY BE REQUIRED.

TRAFFIC SIGN NOTE:
CONTRACTOR TO PROVIDE TEMPORARY TRAFFIC SIGNS FOR ANY TRAFFIC SIGNS DISTURBED DURING CONSTRUCTION. ALL DISTURBED TRAFFIC SIGNS MUST BE REPLACED AND INSTALLED AS PER LOCAL REGULATIONS AT THE COMPLETION OF THE PROJECT.

EROSION CONTROL NOTE:
CONTRACTOR TO INSTALL BACKFILL MATERIAL INTO THE EXCAVATED TRENCH AS SOON AS POSSIBLE TO IMPLEMENT EROSION CONTROL.

PROPERTY LINE AND RIGHT-OF-WAY NOTE:
ALL RIGHT-OF-WAYS AND PROPERTY LINES SHOWN ARE APPROXIMATE AND FOR ILLUSTRATIVE PURPOSES ONLY. A PROPERTY SURVEY PERFORMED BY A PROFESSIONAL LAND SURVEYOR SHOULD BE COMPLETED TO DETERMINE THE ACTUAL PROPERTY LINE AND RIGHT-OF-WAY LOCATIONS.

MAILBOX RELOCATION NOTE:
CONTRACTOR TO RELOCATE EXISTING MAILBOXES DURING CONSTRUCTION (COORDINATE AND VERIFY WITH LOCAL POSTAL SERVICE ON LOCATION). RESET BEHIND CURB AND GUTTER OR SHOULDER ACCORDING TO THE REQUIREMENTS OF THE LOCAL POSTMASTER UPON COMPLETION OF STREET CONSTRUCTION.

TREE TRIMMING NOTE:
CONTRACTOR TO PROPERLY TRIM ALL TREE BRANCHES, ROOTS, AND BUSHES DISTURBED DUE TO STREAM BANK IMPROVEMENTS .

TREE REMOVAL NOTE:
CONTRACTOR TO CONTACT ENGINEER OR ***VILLAGE OF LA FARGE*** FOR VERIFICATION PRIOR TO ANY TREE REMOVAL.

SAW CUT NOTE:
CONTRACTOR TO PROVIDE FULL DEPTH SAW CUTS AND REPLACE PAVEMENT.

UTILITIES' NOTE:
THE LOCATIONS OF THE UNDERGROUND UTILITIES SHOWN ON THE PLAN HAVE BEEN OBTAINED BY FIELD CHECKS, A UTILITY LOCATE THROUGH DIGGER'S HOTLINE , AND SEARCHES OF AVAILABLE RECORDS. IT IS BELIEVED THAT THEY ARE ESSENTIALLY CORRECT, BUT THE SURVEYOR DOES NOT GUARANTEE THEIR ACCURACY OR COMPLETENESS. THE CONTRACTOR SHOULD VERIFY LOCATIONS W/ THE UTILITY COMPANIES AND ***VILLAGE OF LA FARGE*** PRIOR TO STARTING ANY EXCAVATION.

SITE RESTORATION NOTE:
CONTRACTOR WILL BE RESPONSIBLE FOR REPLACEMENT OF ALL DISTURBED PROJECT AREA COMPONENTS INCLUDING, BUT NOT LIMITED TO, EXISTING CONCRETE, BITUMINOUS PAVEMENT, GRAVEL, CULVERTS, WATER AND SANITARY SEWER SYSTEM COMPONENTS, STORM SEWER SYSTEM COMPONENTS, TREES, LAWN ORNAMENTS, FENCING, YARD LANDSCAPING, RETAINING WALLS, MAILBOXES, AND LANDSCAPE AREAS.

PROPERTY DAMAGES:
THE CONTRACTOR IS RESPONSIBLE FOR THE PRESERVATION OF ADJACENT PROPERTY AND FOR ANY DAMAGE TO THE SITE OR TO ADJACENT PROPERTY INCIDENTAL TO THE CONSTRUCTION ACTIVITIES. AFTER THE COMPLETION OF CONSTRUCTION, ANY AREAS ADJACENT TO THE CONSTRUCTION SITE DAMAGED BY THE CONTRACTOR DURING EXECUTION OF THE CONTRACT SHALL BE RESTORED TO MATCH THE PRECONSTRUCTION CONDITIONS.

UTILITIES NOTE:
THE LOCATION OF THE UNDERGROUND UTILITIES SHOWN ON THE PLAN HAVE BEEN OBTAINED BY FIELD CHECKS, A UTILITY LOCATE, AND SEARCHES OF AVAILABLE RECORDS. IT IS BELIEVED THAT THEY ARE ESSENTIALLY CORRECT, BUT THE SURVEYOR DOES NOT GUARANTEE THEIR ACCURACY OR COMPLETENESS. THE CONTRACTOR SHOULD VERIFY LOCATIONS W/ THE UTILITY COMPANIES AND VILLAGE OF LA FARGE PRIOR TO STARTING ANY EXCAVATION.

DISCIPLINE	DESIGNATION
REMOVAL	R
GENERAL	G
CIVIL	C
LANDSCAPE	L
AQUATIC	AQ
ARCHITECTURAL	A
STRUCTURAL	S
ELECTRICAL	E
INSTRUMENTATION/CONTROLS	N
PROCESS	D
PLUMBING	P
HVAC /MECHANICAL	M

DISCIPLINE DESIGNATORS

TYPE	DESIGNATION
NOTES & SCHEDULES	0
PLANS	1
ELEVATIONS & DETAILS	2
CROSS-SECTIONS	3
DIAGRAMS	4

DRAWING SHEET DESIGNATION

C102
DRAWING NUMBER
DRAWING SHEET DESIGNATION
DISCIPLINE DESIGNATION (MAY HAVE MULTIPLE)

SHEET NUMBER IDENTIFICATION

ENGINEER:
DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & CADD SERVICES
825 SOUTH CHESTNUT STREET, PLATTEVILLE, WISCONSIN 53818 — PHONE: (608) 348-5355
898 JACKSON STREET, DUBUQUE, IOWA 52001 — PHONE: (563) 542-9005

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:
MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT
ALL RIGHTS RESERVED. AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN


PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639

REVISIONS:		
NO	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-,-----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	NOT TO SCALE
DRAWN BY	C.COYIER
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	LEGEND & GENERAL NOTES

SHEET TITLE:
G001

SHEET NUMBER # 02 of 09

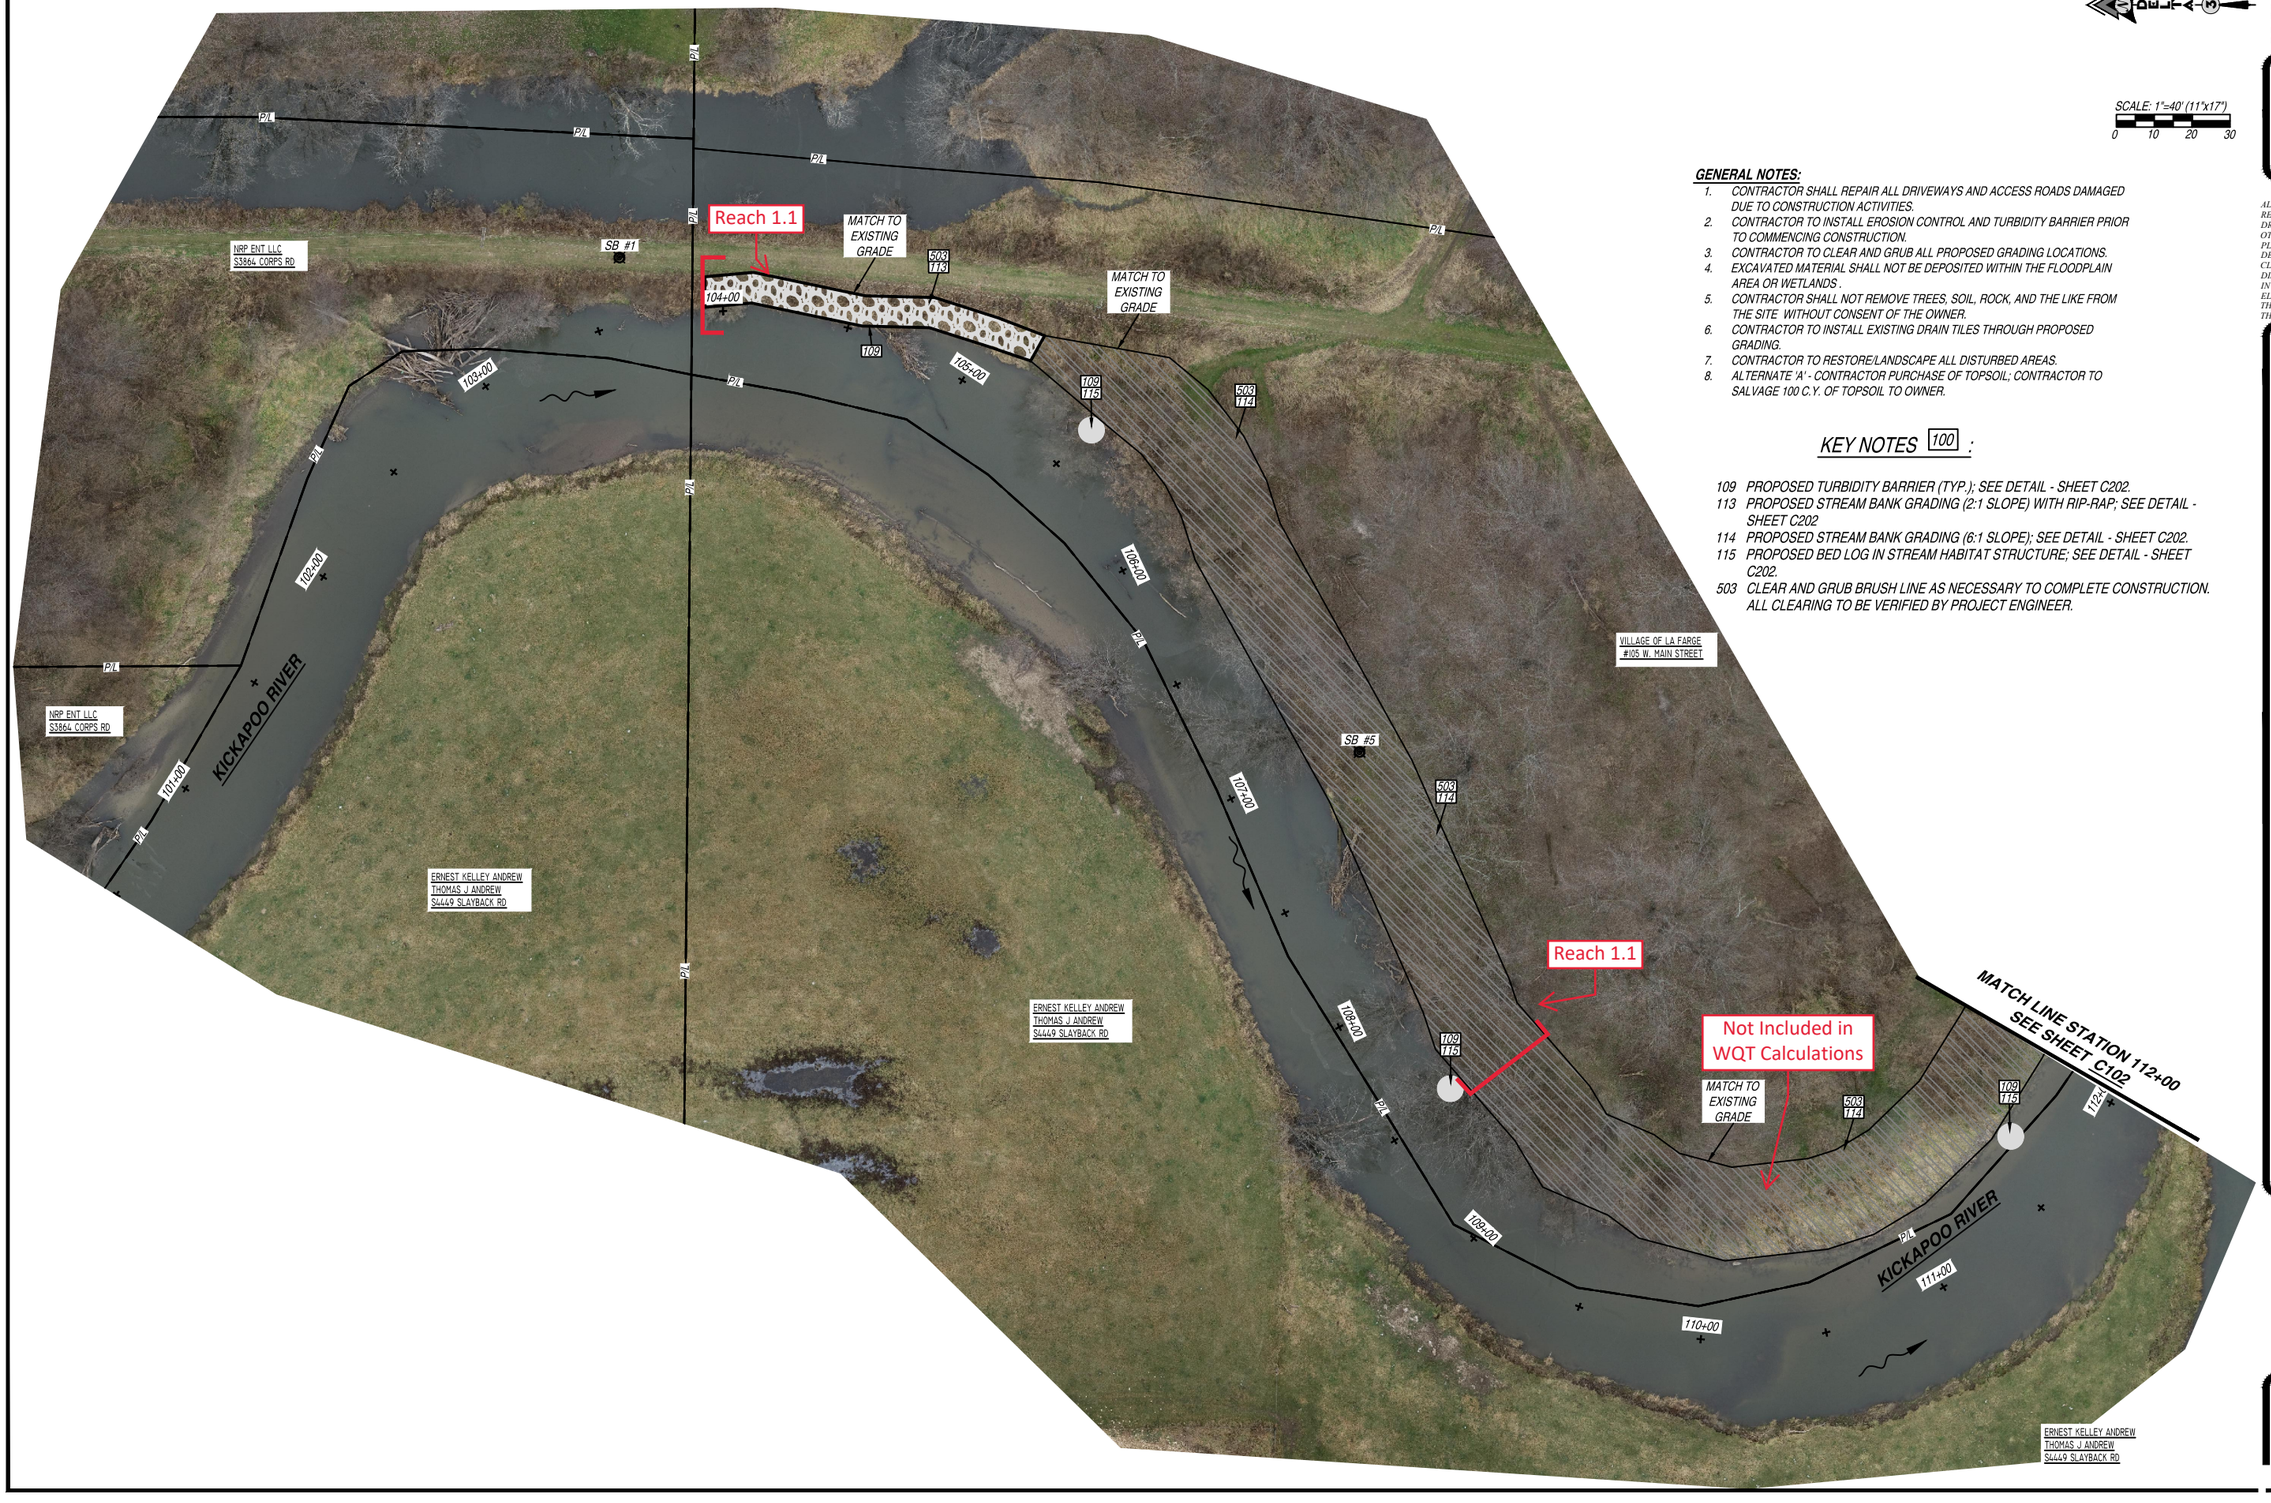

SCALE: 1"=40' (11"x17")

0 10 20 30

GENERAL NOTES:

1. CONTRACTOR SHALL REPAIR ALL DRIVEWAYS AND ACCESS ROADS DAMAGED DUE TO CONSTRUCTION ACTIVITIES.
2. CONTRACTOR TO INSTALL EROSION CONTROL AND TURBIDITY BARRIER PRIOR TO COMMENCING CONSTRUCTION.
3. CONTRACTOR TO CLEAR AND GRUB ALL PROPOSED GRADING LOCATIONS.
4. EXCAVATED MATERIAL SHALL NOT BE DEPOSITED WITHIN THE FLOODPLAIN AREA OR WETLANDS .
5. CONTRACTOR SHALL NOT REMOVE TREES, SOIL, ROCK, AND THE LIKE FROM THE SITE WITHOUT CONSENT OF THE OWNER.
6. CONTRACTOR TO INSTALL EXISTING DRAIN TILES THROUGH PROPOSED GRADING.
7. CONTRACTOR TO RESTORE/LANDSCAPE ALL DISTURBED AREAS.
8. ALTERNATE 'A' - CONTRACTOR PURCHASE OF TOPSOIL; CONTRACTOR TO SALVAGE 100 C.Y. OF TOPSOIL TO OWNER.

KEY NOTES [100] :

109 PROPOSED TURBIDITY BARRIER (TYP.); SEE DETAIL - SHEET C202.
113 PROPOSED STREAM BANK GRADING (2:1 SLOPE) WITH RIP-RAP; SEE DETAIL - SHEET C202
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE); SEE DETAIL - SHEET C202.
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE; SEE DETAIL - SHEET C202.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.

ENGINEER:

DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & DOD SERVICES
875 SOUTH CHESTNUT STREET PHONE: (608) 348-5355
PLATTEVILLE, WISCONSIN 53818
898 JACKSON STREET PHONE: (563) 542-9005
DUBUQUE, IOWA 52001

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639


REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.-----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	SEE BAR SCALE
DRAWN BY	JORDAN FURE
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	PLAN VIEW - REACH 1

SHEET TITLE:

C101

SHEET NUMBER # **03 of 09**

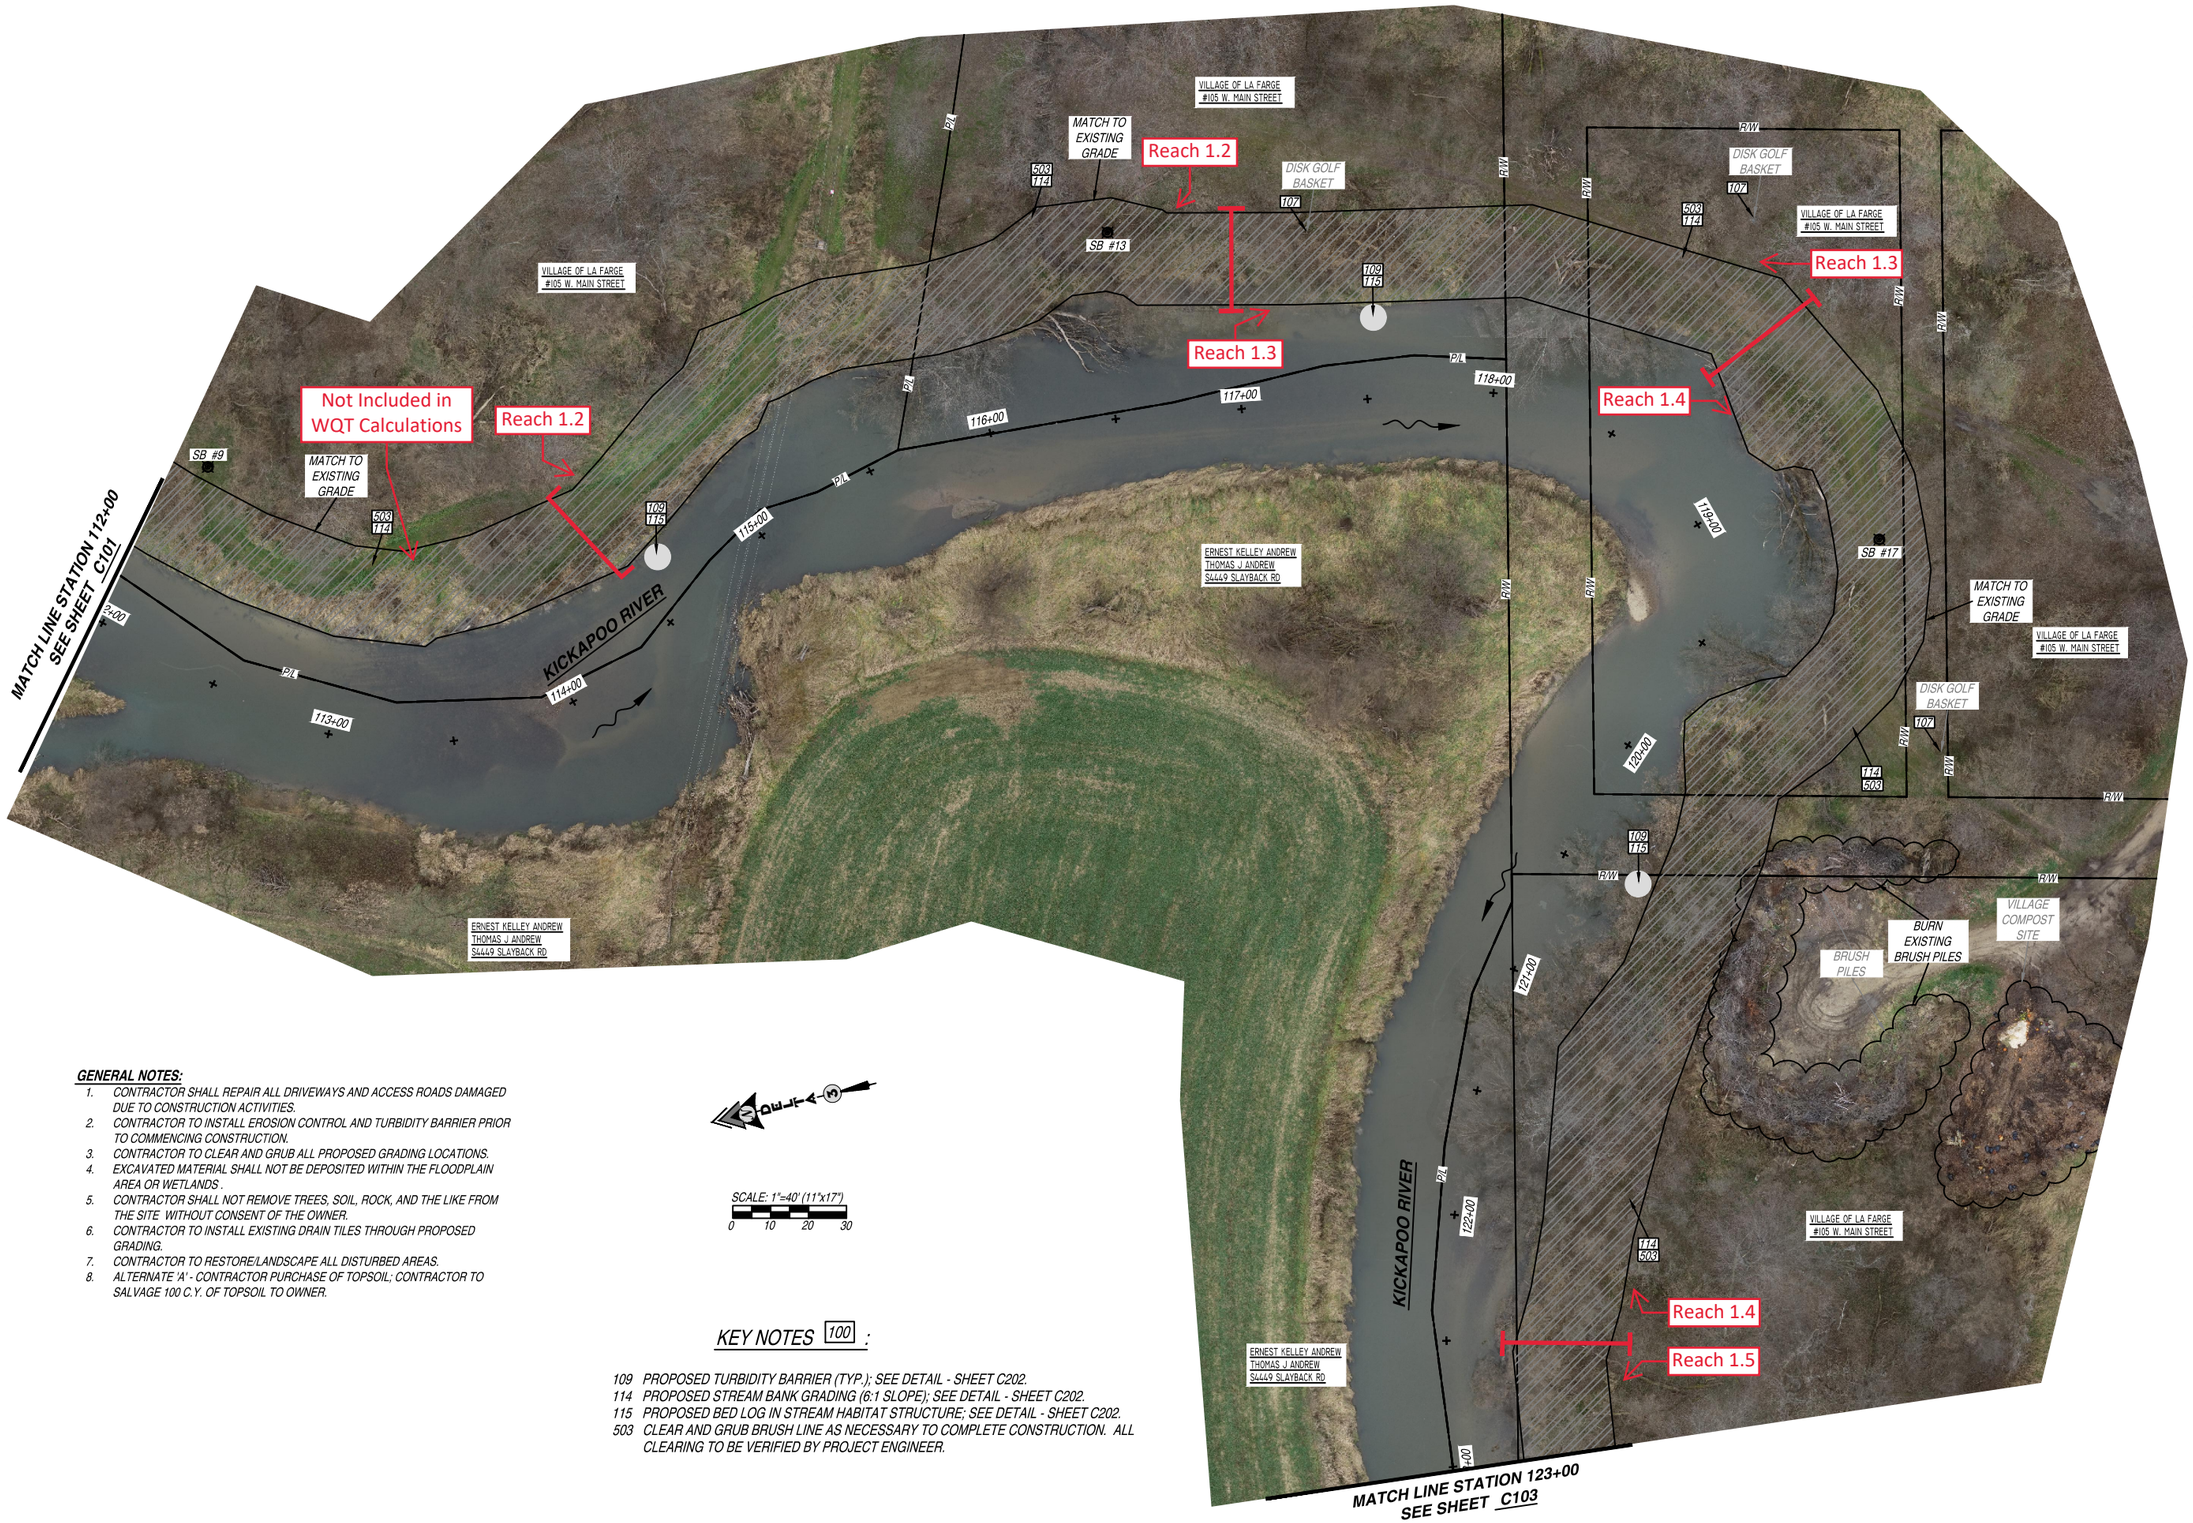

GENERAL NOTES:

1. CONTRACTOR SHALL REPAIR ALL DRIVEWAYS AND ACCESS ROADS DAMAGED DUE TO CONSTRUCTION ACTIVITIES.
2. CONTRACTOR TO INSTALL EROSION CONTROL AND TURBIDITY BARRIER PRIOR TO COMMENCING CONSTRUCTION.
3. CONTRACTOR TO CLEAR AND GRUB ALL PROPOSED GRADING LOCATIONS.
4. EXCAVATED MATERIAL SHALL NOT BE DEPOSITED WITHIN THE FLOODPLAIN AREA OR WETLANDS .
5. CONTRACTOR SHALL NOT REMOVE TREES, SOIL, ROCK, AND THE LIKE FROM THE SITE WITHOUT CONSENT OF THE OWNER.
6. CONTRACTOR TO INSTALL EXISTING DRAIN TILES THROUGH PROPOSED GRADING.
7. CONTRACTOR TO RESTORE/LANDSCAPE ALL DISTURBED AREAS.
8. ALTERNATE 'A' - CONTRACTOR PURCHASE OF TOPSOIL; CONTRACTOR TO SALVAGE 100 C.Y. OF TOPSOIL TO OWNER.

SCALE: 1"=40' (11"x17")

0 10 20 30

KEY NOTES [100] :

109 PROPOSED TURBIDITY BARRIER (TYP.); SEE DETAIL - SHEET C202.
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE); SEE DETAIL - SHEET C202.
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE; SEE DETAIL - SHEET C202.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.

ENGINEER:

DELTA 3
EVERY ANGLE COVERED

PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRENCH • LAND DEVELOPMENT • PLANNING & GIS/D SERVICES

875 SOUTH CHESTNUT STREET PHONE: (608) 348-5355
PLATTEVILLE, WISCONSIN 53818

898 JACKSON STREET PHONE: (563) 542-9005
DUBUQUE, IOWA 52001

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639


REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	SEE BAR SCALE
DRAWN BY	JORDAN FURE
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	PLAN VIEW - REACH 1

SHEET TITLE:

C102

SHEET NUMBER # **04 of 09**

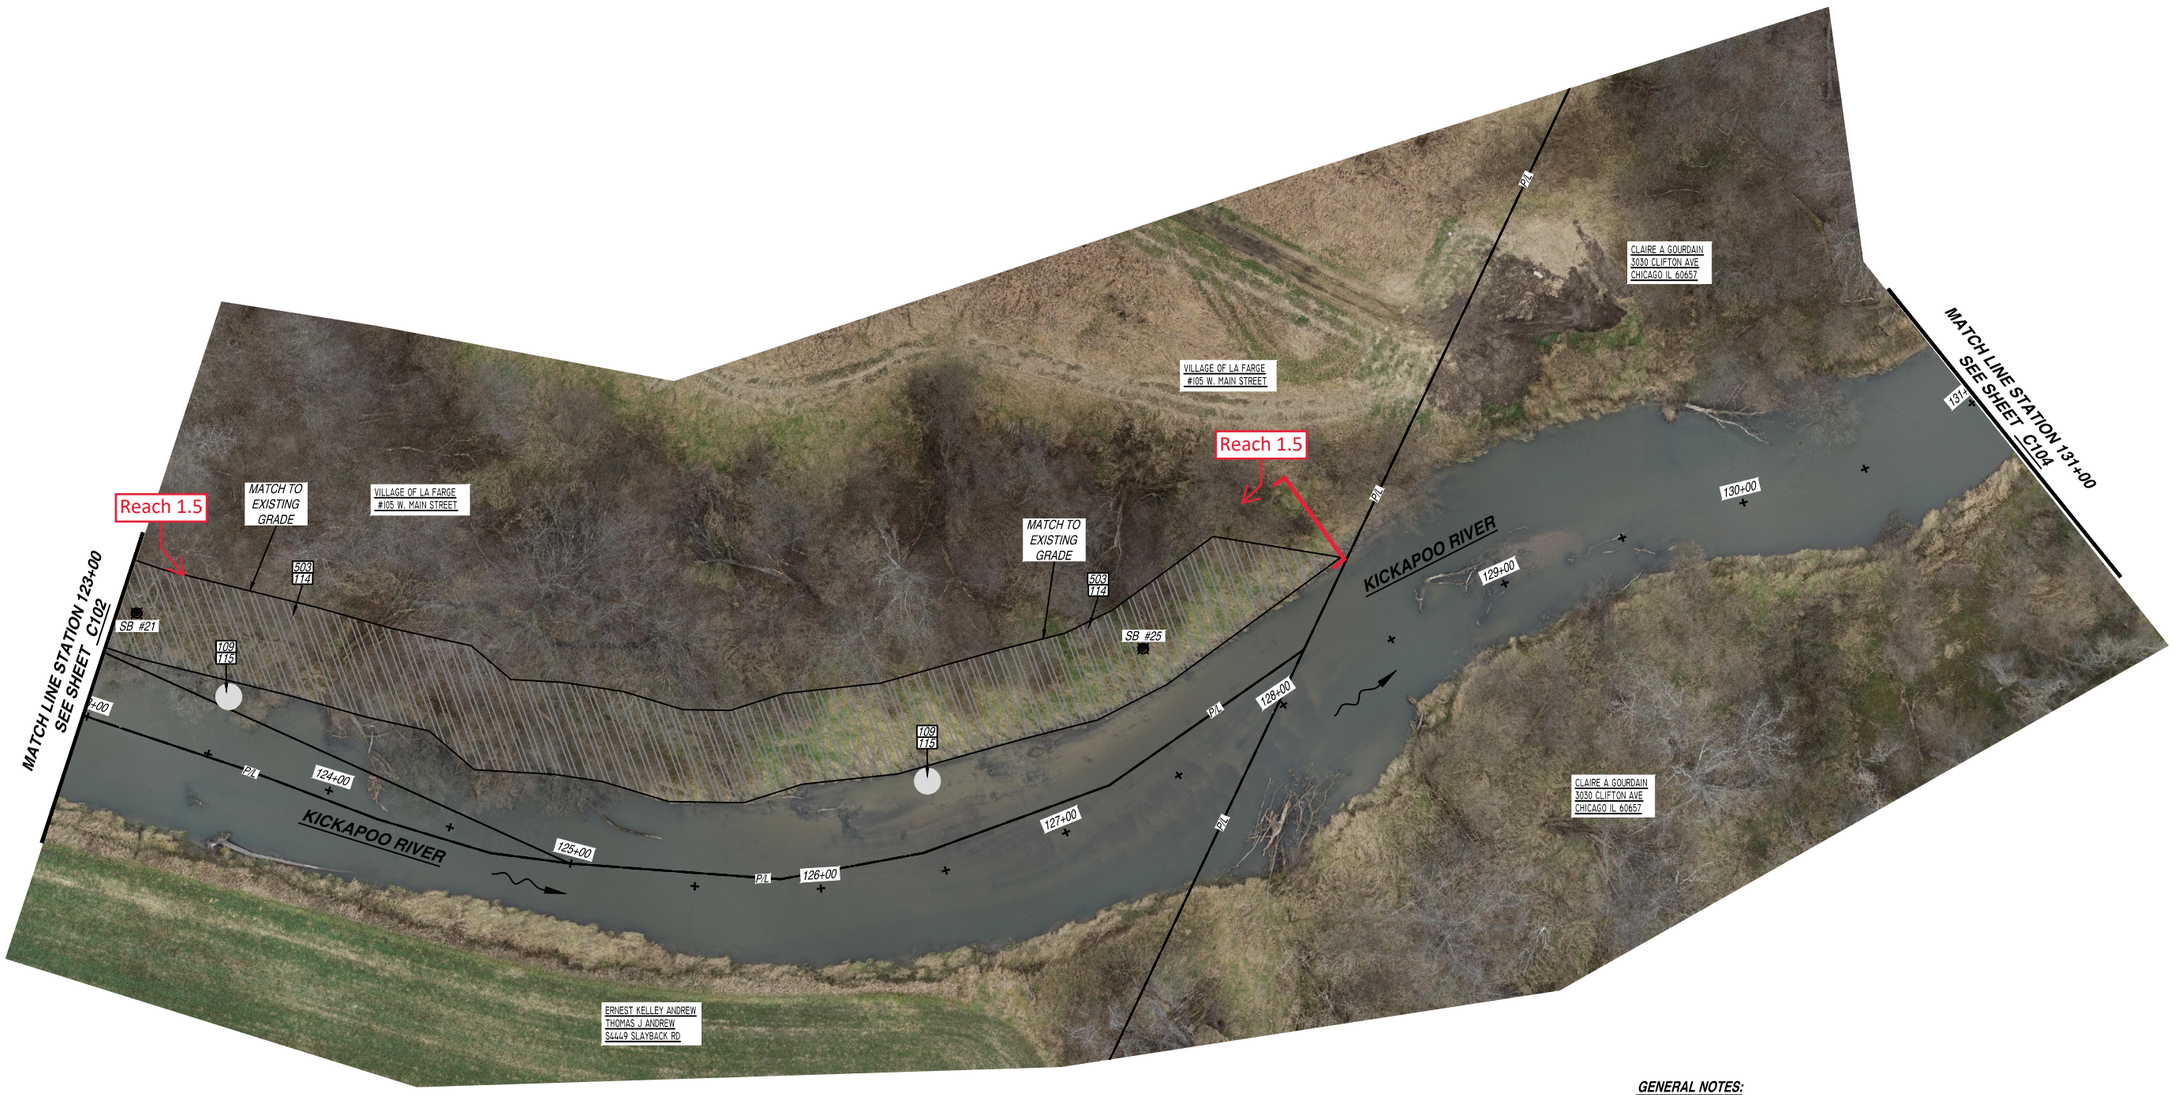

SCALE: 1"=40' (11"x17")

0 10 20 30

KEY NOTES [100] :

109 PROPOSED TURBIDITY BARRIER (TYP.); SEE DETAIL - SHEET C202.
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE); SEE DETAIL - SHEET C202.
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE; SEE DETAIL - SHEET C202.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.

GENERAL NOTES:

1. CONTRACTOR SHALL REPAIR ALL DRIVEWAYS AND ACCESS ROADS DAMAGED DUE TO CONSTRUCTION ACTIVITIES.
2. CONTRACTOR TO INSTALL EROSION CONTROL AND TURBIDITY BARRIER PRIOR TO COMMENCING CONSTRUCTION.
3. CONTRACTOR TO CLEAR AND GRUB ALL PROPOSED GRADING LOCATIONS.
4. EXCAVATED MATERIAL SHALL NOT BE DEPOSITED WITHIN THE FLOODPLAIN AREA OR WETLANDS .
5. CONTRACTOR SHALL NOT REMOVE TREES, SOIL, ROCK, AND THE LIKE FROM THE SITE WITHOUT CONSENT OF THE OWNER.
6. CONTRACTOR TO INSTALL EXISTING DRAIN TILES THROUGH PROPOSED GRADING.
7. CONTRACTOR TO RESTORE/LANDSCAPE ALL DISTURBED AREAS.
8. ALTERNATE 'A' - CONTRACTOR PURCHASE OF TOPSOIL; CONTRACTOR TO SALVAGE 100 C.Y. OF TOPSOIL TO OWNER.

ENGINEER:

DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & GIS SERVICES

825 SOUTH CHESTNUT STREET, PLATTEVILLE, WISCONSIN 53818 — PHONE: (608) 348-5355
888 JACKSON STREET, DUBUQUE, IOWA 52001 — PHONE: (563) 542-9005

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639

REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	SEE BAR SCALE
DRAWN BY	JORDAN FURE
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	PLAN VIEW - REACH 1

SHEET TITLE:

C103


SHEET NUMBER # **05 of 09**

GENERAL NOTES:

1. CONTRACTOR SHALL REPAIR ALL DRIVEWAYS AND ACCESS ROADS DAMAGED DUE TO CONSTRUCTION ACTIVITIES.
2. CONTRACTOR TO INSTALL EROSION CONTROL AND TURBIDITY BARRIER PRIOR TO COMMENCING CONSTRUCTION.
3. CONTRACTOR TO CLEAR AND GRUB ALL PROPOSED GRADING LOCATIONS.
4. EXCAVATED MATERIAL SHALL NOT BE DEPOSITED WITHIN THE FLOODPLAIN AREA OR WETLANDS .
5. CONTRACTOR SHALL NOT REMOVE TREES, SOIL, ROCK, AND THE LIKE FROM THE SITE WITHOUT CONSENT OF THE OWNER.
6. CONTRACTOR TO INSTALL EXISTING DRAIN TILES THROUGH PROPOSED GRADING.
7. CONTRACTOR TO RESTORE/LANDSCAPE ALL DISTURBED AREAS.
8. ALTERNATE 'A' - CONTRACTOR PURCHASE OF TOPSOIL; CONTRACTOR TO SALVAGE 100 C.Y. OF TOPSOIL TO OWNER.

KEY NOTES [100] :

102 PROPOSED TRACKING PAD FOR EROSION CONTROL.
107 ITEM TO REMAIN.
109 PROPOSED TURBIDITY BARRIER (TYP.); SEE DETAIL - SHEET C202.
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE); SEE DETAIL - SHEET C202.
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE; SEE DETAIL - SHEET C202.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.

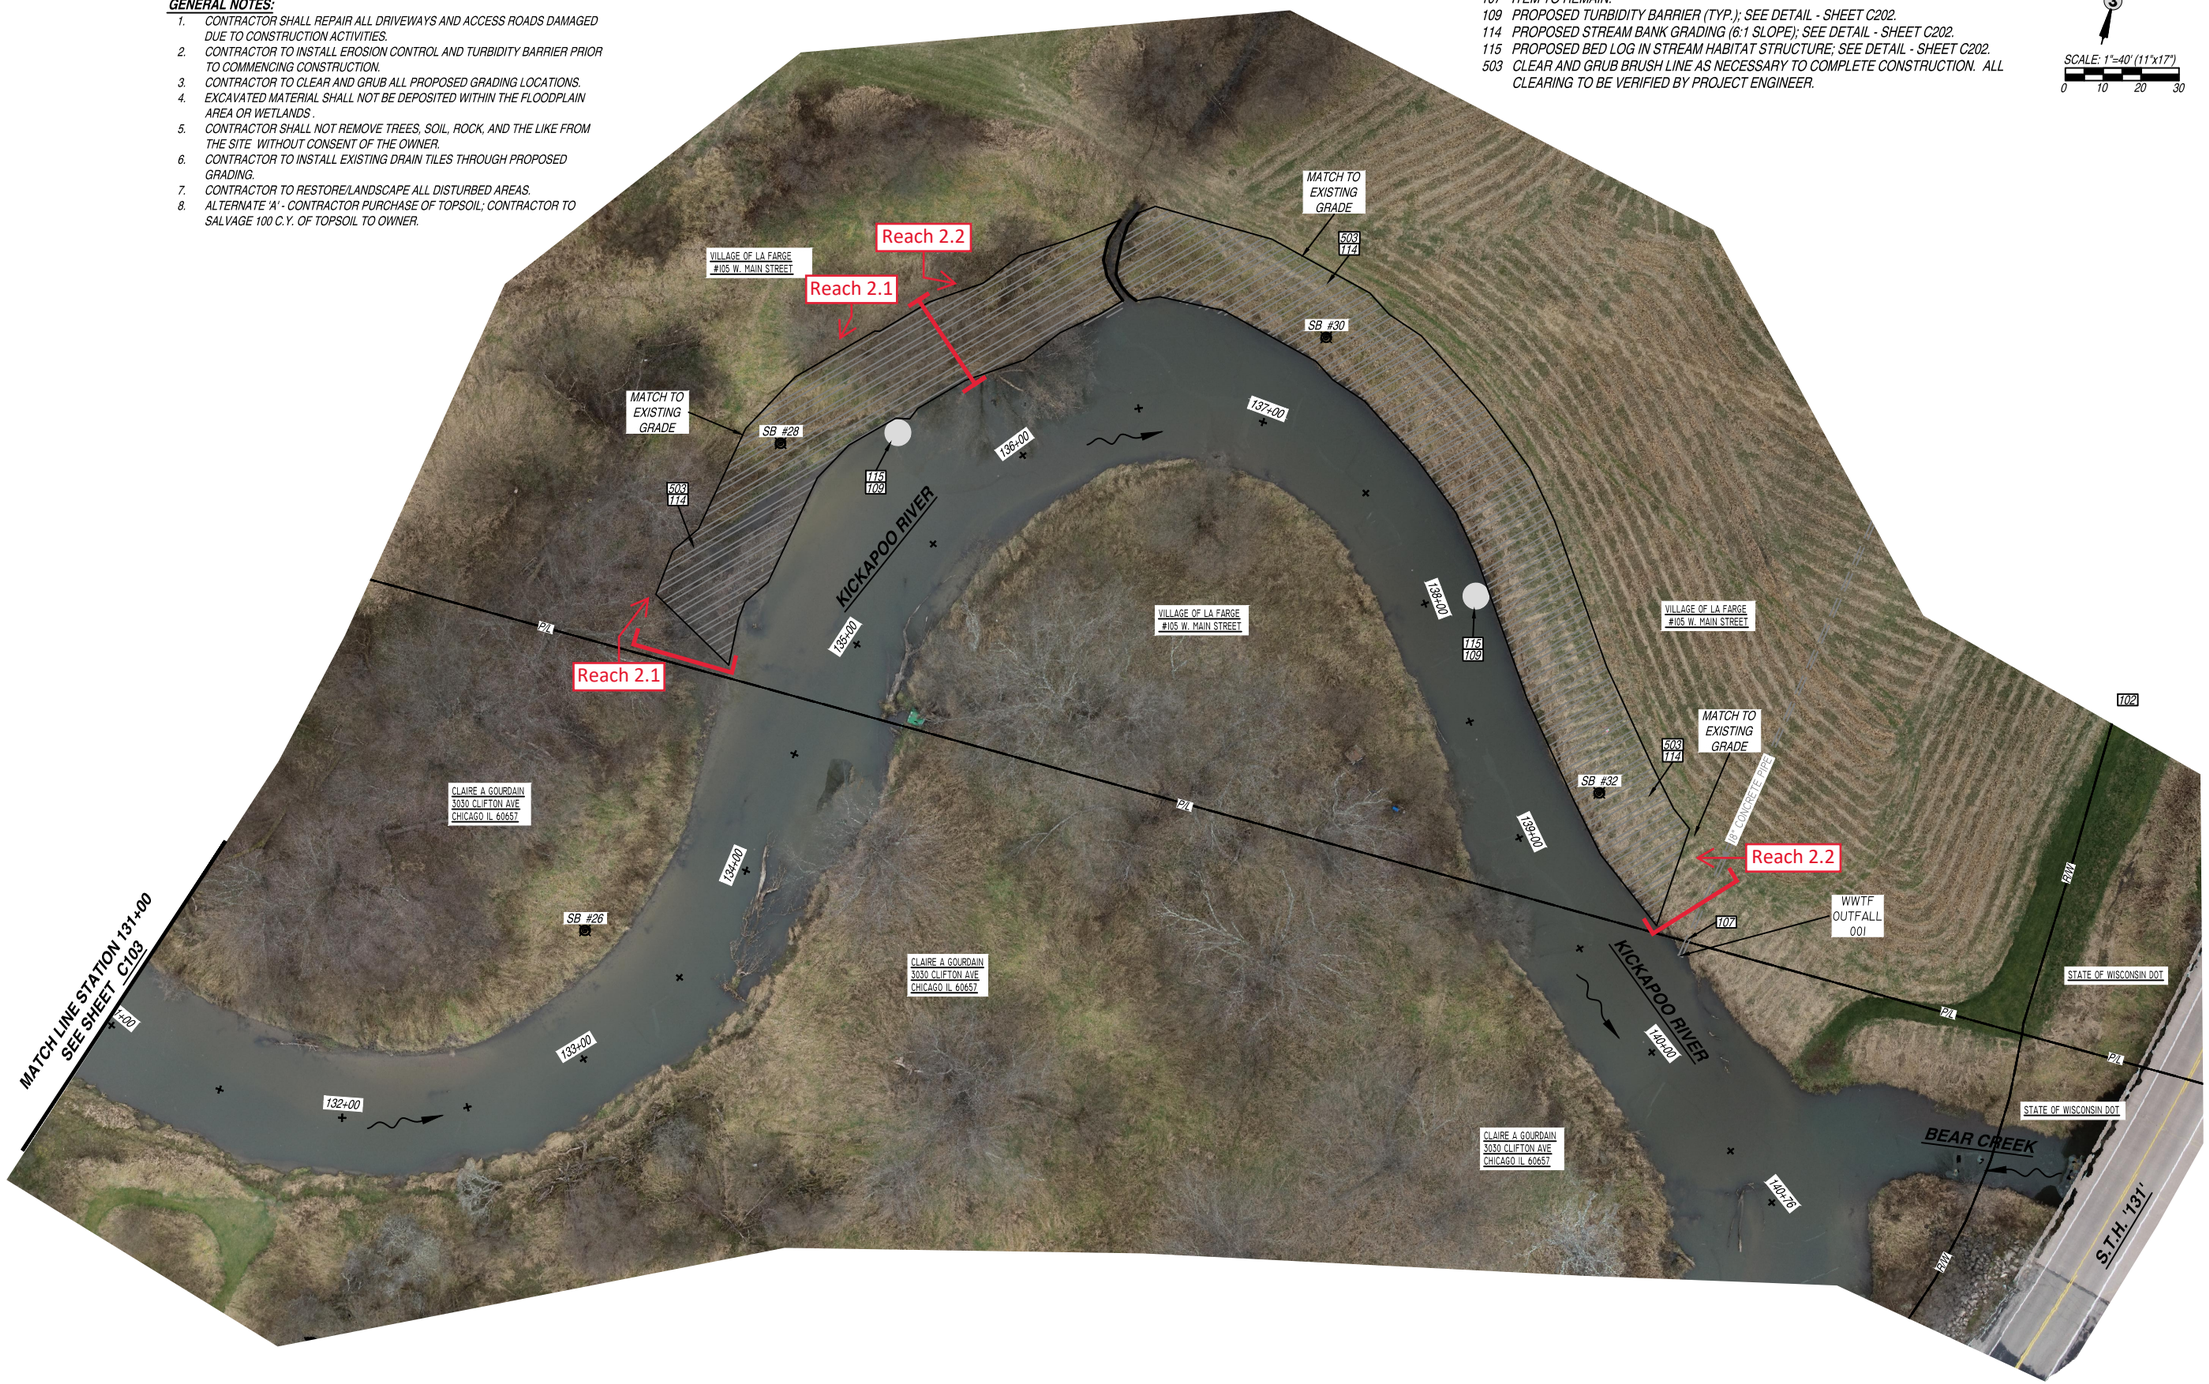

SCALE: 1"=40' (11"x17")
0 10 20 30

ENGINEER:
DELTA 3
EVERY ANGLE COVERED
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & GIS/D SERVICES
875 SOUTH CHESTNUT STREET PHONE: (608) 348-5355
PLATTEVILLE, WISCONSIN 53818
898 JACKSON STREET PHONE: (563) 542-9005
DUBUQUE, IOWA 52001

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:
MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT
ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK
LA FARGE, WISCONSIN


PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639

REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		------

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	SEE BAR SCALE
DRAWN BY	JORDAN FURE
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	PLAN VIEW - REACH 2

SHEET TITLE:
C104

SHEET NUMBER # 06 of 09

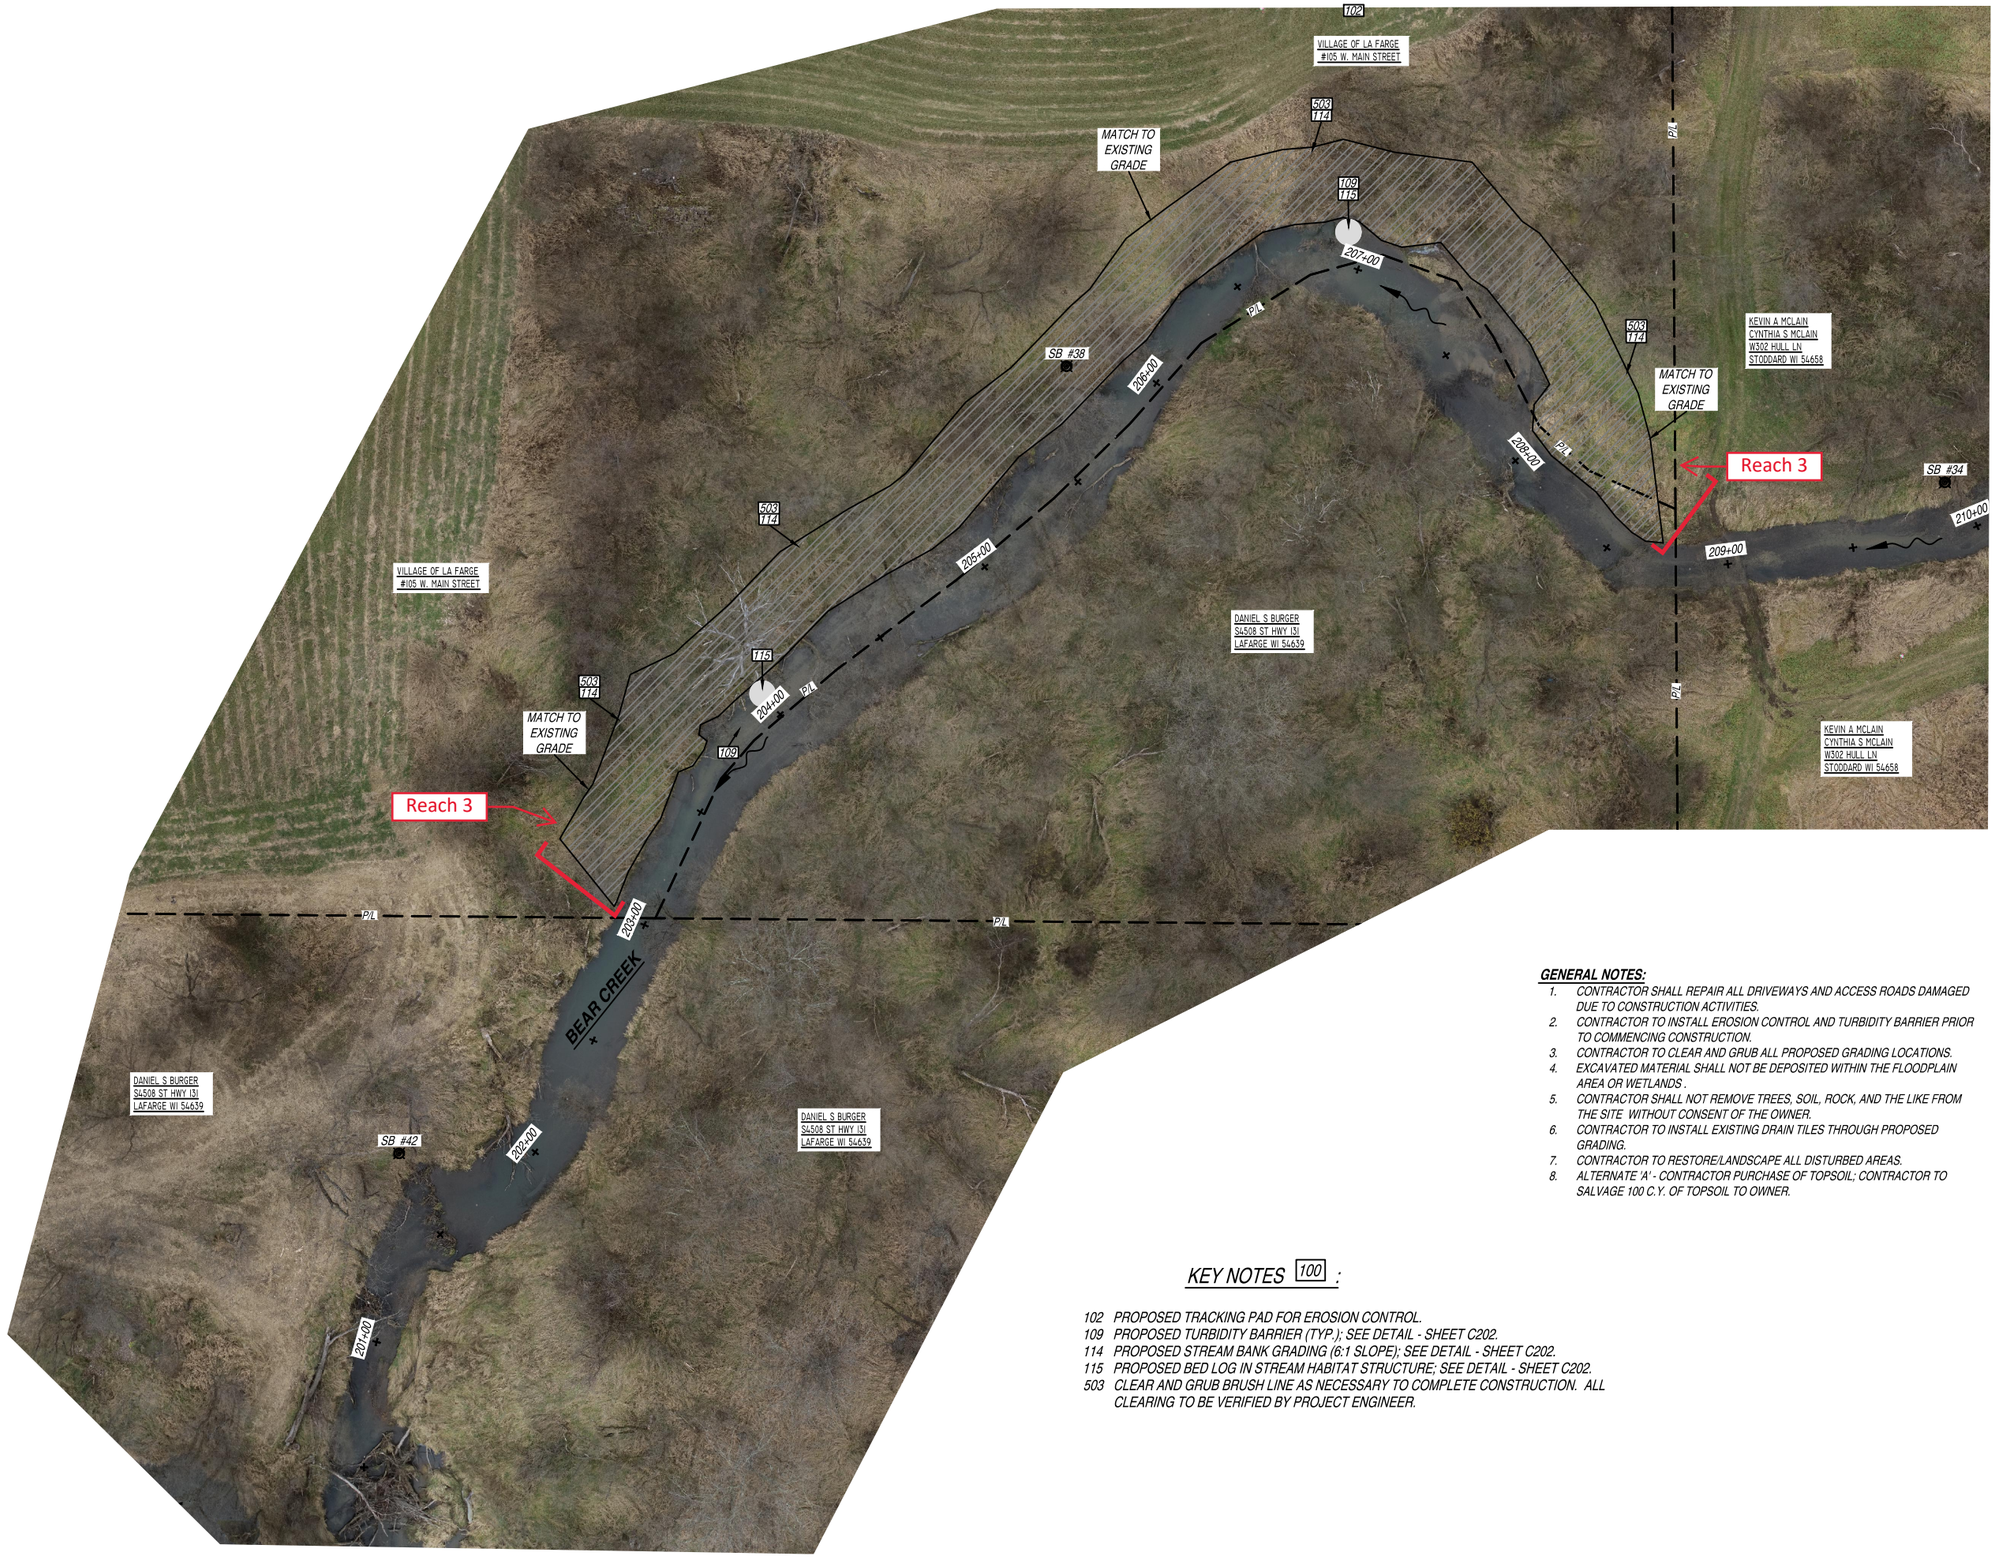

SCALE: 1"=40' (11"x17")

0 10 20 30

GENERAL NOTES:

1. CONTRACTOR SHALL REPAIR ALL DRIVEWAYS AND ACCESS ROADS DAMAGED DUE TO CONSTRUCTION ACTIVITIES.
2. CONTRACTOR TO INSTALL EROSION CONTROL AND TURBIDITY BARRIER PRIOR TO COMMENCING CONSTRUCTION.
3. CONTRACTOR TO CLEAR AND GRUB ALL PROPOSED GRADING LOCATIONS.
4. EXCAVATED MATERIAL SHALL NOT BE DEPOSITED WITHIN THE FLOODPLAIN AREA OR WETLANDS .
5. CONTRACTOR SHALL NOT REMOVE TREES, SOIL, ROCK, AND THE LIKE FROM THE SITE WITHOUT CONSENT OF THE OWNER.
6. CONTRACTOR TO INSTALL EXISTING DRAIN TILES THROUGH PROPOSED GRADING.
7. CONTRACTOR TO RESTORE/LANDSCAPE ALL DISTURBED AREAS.
8. ALTERNATE 'A' - CONTRACTOR PURCHASE OF TOPSOIL; CONTRACTOR TO SALVAGE 100 C.Y. OF TOPSOIL TO OWNER.

KEY NOTES [100] :

102 PROPOSED TRACKING PAD FOR EROSION CONTROL.
109 PROPOSED TURBIDITY BARRIER (TYP.); SEE DETAIL - SHEET C202.
114 PROPOSED STREAM BANK GRADING (6:1 SLOPE); SEE DETAIL - SHEET C202.
115 PROPOSED BED LOG IN STREAM HABITAT STRUCTURE; SEE DETAIL - SHEET C202.
503 CLEAR AND GRUB BRUSH LINE AS NECESSARY TO COMPLETE CONSTRUCTION. ALL CLEARING TO BE VERIFIED BY PROJECT ENGINEER.

ENGINEER:

DELTA 3
EVERY ANGLE COVERED

PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & GIS/CAD SERVICES

825 SOUTH CHESTNUT STREET, PLATTEVILLE, WISCONSIN 53818 — PHONE: (608) 348-5355
898 JACKSON STREET, DUBUQUE, IOWA 52001 — PHONE: (563) 542-9005

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639


REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	SEE BAR SCALE
DRAWN BY	JORDAN FURE
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	PLAN VIEW - REACH 3

SHEET TITLE:


C105

SHEET NUMBER # 07 of 09



SILT FENCE - JOINING TWO LENGTHS DETAIL

SCALE: N.T.S.




SILT FENCE - TRENCH DETAIL

SCALE: N.T.S.

GENERAL NOTES- SILT FENCE:

DETAILS OF CONSTRUCTION NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE WISDOT STANDARD SPECIFICATIONS FOR HIGHWAY AND STRUCTURE CONSTRUCTION (MOST CURRENT EDITION) AND THE APPLICABLE SPECIAL PROVISIONS.


1. *TRENCH SHALL BE A MINIMUM OF 4" WIDE & 6" DEEP TO BURY AND ANCHOR THE GEOTEXTILE FABRIC. FOLD MATERIAL TO FIT TRENCH AND BACKFILL & COMPACT TRENCH WITH EXCAVATED SOIL.*
2. *WOOD POST SHALL BE A MINIMUM SIZE OF 1-1/8" X 1-1/8" OF OAK OR HICKORY.*

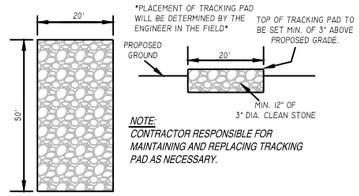

NOTE:
CONTRACTOR RESPONSIBLE FOR MAINTAINING AND REPLACING TRACKING PAD AS NECESSARY.


TRACKING PAD DETAIL

SCALE: N.T.S.



TRENCH DETAIL

SCALE: N.T.S.

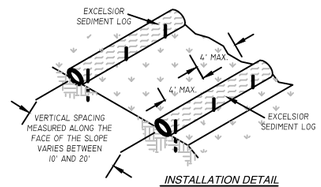


INSTALLATION DETAIL

SCALE: N.T.S.

TYPE 1 = 20" ROLL (HEAVY DUTY CONCENTRATED FLOW)
TYPE 2 = 12" ROLL (HEAVY CONCENTRATED FLOW)
TYPE 3 = 9" ROLL (MILD CONCENTRATED FLOW)
TYPE 4 = 6" ROLL (LOW CONCENTRATED FLOW)

EROSION CONTROL SEDIMENT LOG

SCALE: N.T.S.

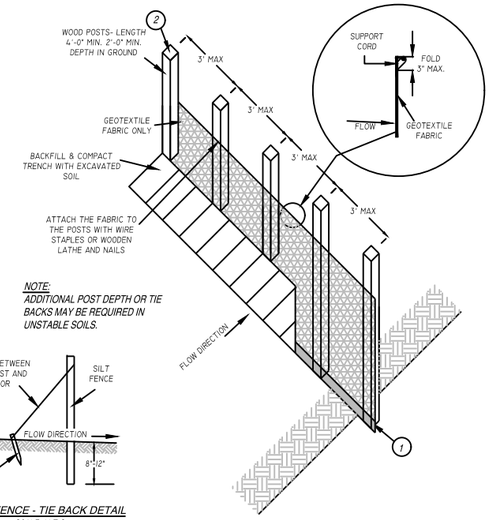

NOTE:
ADDITIONAL POST DEPTH OR TIE BACKS MAY BE REQUIRED IN UNSTABLE SOILS.

SILT FENCE - TIE BACK DETAIL


SCALE: N.T.S.

SILT FENCE INSTALLATION DETAIL

SCALE: N.T.S.


SILT FENCE DETAILS

SCALE: N.T.S.

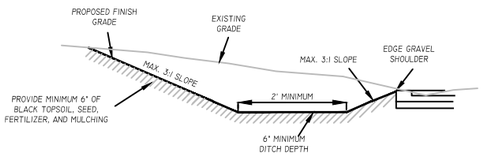

REGRADED DITCH DETAIL

SCALE: N.T.S.

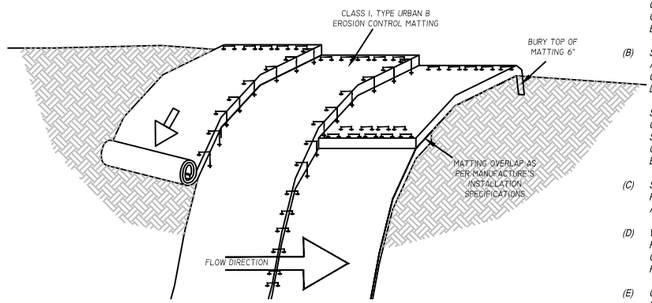

EROSION MATTING NOTES:

1. *PREPARE SOIL BEFORE INSTALLING BLANKETS, INCLUDING APPLICATION OF FERTILIZER AND MULCH AND SEED.*
2. *BEGIN AT THE TOP OF THE SHOULDER (OR CHANNEL) BY ANCHORING THE BLANKET IN A 6" DEEP X 6" WIDE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING.*
3. *ROLL THE BLANKETS DOWN (STARTING AT DOWNSTREAM PROCEEDING UPSTREAM) HORIZONTALLY ACROSS THE SLOPE.*
4. *THE EDGES OF PARALLEL BLANKETS MUST BE STAPLED WITH MANUFACTURE'S RECOMENDED OVERLAP.*
5. *WHEN BLANKETS MUST BE SPLICED DOWN THE SLOPE, PLACE BLANKETS END OVER END (SHINGLE STYLE) WITH AN OVERLAP. USE A DOUBLE ROW OF STAGGERED STAPLES 4" APART TO SECURE BLANKETS.*
6. *IN HIGH CHANNEL APPLICATIONS, A STAPLE SLOT IS RECOMMENDED AT 30 TO 40 FOOT INTERVALS. USE A ROW OF STAPLES 4" APART OVER THE ENTIRE WIDTH OF THE CHANNEL. PLACE A SECOND ROW 4" BELOW THE FIRST ROW IN A STAGERED PATTERN.*
7. *THE TERMINAL END OF THE BLANKETS MUST BE ANCHORED IN A 6" DEEP X 6" WIDE TRENCH. BACKFILL AND COMPACT THE TRENCH AFTER STAPLING.*

EROSION MATTING - SLOPE INSTALLATION DETAIL

SCALE: N.T.S.

EROSION CONTROL NOTES:

1. *GENERAL EROSION NOTES AND MAINTENANCE MEASURES ARE ILLUSTRATED ON THE PLAN SHEETS. AFTER AWARD OF THE CONTRACT, THE GENERAL CONTRACTOR SHALL INSTALL ALL BEST MANAGEMENT PRACTICES AS SHOWN ON THE PLAN SHEETS. ONCE INSTALLED, THE GENERAL CONTRACTOR SHALL CONTACT DELTA 3 ENGINEERING, INC. (608-348-5355). ONCE NOTIFIED DELTA 3 ENGINEERING INC. WILL VISIT THE SITE WITHIN 5 DAYS TO REVIEW THE SITE WITH THE GENERAL CONTRACTORS SUPERINTENDENT. UPON VISITING THE SITE, THE CONSULTING ENGINEER AND THE GENERAL CONTRACTORS SUPERINTENDENT WILL REVIEW THE SITE FOR COMPLIANCE WITH THE EROSION CONTROL MEASURES. IF AND WHEN ALL BEST MANAGEMENT PRACTICES REQUIRED TO COMMENCE SITE CONSTRUCTION ARE IN PLACE, THE CONSULTING ENGINEER AND PROJECT SUPERINTENDENT WILL SIGN AND CERTIFY THIS FACT. THIS REVIEW AND CERTIFICATION SHALL TAKE PLACE PRIOR TO THE REQUIRED PRE-CONSTRUCTION MEETING. THE SITE SUPERINTENDENT SHALL MAINTAIN AN AS-BUILT COPY OF THE EROSION CONTROL MEASURES ON SITE AT ALL TIMES. ANY ACTIVITIES INVOLVING INSTALLATION OF BEST MANAGEMENT PRACTICES SHALL BE INDICATED ON THE AS-BUILT PLAN WITH AN INSTALLED TIME AND DATE. RECORDED INFORMATION SHALL BE PERMANENTLY PLACED ON THE SITE MAP INCLUDING ANY CHANGES MADE TO THE BEST MANAGEMENT PRACTICES. IF THE SITE MAP BECOMES HARD TO READ, THE INITIAL DRAWING SHALL BE SAVED AND A CLEAN COPY SHALL BE ISSUED IN ORDER TO CONTINUE RECORDING ANY ON-SITE EROSION CONTROL ACTIVITY.*
2. *A COMPLETE COPY OF ALL INSPECTION REPORTS, PLAN REVISIONS, ETC., MUST BE RETAINED AT THE PROJECT SITE AT ALL TIMES DURING DURATION OF THE PROJECT AND KEPT IN THE PERMANENT PROJECT RECORDS FOR AT LEAST FIVE YEARS FOLLOWING SUBMISSION OF THE NOTICE OF TERMINATION (NOT).*
3. *THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE FOR INSURING THAT ALL SUB-CONTRACTORS INVOLVED IN GROUND DISTURBING ACTIVITY COMPLY WITH THE EROSION CONTROL REQUIREMENTS.*
4. *DAILY INSPECTIONS BY THE PROJECT SUPERINTENDENT AND MONTHLY INSPECTIONS BY THE OWNER'S CONSTRUCTION MANAGER MUST BE MADE TO DETERMINE THE EFFECTIVENESS OF THE EROSION CONTROL MEASURES. THE GENERAL CONTRACTOR IS TO INSPECT EROSION AND SEDIMENT CONTROLS WITHIN 24 HOURS AFTER A RAINFALL EVENT OF 0.5 INCHES OR GREATER. THE GENERAL CONTRACTOR SHALL BE RESPONSIBLE TO REPAIR OR REPLACE EROSION AND SEDIMENT CONTROL BEST MANAGEMENT PRACTICES AS NECESSARY WITHIN 24 HOURS OF INSPECTION.*
5. *ONCE THE SITE REACHES FINAL STABILIZATION, ALL PERMANENT EROSION AND SEDIMENTATION CONTROLS ARE INSTALLED AND ALL TEMPORARY EROSION AND SEDIMENTATION CONTROLS ARE REMOVED, THE GENERAL CONTRACTOR AND OWNER MUST COMPLETE A FINAL SITE INSPECTION. UPON APPROVAL BY OWNER, THE OWNER AND GENERAL CONTRACTOR, AS APPLICABLE, MUST COMPLETE AND SUBMIT A NOTICE OF TERMINATION (NOT) FORM TO BE SUBMITTED TO THE WISCONSIN DEPARTMENT OF NATURAL RESOURCES.*
6. *A RECORD OF THE DATES WHEN MAJOR GROUND-DISTURBING ACTIVITIES OCCUR, WHEN CONSTRUCTION ACTIVITIES TEMPORARILY OR PERMANENTLY CEASE ON A PORTION OF THE SITE, AND WHEN STABILIZATION MEASURES ARE INITIATED MUST BE MAINTAINED UNTIL THE NOT IS FILED. CONTROLS MUST BE IN PLACE DOWN GRADIENT OF GROUND-DISTURBING ACTIVITIES PRIOR TO THE COMMENCEMENT OF CONSTRUCTION.*
7. *A LOG OF ALL INSPECTIONS BY FEDERAL, STATE, OR LOCAL STORM WATER OR OTHER ENVIRONMENTAL AGENCIES SHALL BE KEPT BY THE GENERAL CONTRACTOR. THE LOG SHALL INCLUDE THE DATE AND TIME OF VISIT AND WHETHER A REPORT WAS ISSUED OR WILL BE ISSUED AS A RESULT OF THE INSPECTION. ANY REPORTS ISSUED SHALL BE FAXED TO THE DELTA 3 ENGINEERING INC. 608-348-5455 (FAX).*
8. *SOIL STABILIZATION - THE PURPOSE OF SOIL STABILIZATION IS TO PREVENT SOIL FROM LEAVING THE SITE. IN THE NATURAL CONDITION, SOIL IS STABILIZED BY NATIVE VEGETATION. THE PRIMARY TECHNIQUE TO BE USED AT THIS PROJECT FOR STABILIZING SITE SOIL WILL BE TO PROVIDE A PROTECTIVE COVER OF TURF GRASS OR PAVEMENT.*

   (A) TEMPORARY SEEDING OR STABILIZATION - AREAS MAY BE STABILIZED TEMPORARILY WITH THE USE OF FAST-GERMINATING ANNUAL SEED, STRAW MULCH, WOOD CELLULOSE FIBERS, TACKIFIERS, NETTING OR BLANKET. WHERE CONDITIONS ARE FAVORABLE, AREAS SHALL BE TEMPORARILY STABILIZED WITHIN 7 DAYS AFTER CONSTRUCTION ACTIVITY CEASES. ALL DISTURBED GROUND WHERE THERE WILL NOT BE CONSTRUCTION FOR LONGER THAN 14 DAYS MUST BE SEEDED OR OTHERWISE STABILIZED.

   (B) PERMANENT SEEDING OR SOD - ALL AREAS AT FINAL GRADE MUST BE SEEDED OR SODDED WITHIN 3 DAYS AFTER COMPLETION OF THE MAJOR CONSTRUCTION ACTIVITY. EXCEPT FOR SMALL LEVEL SPOTS, SEEDED AREAS SHOULD GENERALLY BE PROTECTED WITH MULCH. ALL AREAS TO BE SEEDED WILL ALSO HAVE TOPSOIL AND OTHER AMENDMENTS AS STATED IN WISDOT SPECIFICATION SECTION 02900-PLANTING.

   (C) MULCHING - ALL AREAS THAT ARE TEMPORARY OR PERMANENT SEEDED SHALL BE MULCHED ACCORDING TO SECTION 627 - MULCHING OF THE WISDOT STANDARD SPECIFICATIONS FOR HIGHWAY CONSTRUCTION. ALL MULCH IS TO BE ANCHORED UTILIZING METHOD A, B, OR C.

   (D) EROSION CONTROL MATTING - FOR ANY SLOPES GREATER THAN 3:1, EROSION MATTING IS REQUIRED.
9. *STRUCTURAL CONTROLS - BEFORE ANY MAJOR GRADING ACTIVITIES, THE FOLLOWING BEST MANAGEMENT PRACTICES SHALL BE INSTALLED ON THE PROPOSED SITE - SILT FENCE, TEMPORARY TRACKING PAD, AND STORM SEWER INLET PROTECTION.*

   (A) SILT FENCE - SILT FENCE IS A SYNTHETIC PERMEABLE WOVEN OR NON-WOVEN FABRIC TYPICALLY INCORPORATING WOODEN OR METAL SUPPORT STAKES AT INTERVALS SUFFICIENT TO SUPPORT THE FENCE, WATER, AND SEDIMENT RETAINED BY THE FENCE. SILT FENCE CAN ALSO BE INSTALLED WITH A WIRE FENCE BACKING. THE FENCE IS DESIGNED TO RETAIN SEDIMENT-LADEN WATER AND ALLOW SETTLEMENT OF SUSPENDED SOILS BEFORE THE STORM WATER FLOWS THROUGH THE FABRIC FOR DISCHARGE DOWNSTREAM. SILT FENCE SHALL BE LOCATED AS SHOWN ON THE PLAN SHEETS. THE SILT FENCE TO BE INCLUDED FOR THIS PROJECT SHALL BE CONSTRUCTED PER WISCONSIN DNR TECHNICAL STANDARDS FOR SILT FENCE (CODE 1056).

   (B) TEMPORARY TRACKING PAD - ALL ACCESS POINTS FROM THE PUBLIC STREET INTO THE CONSTRUCTION SITE SHALL INCLUDE A TRACKING PAD COMPOSED OF COURSE STONE TO THE DIMENSIONS SHOWN ON DETAIL SHEET (C201). ANY SEDIMENT REACHING A PUBLIC OR PRIVATE ROAD SHALL BE REMOVED BY STREET CLEANING (NOT FLUSHING) BEFORE THE END OF EACH WORKDAY.

   (C) STORM SEWER INLET PROTECTION - CURB AND GRATED INLETS ARE PROTECTED FROM THE INTRUSION OF SILT AND SEDIMENT THROUGH A VARIETY OF SEDIMENT CONTROL PRACTICES TO ALLOW SETTLEMENT OF SUSPENDED SOILS BEFORE DISCHARGING INTO THE STORM SEWER. GRATED INLETS TYPICALLY INCLUDE A STURDY FRAME WRAPPED IN GEOTEXTILE FABRIC OR SEDIMENT LOG PERIMETER TO SLOW THE FLOW OF WATER AND ALLOW PONDING WHERE SEDIMENT MAY SETTLE OUT. CURB INLETS TYPICALLY INCLUDE SEDIMENT LOG BARRIERS HELD IN PLACE WITH GEOTEXTILE FABRIC. OTHER MANUFACTURED PRODUCTS ARE ALSO AVAILABLE. ALL STORM DRAINS SHALL BE PROTECTED BY USING STRAW BALES, SEDIMENT LOGS, FABRIC, OR EQUIVALENT BARRIER.

   FINAL SITE STABILIZATION IS ACHIEVED WHEN TURF GRASS COVER PROVIDES PERMANENT STABILIZATION FOR AT LEAST 70 PERCENT OF THE DISTURBED SOIL SURFACE, EXCLUSIVE OF AREAS THAT HAVE BEEN PAVED.
10. *OTHER POLLUTANT CONTROLS*

    (A) DUST CONTROL - CONSTRUCTION TRAFFIC MUST ENTER AND EXIT THE SITE AT THE STABILIZED CONSTRUCTION EXIT. THE PURPOSE IS TO TRAP DUST AND MUD THAT WOULD OTHERWISE BE CARRIED OFF-SITE BY CONSTRUCTION EQUIPMENT.

    WATER TRUCKS OR OTHER DUST CONTROL AGENTS WILL BE USED AS NEEDED DURING CONSTRUCTION TO REDUCE DUST GENERATED ON THE SITE. DUST CONTROL MUST BE PROVIDED BY THE GENERAL CONTRACTOR TO A DEGREE THAT IS ACCEPTABLE TO THE OWNER'S CONSTRUCTION MANAGER, AND IN COMPLIANCE WITH APPLICABLE LOCAL AND STATE DUST CONTROL REGULATIONS. AFTER CONSTRUCTION, THE SITE WILL BE STABILIZED (AS DESCRIBED ELSEWHERE), WHICH WILL REDUCE THE POTENTIAL FOR DUST GENERATION.

    (B) SOLID WASTE DISPOSAL - NO SOLID MATERIALS, INCLUDING BUILDING MATERIALS, ARE ALLOWED TO BE DISCHARGED FROM THE SITE WITH STORM WATER. ALL SOLID WASTE, INCLUDING DISPOSABLE MATERIALS INCIDENTAL TO THE MAJOR CONSTRUCTION ACTIVITIES, MUST BE COLLECTED AND PLACED IN CONTAINERS. THE CONTAINERS WILL BE EMPTIED AS NECESSARY BY A CONTRACT TRASH DISPOSAL SERVICE AND HAULED AWAY FROM THE SITE. THE LOCATION OF SOLID WASTE RECEPTACLES SHALL BE SHOWN AND APPROVED BY THE OWNER.

    SUBSTANCES THAT HAVE THE POTENTIAL FOR POLLUTING SURFACE AND/OR GROUNDWATER MUST BE CONTROLLED BY WHATEVER MEANS NECESSARY IN ORDER TO ENSURE THAT THEY DO NOT DISCHARGE FROM THE SITE. FOR EXAMPLE, SPECIAL CARE MUST BE EXERCISED DURING EQUIPMENT FUELING AND SERVICING OPERATIONS. IF A SPILL OCCURS, IT MUST BE CONTAINED AND DISPOSED SO THAT IT WILL NOT FLOW FROM THE SITE OR ENTER GROUNDWATER, EVEN IF THIS REQUIRES REMOVAL, TREATMENT, AND DISPOSAL OF SOIL. IN THIS REGARD, POTENTIALLY POLLUTING SUBSTANCES SHOULD BE HANDLED IN A MANNER CONSISTENT WITH THE IMPACT THEY REPRESENT.

    (C) SANITARY FACILITIES - ALL PERSONNEL INVOLVED WITH CONSTRUCTION ACTIVITIES MUST COMPLY WITH STATE AND LOCAL SANITARY OR SEPTIC SYSTEM REGULATIONS. TEMPORARY SANITARY FACILITIES MUST BE PROVIDED AT THE SITE THROUGHOUT THE CONSTRUCTION PHASE. THEY MUST BE UTILIZED BY ALL CONSTRUCTION PERSONNEL AND MUST BE SERVICED BY A COMMERCIAL OPERATOR.

    (D) WATER SOURCE - NON-STORM WATER COMPONENTS OF SITE DISCHARGE MUST BE CLEAN WATER. WATER USED FOR CONSTRUCTION WHICH DISCHARGES FROM THE SITE MUST ORIGINATE FROM A PUBLIC WATER SUPPLIER, OR PRIVATE WELL APPROVED BY THE STATE HEALTH DEPARTMENT. WATER USED FOR CONSTRUCTION THAT DOES NOT ORIGINATE FROM AN APPROVED PUBLIC SUPPLY MUST NOT DISCHARGE FROM THE SITE. IT CAN BE RETAINED IN THE PONDS UNTIL IT INFILTRATES AND EVAPORATES.

    (E) CONCRETE WASTE FROM CONCRETE READY-MIX TRUCKS - DISCHARGE OF EXCESS OR WASTE CONCRETE AND/OR WASH WATER FROM CONCRETE TRUCKS WILL BE ALLOWED ON THE CONSTRUCTION SITE, BUT ONLY IN SPECIFICALLY DESIGNATED DIKED AREAS PREPARED TO PREVENT CONTACT BETWEEN THE CONCRETE AND/OR WASH WATER AND STORM WATER THAT WILL BE DISCHARGED FROM THE SITE. ALTERNATIVELY, WASTE CONCRETE CAN BE PLACED INTO FORMS TO MAKE RIP-RAP OR OTHER USEFUL CONCRETE PRODUCTS. THE CURED RESIDUE FROM THE CONCRETE WASHOUT DIKED AREAS SHALL BE DISPOSED IN ACCORDANCE WITH APPLICABLE STATE AND FEDERAL REGULATIONS. THE JOB SITE SUPERINTENDENT IS RESPONSIBLE FOR ASSURING THAT THESE PROCEDURES ARE FOLLOWED.

    (F) FUEL TANKS - TEMPORARY ON-SITE FUEL TANKS FOR CONSTRUCTION VEHICLES SHALL MEET ALL STATE AND FEDERAL REGULATIONS. TANKS SHALL HAVE APPROVED SPILL CONTAINMENT WITH THE CAPACITY REQUIRED BY THE APPLICABLE REGULATIONS. THE TANK SHALL BE IN SOUND CONDITION FREE OF RUST OR OTHER DAMAGE WHICH MIGHT COMPROMISE CONTAINMENT. HOSES, VALVES, FITTINGS, CAPS, FILLER NOZZLES, AND ASSOCIATED HARDWARE SHALL BE MAINTAINED IN PROPER WORKING CONDITION AT ALL TIMES.
11. *MINIMIZING EROSION AND RUNOFF DURING TRENCH OPERATIONS*

    (A) EXCAVATED TRENCH MATERIALS SHALL BE PLACED ON THE UPPER SIDE OF THE TRENCH WHILE THE TRENCH IS OPEN.

    (B) EXCAVATED TRENCH MATERIAL, UPON COMPLETING WORK IN TRENCH, SHALL BE PLACED BACK IN THE TRENCH OR HAULED AWAY TO A PROPER SPOIL SITE. THE TRENCH SHALL BE BACKFILLED AND STABILIZED AT THE END OF EACH WORKING DAY.

ENGINEER:

DELTA 3 (EVERY ANGLE COVERED)

PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & CADD SERVICES

825 SOUTH CHESTNUT STREET — PHONE: (608) 348-5355
PLATTEVILLE, WISCONSIN 53818

898 JACKSON STREET — PHONE: (563) 542-9055
DUBUQUE, IOWA 52001

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639

REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.-----


FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	NOT TO SCALE
DRAWN BY	C.COYIER
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	DETAILS - EROSION CONTROL & NOTES

SHEET TITLE:

C201

SHEET NUMBER # 08 of 09

Figure 1. Turbidity Barrier Placement Details

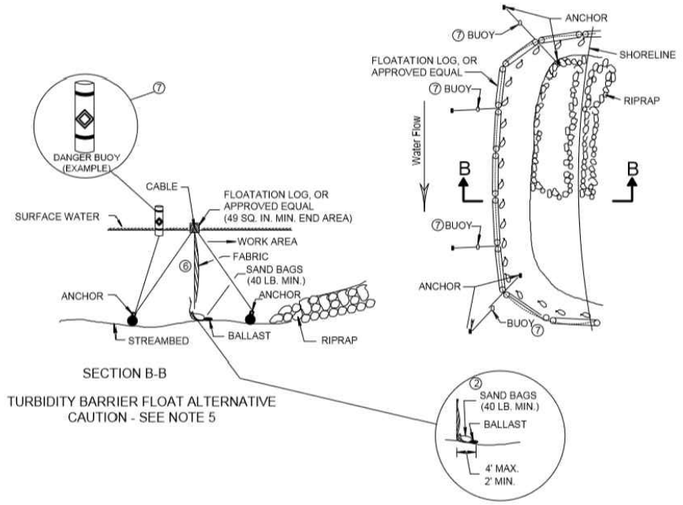

SECTION B-B

TURBIDITY BARRIER FLOAT ALTERNATIVE
CAUTION - SEE NOTE 5

GENERAL NOTES

DETAILS OF CONSTRUCTION, MATERIALS AND WORKMANSHIP NOT SHOWN ON THIS DRAWING SHALL CONFORM TO THE PERTINENT REQUIREMENTS OF THE STANDARD AND THE APPLICABLE SPECIAL PROVISIONS

TURBIDITY BARRIER MAY BE REMOVED AT THE ENGINEERS OR PROJECT MANAGERS DISCRETION, WHEN PERMANENT EROSION CONTROL MEASURES HAVE BEEN ESTABLISHED.

① DRIVEN STEEL POSTS, PIPES, OR CHANNELS. LENGTH SHALL BE SUFFICIENT TO SECURELY SUPPORT BARRIER AT HIGH WATER ELEVATIONS.

② SANDBAGS TO BE USED AS ADDITIONAL BALLAST WHEN ORDERED BY THE ENGINEER OR PROJECT MANAGER TO MEET ADVERSE FIELD CONDITIONS. SPACE AS APPROPRIATE FOR SITE CONDITIONS.


③ WHEN BARRIER HEIGHT, H, EXCEEDS 8 FT., POST SPACING MAY NEED TO BE DECREASED.

④ IN WATERWAYS SUBJECT TO FLUCTUATING WATER ELEVATIONS, PROVISIONS SHOULD BE MADE TO ALLOW THE WATER TO EQUALIZE ON EACH SIDE OF THE BARRIER. THIS MAY BE ACCOMPLISHED BY LEAVING A PORTION OF THE BARRIER OPEN ON THE UPSTREAM END.

⑤ FLOAT ALTERNATIVE WILL ONLY BE ALLOWED WITH WRITTEN APPROVAL OF THE ENGINEER OR PROJECT MANAGER, AND IS MEANT FOR LOCATIONS WHERE BED ROCK PREVENTS THE INSTALLATION OF POSTS.


⑥ ALLOW SUFFICIENT SLACK VERTICALLY AND HORIZONTALLY SO THAT SEDIMENT BUILD UP WILL NOT SEPARATE OR LOWER THE TURBIDITY BARRIER.

⑦ USE AS DIRECTED BY COAST GUARD OR DNR PERMIT WHEN WORKING IN NAVIGABLE WATERWAYS.

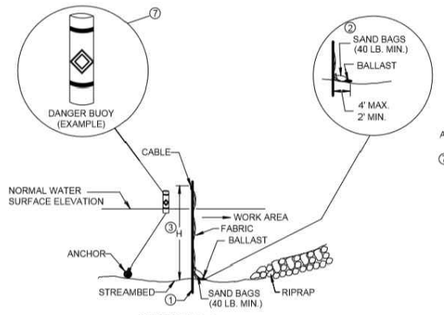


SECTION A-A

TURBIDITY BARRIER STANDARD POST INSTALLATION

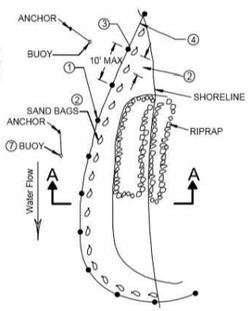


PLAN VIEW

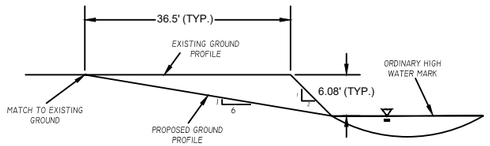


TYPICAL CROSS SECTION DETAIL - REACH 1

SCALE: N.T.S.

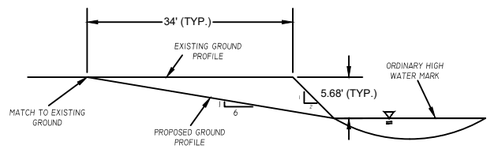


TYPICAL CROSS SECTION DETAIL - REACH 2

SCALE: N.T.S.

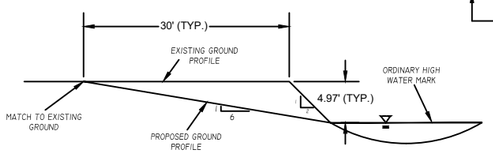


TYPICAL CROSS SECTION DETAIL - REACH 3

SCALE: N.T.S.

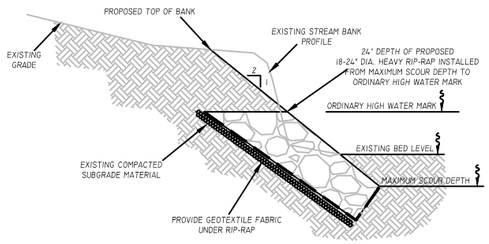


STREAM BANK GRADING (2:1 SLOPES) WITH RIP-RAP DETAIL

SCALE: N.T.S.

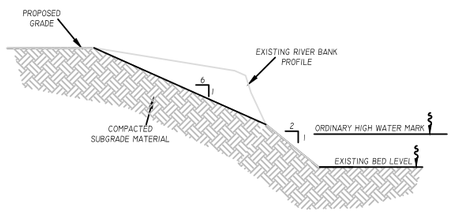

STREAM BANK GRADING (6:1 SLOPES) DETAIL

SCALE: N.T.S.

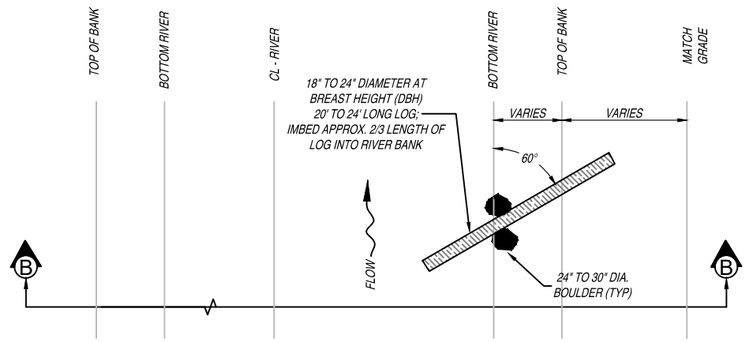


BED LOG DETAIL - PLAN VIEW

SCALE: N.T.S.

HABITAT NOTES:

1 - LOCATIONS AND ORIENTATION OF LARGE WOODY MATERIAL (LWM) AS SHOWN ON THIS SHEET ARE APPROXIMATE. FINAL LOCATIONS TO BE DETERMINED ON SITE BY THE ENGINEER.



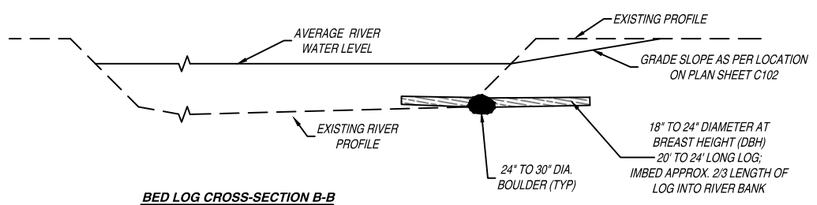

BED LOG CROSS-SECTION B-B

SCALE: N.T.S.

ENGINEER:

DELTA 3
(EVERY ANGLE COVERED)
PROFESSIONAL CIVIL, MUNICIPAL, & STRUCTURAL ENGINEERING
GRANT WRITING • LAND DEVELOPMENT • PLANNING & CADD SERVICES
875 SOUTH CHESTNUT STREET, PLATTEVILLE, WISCONSIN 53818, PHONE: (608) 348-5355
898 JACKSON STREET, DUBUQUE, IOWA 52001, PHONE: (563) 542-9005

FOR QUESTIONS REGARDING THIS PROJECT, PLEASE CONTACT:

MR. JORDAN FURE, P.E.
DELTA 3 ENGINEERING, INC.
TELEPHONE: (608) 348-5355

CONSENT STATEMENT

ALL RIGHTS RESERVED, AND NO REPRODUCTION WITHOUT CONSENT. ALL DRAWINGS, SPECS., REPORTS, DATA, AND OTHER DOCUMENTS CONTAINED ON THIS PLAN SHEET ARE CREATED BY AND FOR DELTA 3 ENGINEERING AND THEIR CLIENTS' USE. USE, REPRODUCTION, OR DISTRIBUTION OF ANY CONTENT HEREIN, IN ANY FORM, WHETHER PRINTED, ELECTRONIC, OR OTHERWISE, REQUIRES THE EXPLICIT WRITTEN PERMISSION OF THE OWNER.

PROPOSED 2023 STREAM IMPROVEMENTS - KICKAPOO RIVER & BEAR CREEK

LA FARGE, WISCONSIN

PROJECT LOCATION: VILLAGE OF LA FARGE - KICKAPOO RIVER & BEAR CREEK
OWNER: VILLAGE OF LA FARGE: 105 W. MAIN ST., LA FARGE, WI 54639

REVISIONS:		
NO.	DATE	DESCRIPTION
AS-BUILT:		BY:
--/--/----		-.-----

FOR BID	
PROJECT NUMBER	D22-145
SHEET SCALE	NOT TO SCALE
DRAWN BY	C.COYIER
DATE ISSUED	MARCH 23, 2023
SHEET DESC.	DETAILS - STREAM BANK

SHEET TITLE:

C202

SHEET NUMBER # **09 of 09**